


指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2015/04/01~2015/04/30	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

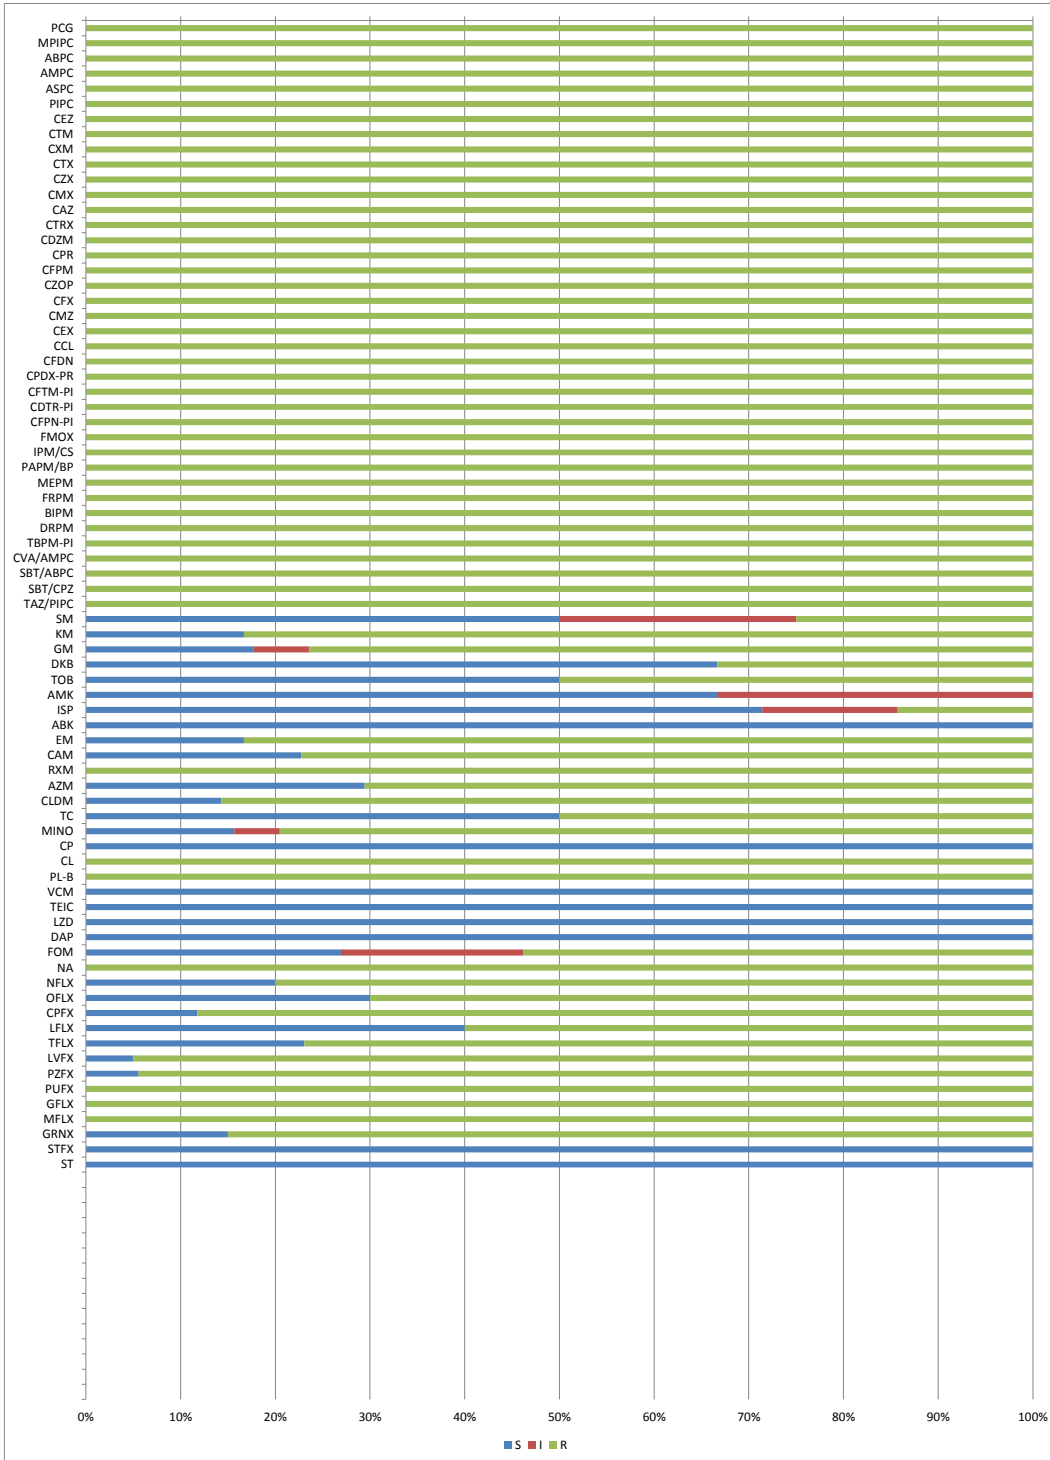

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2015/04/01~2015/04/30	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

Antibiotic	S (%)	I (%)	R (%)	合計
PCG	0(0%)	0(0%)	42(100%)	42(100%)
MPIPC	0(0%)	0(0%)	43(100%)	43(100%)
ABPC	0(0%)	0(0%)	8(100%)	8(100%)
AMPC	0(0%)	0(0%)	13(100%)	13(100%)
ASPC	0(0%)	0(0%)	1(100%)	1(100%)
PIPC	0(0%)	0(0%)	39(100%)	39(100%)
CEZ	0(0%)	0(0%)	62(100%)	62(100%)
CTM	0(0%)	0(0%)	59(100%)	59(100%)
CXM	0(0%)	0(0%)	5(100%)	5(100%)
CTX	0(0%)	0(0%)	41(100%)	41(100%)
CZX	0(0%)	0(0%)	1(100%)	1(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
CAZ	0(0%)	0(0%)	20(100%)	20(100%)
CTRX	0(0%)	0(0%)	27(100%)	27(100%)
CDZM	0(0%)	0(0%)	1(100%)	1(100%)
CPR	0(0%)	0(0%)	4(100%)	4(100%)
CFPM	0(0%)	0(0%)	60(100%)	60(100%)
CZOP	0(0%)	0(0%)	23(100%)	23(100%)
CFX	0(0%)	0(0%)	1(100%)	1(100%)
CMZ	0(0%)	0(0%)	43(100%)	43(100%)
CEX	0(0%)	0(0%)	2(100%)	2(100%)
CCL	0(0%)	0(0%)	7(100%)	7(100%)
CFDN	0(0%)	0(0%)	9(100%)	9(100%)
CPDX-PR	0(0%)	0(0%)	4(100%)	4(100%)
CFM-PI	0(0%)	0(0%)	5(100%)	5(100%)
CDTR-PI	0(0%)	0(0%)	8(100%)	8(100%)
CFPN-PI	0(0%)	0(0%)	18(100%)	18(100%)
FMOX	0(0%)	0(0%)	41(100%)	41(100%)
IPM/CS	0(0%)	0(0%)	60(100%)	60(100%)
PAPM/BP	0(0%)	0(0%)	3(100%)	3(100%)
MEPM	0(0%)	0(0%)	32(100%)	32(100%)
FRPM	0(0%)	0(0%)	4(100%)	4(100%)
BIPM	0(0%)	0(0%)	8(100%)	8(100%)
DRPM	0(0%)	0(0%)	17(100%)	17(100%)
TBPM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CVA/AMPC	0(0%)	0(0%)	4(100%)	4(100%)
SBT/ABPC	0(0%)	0(0%)	63(100%)	63(100%)
SBT/CPZ	0(0%)	0(0%)	75(100%)	75(100%)
TAZ/PIPC	0(0%)	0(0%)	11(100%)	11(100%)
SM	2(50.0%)	1(25.0%)	1(25.0%)	4(100%)
KM	1(16.7%)	0(0%)	5(83.3%)	6(100%)
GM	6(17.8%)	2(5.9%)	26(76.5%)	34(100%)
DKB	2(66.7%)	0(0%)	1(33.3%)	3(100%)
TOB	1(50.0%)	0(0%)	1(50.0%)	2(100%)
AMK	18(66.7%)	9(33.3%)	0(0%)	27(100%)
ISP	5(71.4%)	1(14.3%)	1(14.3%)	7(100%)
ABK	53(100%)	0(0%)	0(0%)	53(100%)
EM	3(16.7%)	0(0%)	15(83.3%)	18(100%)
CAM	5(22.7%)	0(0%)	17(77.3%)	22(100%)
RXM	0(0%)	0(0%)	1(100%)	1(100%)
AZM	5(29.4%)	0(0%)	12(70.6%)	17(100%)
CLDM	10(14.3%)	0(0%)	60(85.7%)	70(100%)
TC	1(50.0%)	0(0%)	1(50.0%)	2(100%)
MINO	13(15.7%)	4(4.8%)	66(79.5%)	83(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
CL	0(0%)	0(0%)	1(100%)	1(100%)
PL-B	0(0%)	0(0%)	6(100%)	6(100%)
VCM	80(100%)	0(0%)	0(0%)	80(100%)
TEIC	72(100%)	0(0%)	0(0%)	72(100%)
LZD	51(100%)	0(0%)	0(0%)	51(100%)
DAP	3(100%)	0(0%)	0(0%)	3(100%)
FOM	7(26.9%)	5(19.2%)	14(53.8%)	26(100%)
NA	0(0%)	0(0%)	1(100%)	1(100%)
NFLX	1(20.0%)	0(0%)	4(80.0%)	5(100%)
OFLX	3(30.0%)	0(0%)	7(70.0%)	10(100%)
CPFX	2(11.8%)	0(0%)	15(88.2%)	17(100%)
FLX	2(40.0%)	0(0%)	3(60.0%)	5(100%)
LFLX	3(23.1%)	0(0%)	10(76.9%)	13(100%)
LVFX	4(5.0%)	0(0%)	76(95.0%)	80(100%)
PZFX	1(5.6%)	0(0%)	17(94.4%)	18(100%)
PUFX	0(0%)	0(0%)	2(100%)	2(100%)
GFLX	0(0%)	0(0%)	2(100%)	2(100%)
MFLX	0(0%)	0(0%)	3(100%)	3(100%)
GRNX	3(15.0%)	0(0%)	17(85.0%)	20(100%)
STFX	1(100%)	0(0%)	0(0%)	1(100%)
ST	13(100%)	0(0%)	0(0%)	13(100%)