




指定感染菌 薬剤感受性状況

印刷日: 2015/07/29 14:28:02

指定感染菌 薬剤感受性状況

抽出条件		
受付日	菌	医療機関
2015/06/01~2015/06/30	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

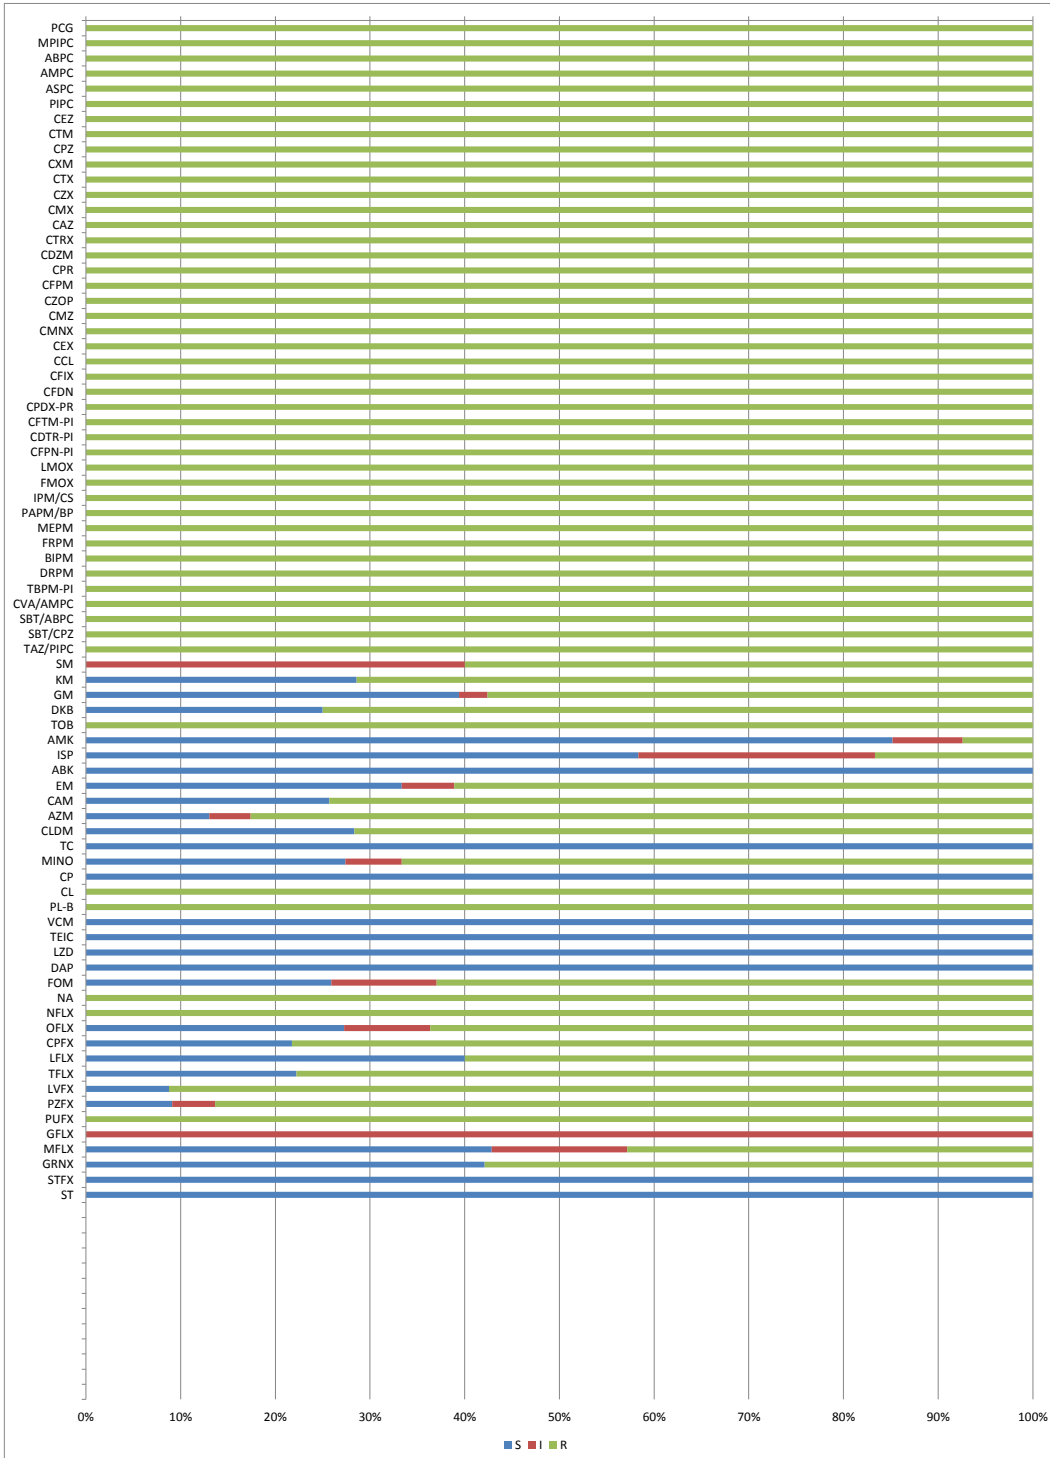

抽出条件				
受付日	菌			
2015/06/01~2015/06/30	S.aureus (MRSA)			

指定感染菌 薬剤感受性状況表

指定感染菌	S	I	R	合計
PCG	0(0%)	0(0%)	34(100%)	34(100%)
MPIP	0(0%)	0(0%)	34(100%)	34(100%)
ABPC	0(0%)	0(0%)	10(100%)	10(100%)
AMPC	0(0%)	0(0%)	22(100%)	22(100%)
ASPC	0(0%)	0(0%)	2(100%)	2(100%)
PIPC	0(0%)	0(0%)	45(100%)	45(100%)
CEZ	0(0%)	0(0%)	57(100%)	57(100%)
CTM	0(0%)	0(0%)	63(100%)	63(100%)
CPZ	0(0%)	0(0%)	1(100%)	1(100%)
CXM	0(0%)	0(0%)	5(100%)	5(100%)
CTX	0(0%)	0(0%)	35(100%)	35(100%)
CZX	0(0%)	0(0%)	2(100%)	2(100%)
CMX	0(0%)	0(0%)	2(100%)	2(100%)
CAZ	0(0%)	0(0%)	26(100%)	26(100%)
CTR	0(0%)	0(0%)	35(100%)	35(100%)
CDZ	0(0%)	0(0%)	1(100%)	1(100%)
CPR	0(0%)	0(0%)	3(100%)	3(100%)
CFPM	0(0%)	0(0%)	51(100%)	51(100%)
CZOP	0(0%)	0(0%)	22(100%)	22(100%)
CMZ	0(0%)	0(0%)	38(100%)	38(100%)
CMNX	0(0%)	0(0%)	1(100%)	1(100%)
CEX	0(0%)	0(0%)	5(100%)	5(100%)
CCL	0(0%)	0(0%)	10(100%)	10(100%)
CFIX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	14(100%)	14(100%)
CPDX-PR	0(0%)	0(0%)	8(100%)	8(100%)
CFTM-PI	0(0%)	0(0%)	5(100%)	5(100%)
CDTR-PI	0(0%)	0(0%)	12(100%)	12(100%)
CFPN-PI	0(0%)	0(0%)	28(100%)	28(100%)
LMOX	0(0%)	0(0%)	1(100%)	1(100%)
FMOX	0(0%)	0(0%)	36(100%)	36(100%)
IPM/CS	0(0%)	0(0%)	64(100%)	64(100%)
PAPM/BP	0(0%)	0(0%)	1(100%)	1(100%)
MEPM	0(0%)	0(0%)	40(100%)	40(100%)
FRPM	0(0%)	0(0%)	8(100%)	8(100%)
BIPM	0(0%)	0(0%)	9(100%)	9(100%)
DRPM	0(0%)	0(0%)	17(100%)	17(100%)
TBPM-PI	0(0%)	0(0%)	5(100%)	5(100%)
GVA/AMPC	0(0%)	0(0%)	2(100%)	2(100%)
SBT/ABPC	0(0%)	0(0%)	62(100%)	62(100%)
SBT/CPZ	0(0%)	0(0%)	75(100%)	75(100%)
TAZ/PIPC	0(0%)	0(0%)	19(100%)	19(100%)
SM	0(0%)	2(40.0%)	3(60.0%)	5(100%)
KM	2(28.6%)	0(0%)	5(71.4%)	7(100%)
GM	13(39.4%)	1(3.0%)	19(57.6%)	33(100%)
DKB	1(25.0%)	0(0%)	3(75.0%)	4(100%)
TOB	0(0%)	0(0%)	3(100%)	3(100%)
AMK	23(85.2%)	2(7.4%)	2(7.4%)	27(100%)
ISP	7(58.3%)	3(25.0%)	2(16.7%)	12(100%)
ABK	50(100%)	0(0%)	0(0%)	50(100%)
EM	6(33.3%)	1(5.6%)	11(61.1%)	18(100%)
CAM	9(25.7%)	0(0%)	26(74.3%)	35(100%)
AZM	3(13.0%)	1(4.3%)	19(82.6%)	23(100%)
CLDM	19(28.4%)	0(0%)	48(71.6%)	67(100%)
TC	1(100%)	0(0%)	0(0%)	1(100%)
MINO	23(27.4%)	5(6.0%)	56(66.7%)	84(100%)
CP	1(100%)	0(0%)	0(0%)	1(100%)
CL	0(0%)	0(0%)	1(100%)	1(100%)
PL-B	0(0%)	0(0%)	7(100%)	7(100%)
VCM	79(100%)	0(0%)	0(0%)	79(100%)
TEIC	71(100%)	0(0%)	0(0%)	71(100%)
LZD	46(100%)	0(0%)	0(0%)	46(100%)
DAP	4(100%)	0(0%)	0(0%)	4(100%)
FOM	7(25.9%)	3(11.1%)	17(63.0%)	27(100%)
NA	0(0%)	0(0%)	3(100%)	3(100%)
NFLX	0(0%)	0(0%)	5(100%)	5(100%)
OFLX	3(27.3%)	1(9.1%)	7(63.6%)	11(100%)
CPFX	5(21.7%)	0(0%)	18(78.3%)	23(100%)
LFLX	2(40.0%)	0(0%)	3(60.0%)	5(100%)
TLX	4(22.2%)	0(0%)	14(77.8%)	18(100%)
LVFX	7(8.8%)	0(0%)	73(91.3%)	80(100%)
PZFX	2(9.1%)	1(4.5%)	19(86.4%)	22(100%)
PUFX	0(0%)	0(0%)	2(100%)	2(100%)
GFLX	0(0%)	1(100%)	0(0%)	1(100%)
MFLX	3(42.9%)	1(14.3%)	3(42.9%)	7(100%)
GRNX	8(42.1%)	0(0%)	11(57.9%)	19(100%)
STFX	1(100%)	0(0%)	0(0%)	1(100%)
ST	23(100%)	0(0%)	0(0%)	23(100%)