


指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2015/07/01~2015/07/31	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

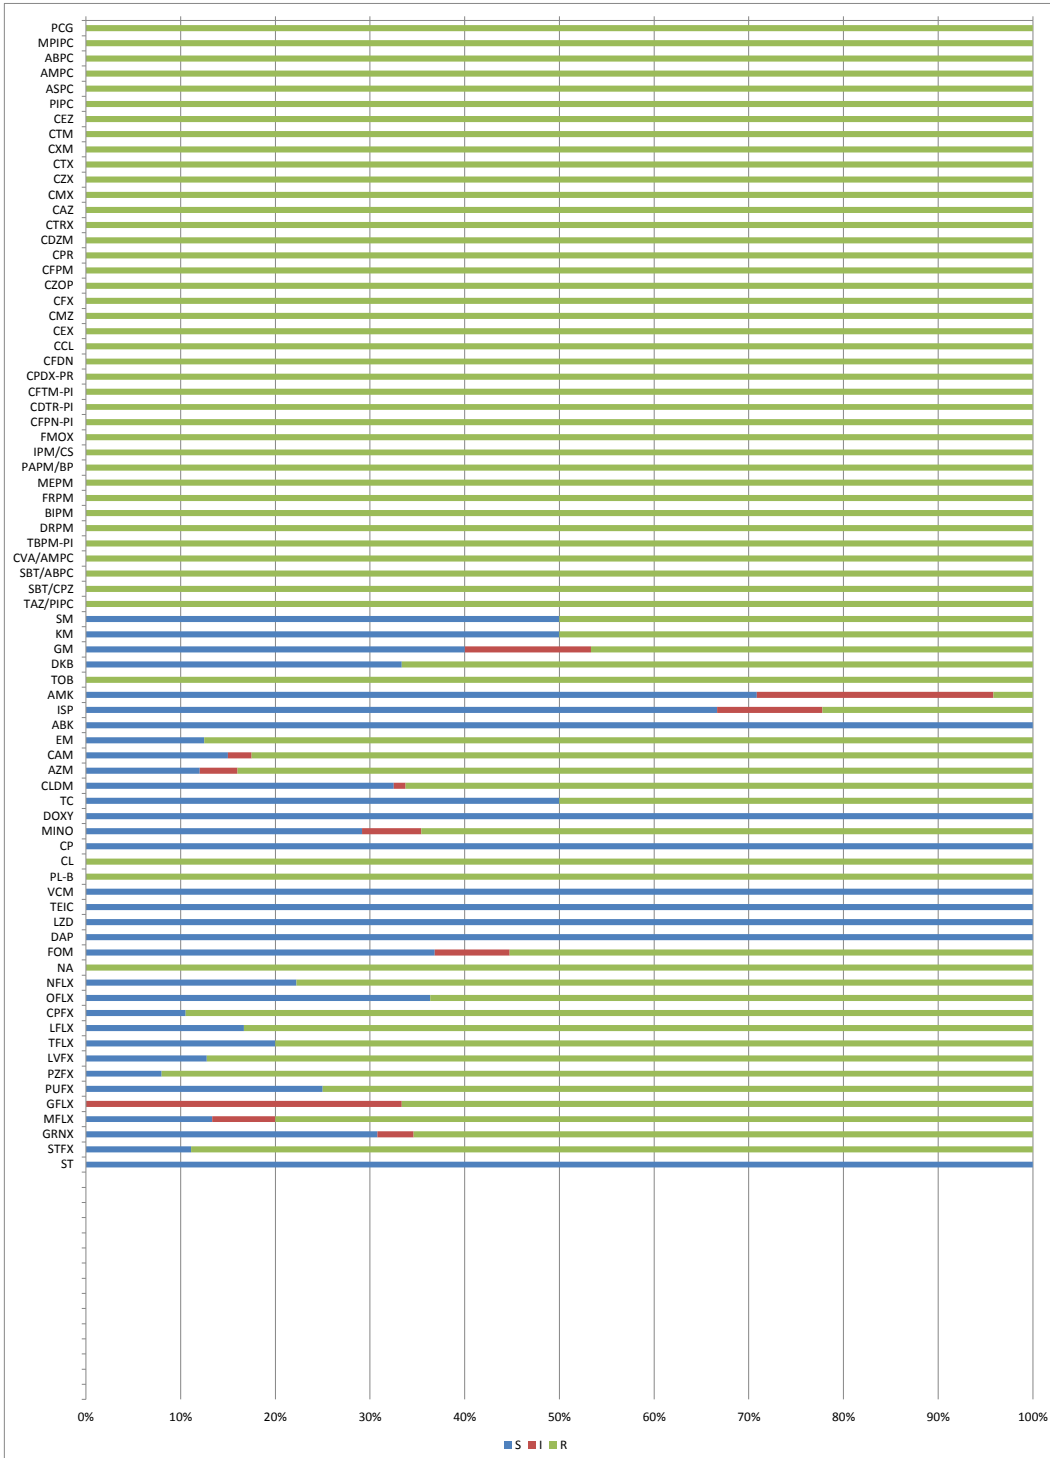

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2015/07/01~2015/07/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

指定感染菌	S	I	R	合計
PCG	0(0%)	0(0%)	45(100%)	45(100%)
MPIP	0(0%)	0(0%)	49(100%)	49(100%)
ABPC	0(0%)	0(0%)	15(100%)	15(100%)
AMPC	0(0%)	0(0%)	22(100%)	22(100%)
ASPC	0(0%)	0(0%)	2(100%)	2(100%)
PIPC	0(0%)	0(0%)	42(100%)	42(100%)
CEZ	0(0%)	0(0%)	69(100%)	69(100%)
CTM	0(0%)	0(0%)	70(100%)	70(100%)
CXM	0(0%)	0(0%)	3(100%)	3(100%)
CTX	0(0%)	0(0%)	47(100%)	47(100%)
CZX	0(0%)	0(0%)	3(100%)	3(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
CAZ	0(0%)	0(0%)	25(100%)	25(100%)
CTR	0(0%)	0(0%)	36(100%)	36(100%)
CDZ	0(0%)	0(0%)	1(100%)	1(100%)
CPR	0(0%)	0(0%)	6(100%)	6(100%)
CFPM	0(0%)	0(0%)	63(100%)	63(100%)
CZOP	0(0%)	0(0%)	20(100%)	20(100%)
CFX	0(0%)	0(0%)	1(100%)	1(100%)
CMZ	0(0%)	0(0%)	48(100%)	48(100%)
CEX	0(0%)	0(0%)	3(100%)	3(100%)
CCL	0(0%)	0(0%)	10(100%)	10(100%)
CFDN	0(0%)	0(0%)	20(100%)	20(100%)
CPDX-PR	0(0%)	0(0%)	10(100%)	10(100%)
CFM-PI	0(0%)	0(0%)	5(100%)	5(100%)
CDTR-PI	0(0%)	0(0%)	15(100%)	15(100%)
CFPN-PI	0(0%)	0(0%)	27(100%)	27(100%)
FMOX	0(0%)	0(0%)	44(100%)	44(100%)
IPM/CS	0(0%)	0(0%)	73(100%)	73(100%)
PAPM/BP	0(0%)	0(0%)	2(100%)	2(100%)
MEPM	0(0%)	0(0%)	35(100%)	35(100%)
FRPM	0(0%)	0(0%)	11(100%)	11(100%)
BIPM	0(0%)	0(0%)	13(100%)	13(100%)
DRPM	0(0%)	0(0%)	18(100%)	18(100%)
TBPM-PI	0(0%)	0(0%)	4(100%)	4(100%)
GVA/AMPC	0(0%)	0(0%)	4(100%)	4(100%)
SBT/ABPC	0(0%)	0(0%)	66(100%)	66(100%)
SBT/CPZ	0(0%)	0(0%)	81(100%)	81(100%)
TAZ/PIPC	0(0%)	0(0%)	24(100%)	24(100%)
SM	1(50.0%)	0(0%)	1(50.0%)	2(100%)
KM	3(50.0%)	0(0%)	3(50.0%)	6(100%)
GM	12(40.0%)	4(13.3%)	14(46.7%)	30(100%)
DKB	1(33.3%)	0(0%)	2(66.7%)	3(100%)
TOB	0(0%)	0(0%)	4(100%)	4(100%)
AMK	17(70.8%)	6(25.0%)	1(4.2%)	24(100%)
ISP	6(66.7%)	1(11.1%)	2(22.2%)	9(100%)
ABK	62(100%)	0(0%)	0(0%)	62(100%)
EM	3(12.5%)	0(0%)	21(87.5%)	24(100%)
CAM	6(15.0%)	1(2.5%)	33(82.5%)	40(100%)
AZM	3(12.0%)	1(4.0%)	21(84.0%)	25(100%)
CLDM	26(32.5%)	1(1.3%)	53(66.3%)	80(100%)
TC	1(50.0%)	0(0%)	1(50.0%)	2(100%)
DOXY	1(100%)	0(0%)	0(0%)	1(100%)
MINO	28(29.2%)	6(6.3%)	62(64.6%)	96(100%)
CP	3(100%)	0(0%)	0(0%)	3(100%)
CL	0(0%)	0(0%)	2(100%)	2(100%)
PL-B	0(0%)	0(0%)	6(100%)	6(100%)
VCM	89(100%)	0(0%)	0(0%)	89(100%)
TEIC	75(100%)	0(0%)	0(0%)	75(100%)
LZD	59(100%)	0(0%)	0(0%)	59(100%)
DAP	4(100%)	0(0%)	0(0%)	4(100%)
FOM	14(36.8%)	3(7.9%)	21(55.3%)	38(100%)
NA	0(0%)	0(0%)	1(100%)	1(100%)
NFLX	2(22.2%)	0(0%)	7(77.8%)	9(100%)
OFLX	4(36.4%)	0(0%)	7(63.6%)	11(100%)
CPFX	2(10.5%)	0(0%)	17(89.5%)	19(100%)
LFLX	1(16.7%)	0(0%)	5(83.3%)	6(100%)
TLX	4(20.0%)	0(0%)	16(80.0%)	20(100%)
LVFX	12(12.8%)	0(0%)	82(87.2%)	94(100%)
PZFX	2(8.0%)	0(0%)	23(92.0%)	25(100%)
PUFX	1(25.0%)	0(0%)	3(75.0%)	4(100%)
GFLX	0(0%)	1(33.3%)	2(66.7%)	3(100%)
MFLX	2(13.3%)	1(6.7%)	12(80.0%)	15(100%)
GRNX	8(30.8%)	1(3.8%)	17(65.4%)	26(100%)
STFX	1(11.1%)	0(0%)	8(88.9%)	9(100%)
ST	17(100%)	0(0%)	0(0%)	17(100%)