


指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2015/08/01~2015/08/31	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

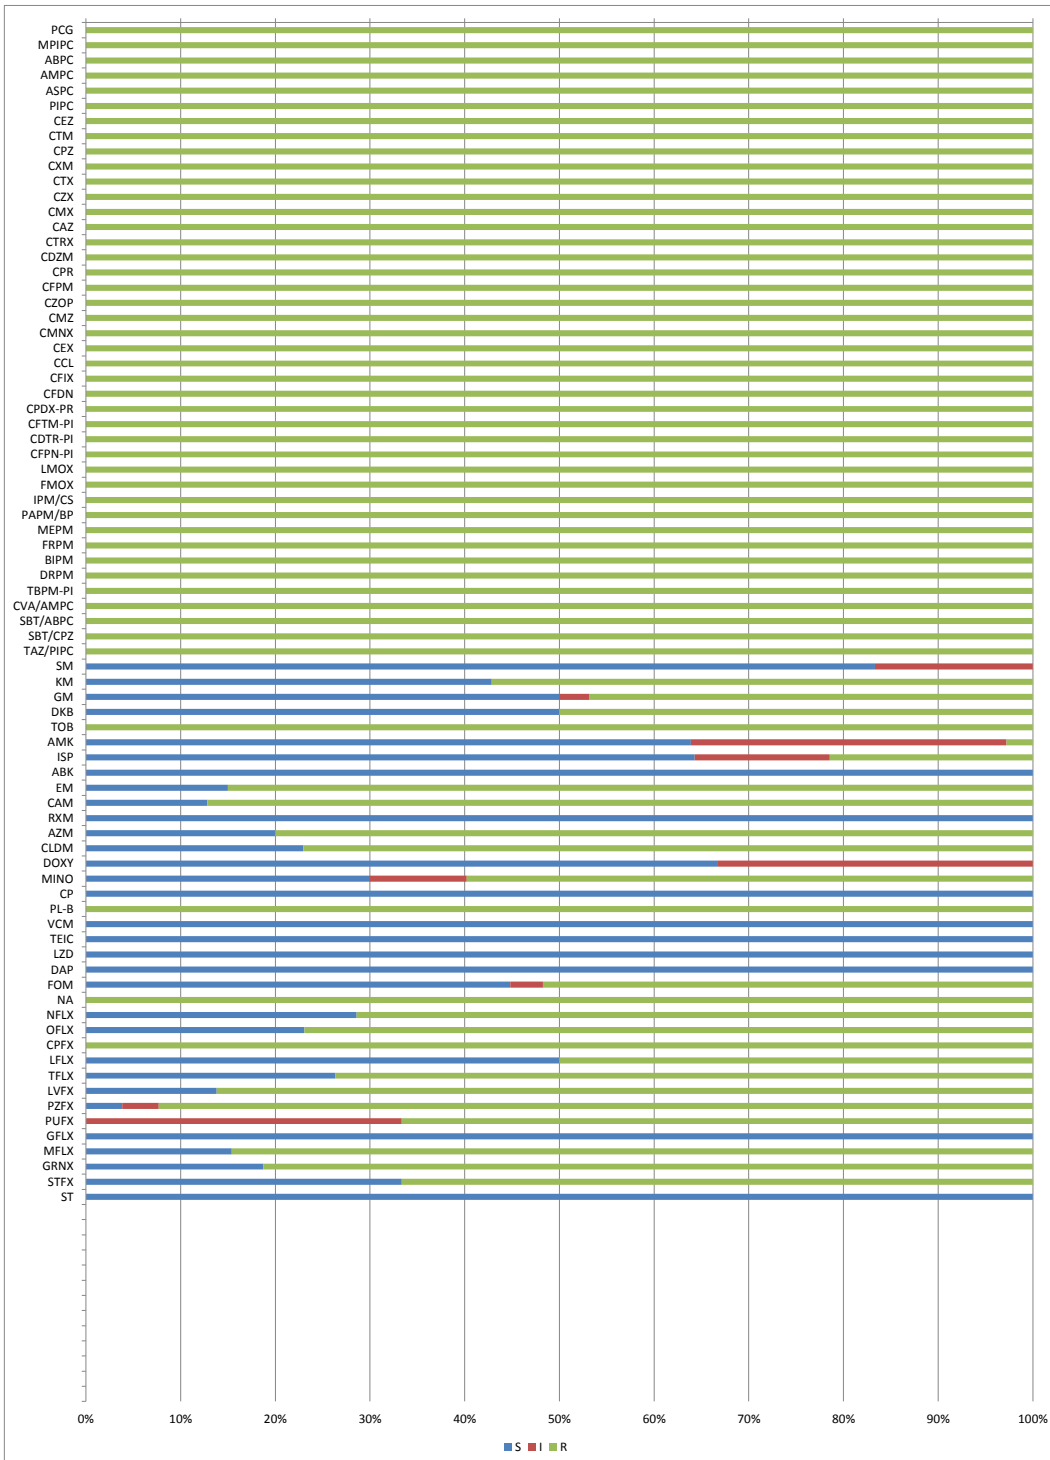

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2015/08/01~2015/08/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

指定感染菌	S	I	R	合計
PCG	0(0%)	0(0%)	34(100%)	34(100%)
MPIP	0(0%)	0(0%)	35(100%)	35(100%)
ABPC	0(0%)	0(0%)	12(100%)	12(100%)
AMPC	0(0%)	0(0%)	18(100%)	18(100%)
ASPC	0(0%)	0(0%)	1(100%)	1(100%)
PIPC	0(0%)	0(0%)	51(100%)	51(100%)
CEZ	0(0%)	0(0%)	63(100%)	63(100%)
CTM	0(0%)	0(0%)	60(100%)	60(100%)
CPZ	0(0%)	0(0%)	2(100%)	2(100%)
CXM	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	34(100%)	34(100%)
CZX	0(0%)	0(0%)	4(100%)	4(100%)
CMX	0(0%)	0(0%)	1(100%)	1(100%)
CAZ	0(0%)	0(0%)	35(100%)	35(100%)
CTR	0(0%)	0(0%)	45(100%)	45(100%)
CDZ	0(0%)	0(0%)	1(100%)	1(100%)
CPR	0(0%)	0(0%)	6(100%)	6(100%)
CFPM	0(0%)	0(0%)	57(100%)	57(100%)
CZOP	0(0%)	0(0%)	20(100%)	20(100%)
CMZ	0(0%)	0(0%)	33(100%)	33(100%)
CMNX	0(0%)	0(0%)	1(100%)	1(100%)
CEX	0(0%)	0(0%)	7(100%)	7(100%)
CCL	0(0%)	0(0%)	13(100%)	13(100%)
CFIX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	18(100%)	18(100%)
CPDX-PR	0(0%)	0(0%)	4(100%)	4(100%)
CFTM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CDTR-PI	0(0%)	0(0%)	14(100%)	14(100%)
CFPN-PI	0(0%)	0(0%)	31(100%)	31(100%)
LMOX	0(0%)	0(0%)	1(100%)	1(100%)
FMOX	0(0%)	0(0%)	36(100%)	36(100%)
IPM/CS	0(0%)	0(0%)	64(100%)	64(100%)
PAPM/BP	0(0%)	0(0%)	4(100%)	4(100%)
MEPM	0(0%)	0(0%)	40(100%)	40(100%)
FRPM	0(0%)	0(0%)	11(100%)	11(100%)
BIPM	0(0%)	0(0%)	8(100%)	8(100%)
DRPM	0(0%)	0(0%)	25(100%)	25(100%)
TBPM-PI	0(0%)	0(0%)	2(100%)	2(100%)
GVA/AMPC	0(0%)	0(0%)	2(100%)	2(100%)
SBT/ABPC	0(0%)	0(0%)	69(100%)	69(100%)
SBT/CPZ	0(0%)	0(0%)	81(100%)	81(100%)
TAZ/PIPC	0(0%)	0(0%)	22(100%)	22(100%)
SM	5(83.3%)	1(16.7%)	0(0%)	6(100%)
KM	3(42.9%)	0(0%)	4(57.1%)	7(100%)
GM	16(50.0%)	1(3.1%)	15(46.9%)	32(100%)
DKB	2(50.0%)	0(0%)	2(50.0%)	4(100%)
TOB	0(0%)	0(0%)	1(100%)	1(100%)
AMK	23(63.9%)	12(33.3%)	1(2.8%)	36(100%)
ISP	9(64.3%)	2(14.3%)	3(21.4%)	14(100%)
ABK	48(100%)	0(0%)	0(0%)	48(100%)
EM	3(15.0%)	0(0%)	17(85.0%)	20(100%)
CAM	5(12.8%)	0(0%)	34(87.2%)	39(100%)
RXM	1(100%)	0(0%)	0(0%)	1(100%)
AZM	4(20.0%)	0(0%)	16(80.0%)	20(100%)
CLDM	17(23.0%)	0(0%)	57(77.0%)	74(100%)
DOXY	2(66.7%)	1(33.3%)	0(0%)	3(100%)
MINO	26(29.9%)	9(10.3%)	52(59.8%)	87(100%)
CP	1(100%)	0(0%)	0(0%)	1(100%)
PL-B	0(0%)	0(0%)	7(100%)	7(100%)
VCM	82(100%)	0(0%)	0(0%)	82(100%)
TEIC	65(100%)	0(0%)	0(0%)	65(100%)
LZD	40(100%)	0(0%)	0(0%)	40(100%)
DAP	2(100%)	0(0%)	0(0%)	2(100%)
FOM	13(44.8%)	1(3.4%)	15(51.7%)	29(100%)
NA	0(0%)	0(0%)	5(100%)	5(100%)
NFLX	2(28.6%)	0(0%)	5(71.4%)	7(100%)
OFLX	3(23.1%)	0(0%)	10(76.9%)	13(100%)
CPFX	0(0%)	0(0%)	17(100%)	17(100%)
LFLX	1(50.0%)	0(0%)	1(50.0%)	2(100%)
TLX	5(26.3%)	0(0%)	14(73.7%)	19(100%)
LVFX	12(13.8%)	0(0%)	75(86.2%)	87(100%)
PZFX	1(3.8%)	1(3.8%)	24(92.3%)	26(100%)
MFLX	0(0%)	1(33.3%)	2(66.7%)	3(100%)
GFLX	1(100%)	0(0%)	0(0%)	1(100%)
MFLX	2(15.4%)	0(0%)	11(84.6%)	13(100%)
GRNX	6(18.8%)	0(0%)	26(81.3%)	32(100%)
STFX	2(33.3%)	0(0%)	4(66.7%)	6(100%)
ST	19(100%)	0(0%)	0(0%)	19(100%)