


指定感染菌 薬剤感受性状況

印刷日: 2018/02/23 15:43:42

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2018/01/01~2018/01/31	P.aeruginosa (MDR)
	医療機関

指定感染菌 検出推移グラフ

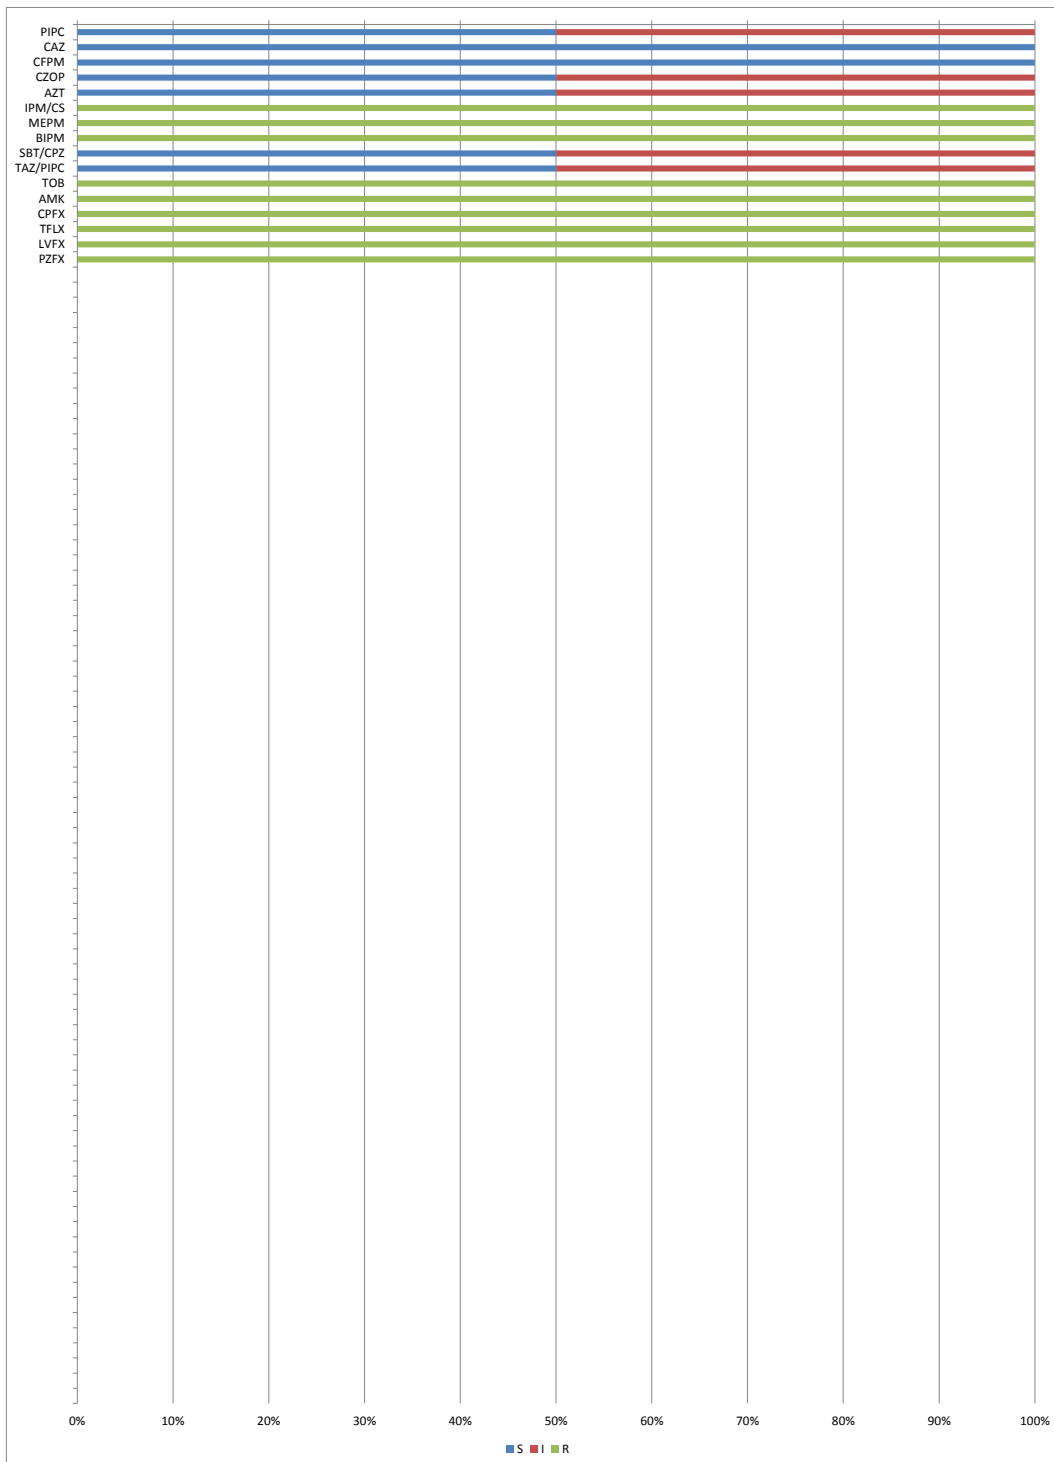

抽出条件	
受付日	菌
2018/01/01~2018/01/31	P.aeruginosa (MDR)

指定感染菌 薬剤感受性状況表

指定感染菌	S	I	R	合計
PIPC	1(50.0%)	1(50.0%)	0(0%)	2(100%)
CAZ	2(100%)	0(0%)	0(0%)	2(100%)
CFPM	2(100%)	0(0%)	0(0%)	2(100%)
CZOP	1(50.0%)	1(50.0%)	0(0%)	2(100%)
AZT	1(50.0%)	1(50.0%)	0(0%)	2(100%)
IPM/CS	0(0%)	0(0%)	2(100%)	2(100%)
MEPM	0(0%)	0(0%)	2(100%)	2(100%)
BIPM	0(0%)	0(0%)	2(100%)	2(100%)
SBT/CPZ	1(50.0%)	1(50.0%)	0(0%)	2(100%)
TAZ/PIPC	1(50.0%)	1(50.0%)	0(0%)	2(100%)
TOB	0(0%)	0(0%)	2(100%)	2(100%)
AMK	0(0%)	0(0%)	2(100%)	2(100%)
CPFX	0(0%)	0(0%)	2(100%)	2(100%)
TFLX	0(0%)	0(0%)	2(100%)	2(100%)
LVFX	0(0%)	0(0%)	2(100%)	2(100%)
PZFX	0(0%)	0(0%)	2(100%)	2(100%)


指定感染菌 薬剤感受性状況

印刷日: 2018/02/23 15:43:42

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2018/01/01~2018/01/31	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

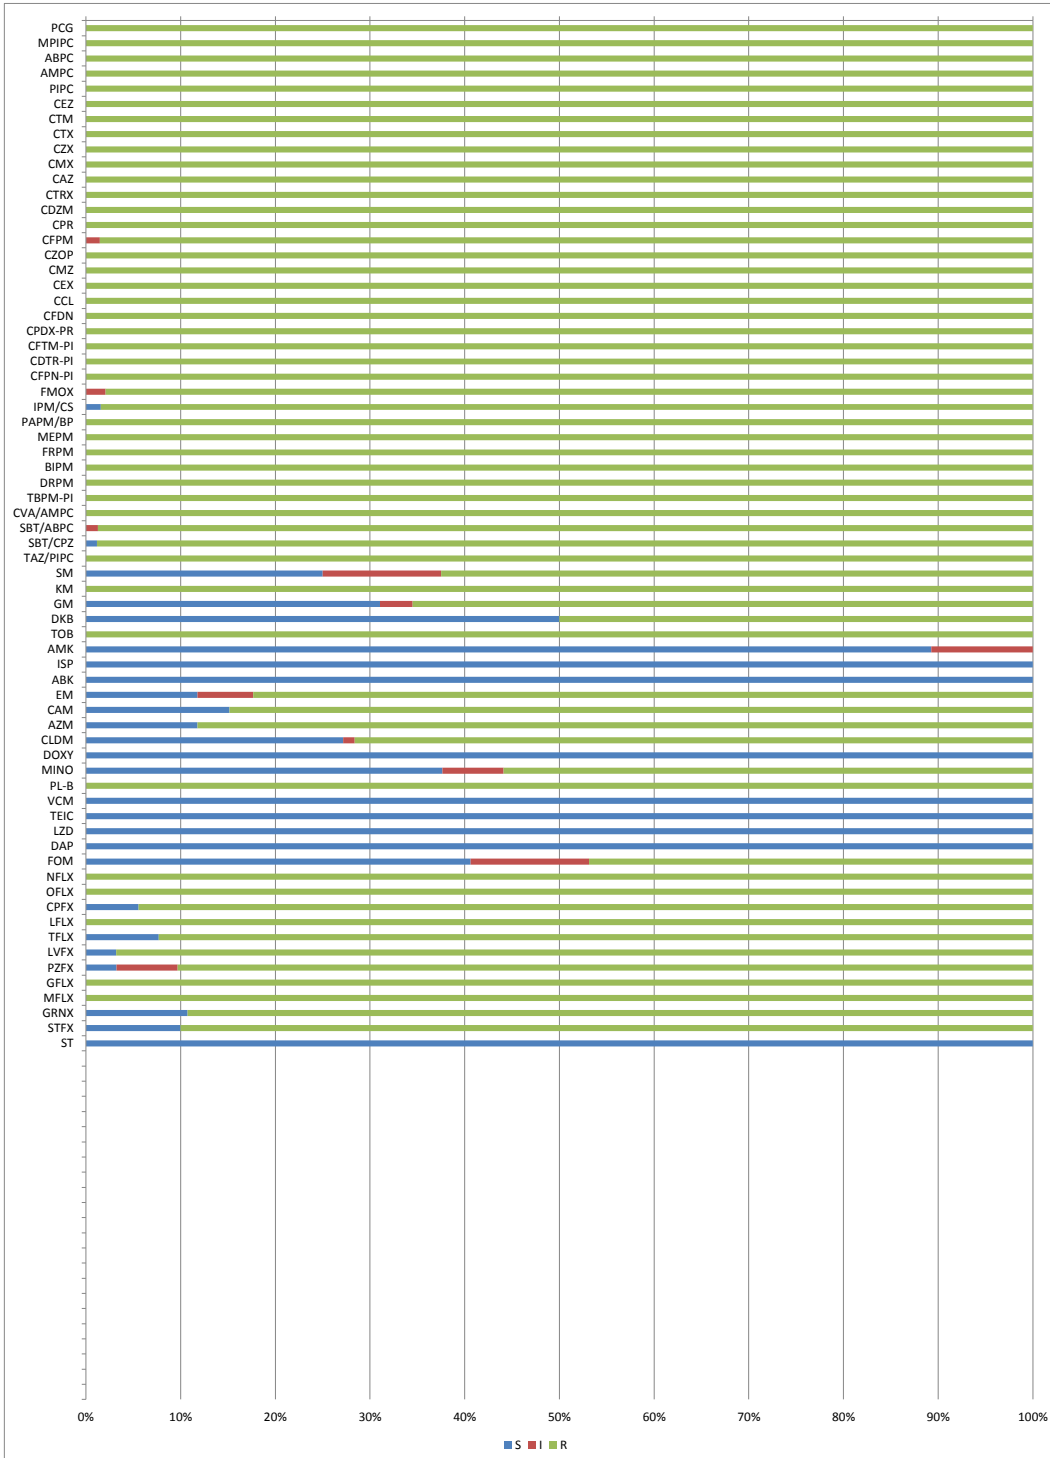

抽出条件	
受付日	菌
2018/01/01~2018/01/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表


指定感染菌	S	I	R	合計
PCG	0(0%)	0(0%)	49(100%)	49(100%)
MPIP	0(0%)	0(0%)	48(100%)	48(100%)
ABPC	0(0%)	0(0%)	11(100%)	11(100%)
AMPC	0(0%)	0(0%)	23(100%)	23(100%)
PIP	0(0%)	0(0%)	42(100%)	42(100%)
CEZ	0(0%)	0(0%)	73(100%)	73(100%)
CTM	0(0%)	0(0%)	61(100%)	61(100%)
CTX	0(0%)	0(0%)	47(100%)	47(100%)
CZX	0(0%)	0(0%)	2(100%)	2(100%)
CMX	0(0%)	0(0%)	1(100%)	1(100%)
GAZ	0(0%)	0(0%)	31(100%)	31(100%)
CTRX	0(0%)	0(0%)	42(100%)	42(100%)
CDZM	0(0%)	0(0%)	2(100%)	2(100%)
CPR	0(0%)	0(0%)	5(100%)	5(100%)
CFPM	0(0%)	1(1.5%)	67(98.5%)	68(100%)
CZOP	0(0%)	0(0%)	17(100%)	17(100%)
CMZ	0(0%)	0(0%)	61(100%)	61(100%)
CEX	0(0%)	0(0%)	5(100%)	5(100%)
CCL	0(0%)	0(0%)	15(100%)	15(100%)
CFDN	0(0%)	0(0%)	12(100%)	12(100%)
CPDX-PR	0(0%)	0(0%)	8(100%)	8(100%)
CFTM-PI	0(0%)	0(0%)	5(100%)	5(100%)
CDTR-PI	0(0%)	0(0%)	17(100%)	17(100%)
CFPN-PI	0(0%)	0(0%)	24(100%)	24(100%)
FMOX	0(0%)	1(2.1%)	47(97.9%)	48(100%)
IPM/CS	1(1.8%)	0(0%)	63(98.4%)	64(100%)
PAPM/BP	0(0%)	0(0%)	2(100%)	2(100%)
MEPM	0(0%)	0(0%)	41(100%)	41(100%)
FRPM	0(0%)	0(0%)	15(100%)	15(100%)
BIPM	0(0%)	0(0%)	7(100%)	7(100%)
DRPM	0(0%)	0(0%)	18(100%)	18(100%)
TBPM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CVA/AMPC	0(0%)	0(0%)	8(100%)	8(100%)
SBT/ABPC	0(0%)	1(1.3%)	79(98.8%)	80(100%)
SBT/CPZ	1(1.1%)	0(0%)	86(98.9%)	87(100%)
TAZ/PIPC	0(0%)	0(0%)	14(100%)	14(100%)
SM	2(25.0%)	1(12.5%)	5(62.5%)	8(100%)
KM	0(0%)	0(0%)	4(100%)	4(100%)
GM	9(31.0%)	1(3.4%)	19(65.5%)	29(100%)
DKB	1(50.0%)	0(0%)	1(50.0%)	2(100%)
TOB	0(0%)	0(0%)	1(100%)	1(100%)
AMK	25(89.3%)	3(10.7%)	0(0%)	28(100%)
ISP	7(100%)	0(0%)	0(0%)	7(100%)
ABK	51(100%)	0(0%)	0(0%)	51(100%)
EM	2(11.8%)	1(5.9%)	14(82.4%)	17(100%)
CAM	5(15.2%)	0(0%)	28(84.8%)	33(100%)
AZM	2(11.8%)	0(0%)	15(88.2%)	17(100%)
CLDM	22(27.2%)	1(1.2%)	58(71.6%)	81(100%)
DOXY	2(100%)	0(0%)	0(0%)	2(100%)
MINO	35(37.6%)	6(6.5%)	52(55.9%)	93(100%)
PL-B	0(0%)	0(0%)	5(100%)	5(100%)
VCM	91(100%)	0(0%)	0(0%)	91(100%)
TEIC	74(100%)	0(0%)	0(0%)	74(100%)
LZD	55(100%)	0(0%)	0(0%)	55(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	13(40.6%)	4(12.5%)	15(46.9%)	32(100%)
NFLX	0(0%)	0(0%)	3(100%)	3(100%)
OFLX	0(0%)	0(0%)	6(100%)	6(100%)
CPFX	1(5.6%)	0(0%)	17(94.4%)	18(100%)
LFLL	0(0%)	0(0%)	1(100%)	1(100%)
TFLX	1(7.7%)	0(0%)	12(92.3%)	13(100%)
LVFX	3(3.2%)	0(0%)	91(96.8%)	94(100%)
PZFX	1(3.2%)	2(6.5%)	28(90.3%)	31(100%)
GFLX	0(0%)	0(0%)	1(100%)	1(100%)
MFLX	0(0%)	0(0%)	8(100%)	8(100%)
GRNX	3(10.7%)	0(0%)	25(89.3%)	28(100%)
STFX	1(10.0%)	0(0%)	9(90.0%)	10(100%)
ST	24(100%)	0(0%)	0(0%)	24(100%)

指定感染菌 薬剤感受性状況

印刷日: 2018/02/23 15:43:42

抽出条件		
受付日	菌	医療機関
2018/01/01~2018/01/31	S.pneumoniae (PISP)	

指定感染菌 検出推移グラフ

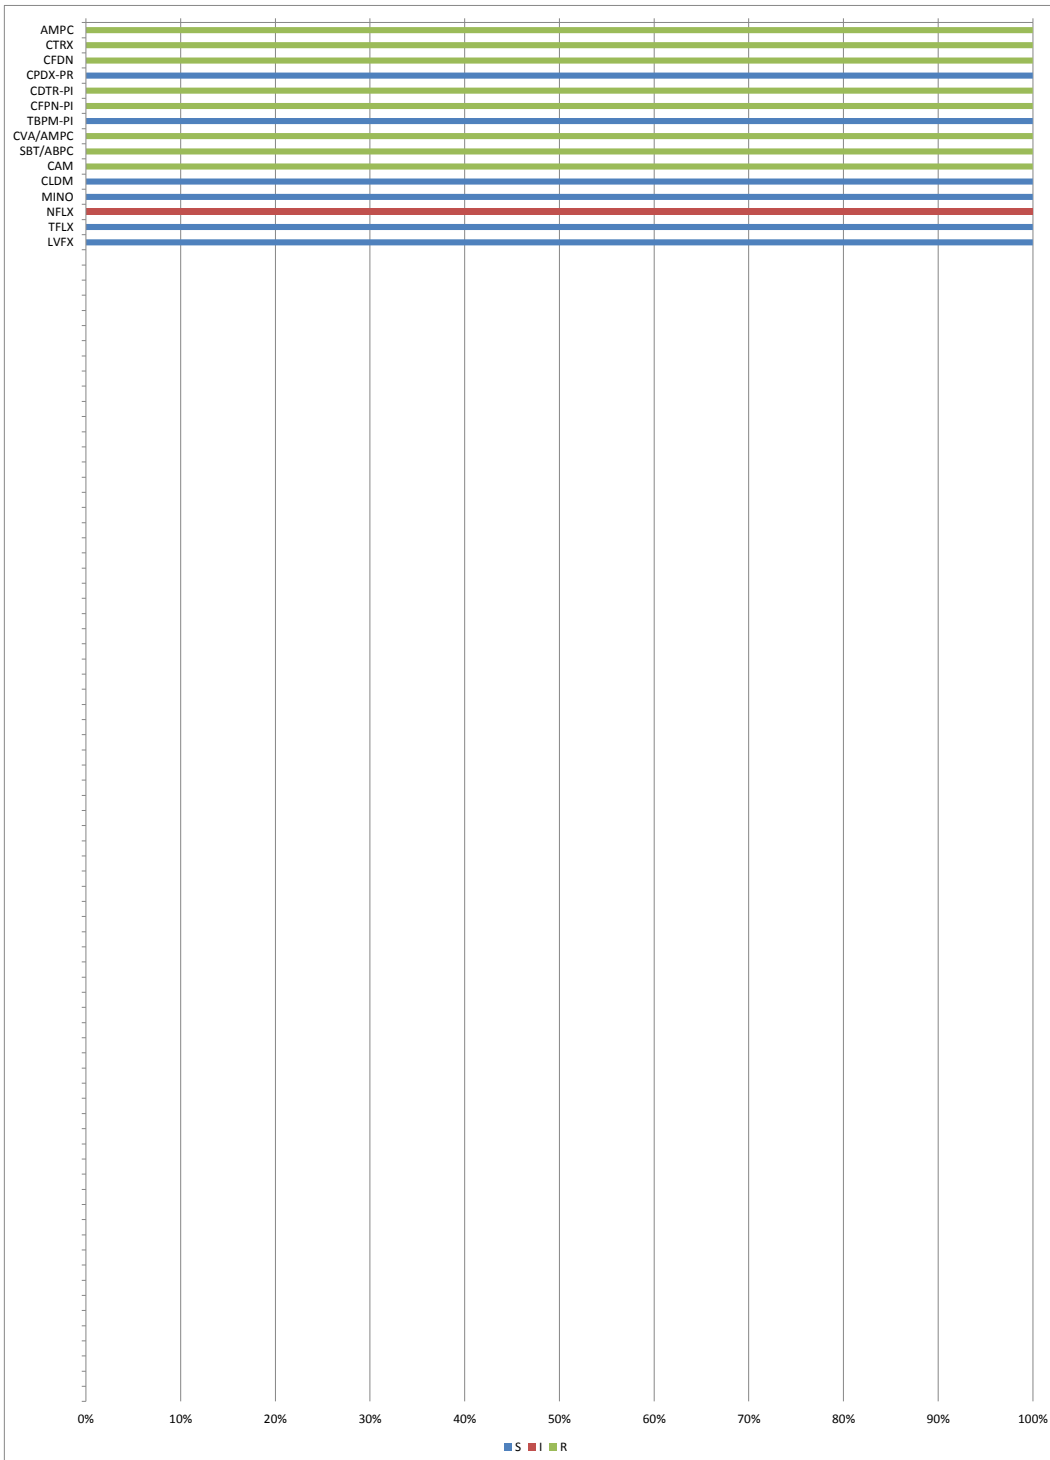

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2018/01/01~2018/01/31	S.pneumoniae (PISP)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
AMPC	0(0%)	0(0%)	1(100%)	1(100%)
CTRX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	1(100%)	1(100%)
CPDX-PR	1(100%)	0(0%)	0(0%)	1(100%)
CDTR-PI	0(0%)	0(0%)	1(100%)	1(100%)
CFPN-PI	0(0%)	0(0%)	1(100%)	1(100%)
TBPM-PI	1(100%)	0(0%)	0(0%)	1(100%)
GVA/AMPC	0(0%)	0(0%)	1(100%)	1(100%)
SBT/ABPC	0(0%)	0(0%)	1(100%)	1(100%)
CAM	0(0%)	0(0%)	1(100%)	1(100%)
CLDM	1(100%)	0(0%)	0(0%)	1(100%)
MINO	1(100%)	0(0%)	0(0%)	1(100%)
NFLX	0(0%)	1(100%)	0(0%)	1(100%)
TFLX	1(100%)	0(0%)	0(0%)	1(100%)
LVFX	1(100%)	0(0%)	0(0%)	1(100%)