


指定感染菌 薬剤感受性状況

印刷日 : 2026/07/28 16:25:43

抽出条件		
受付日	菌	医療機関
2026/06/01～2026/06/30	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

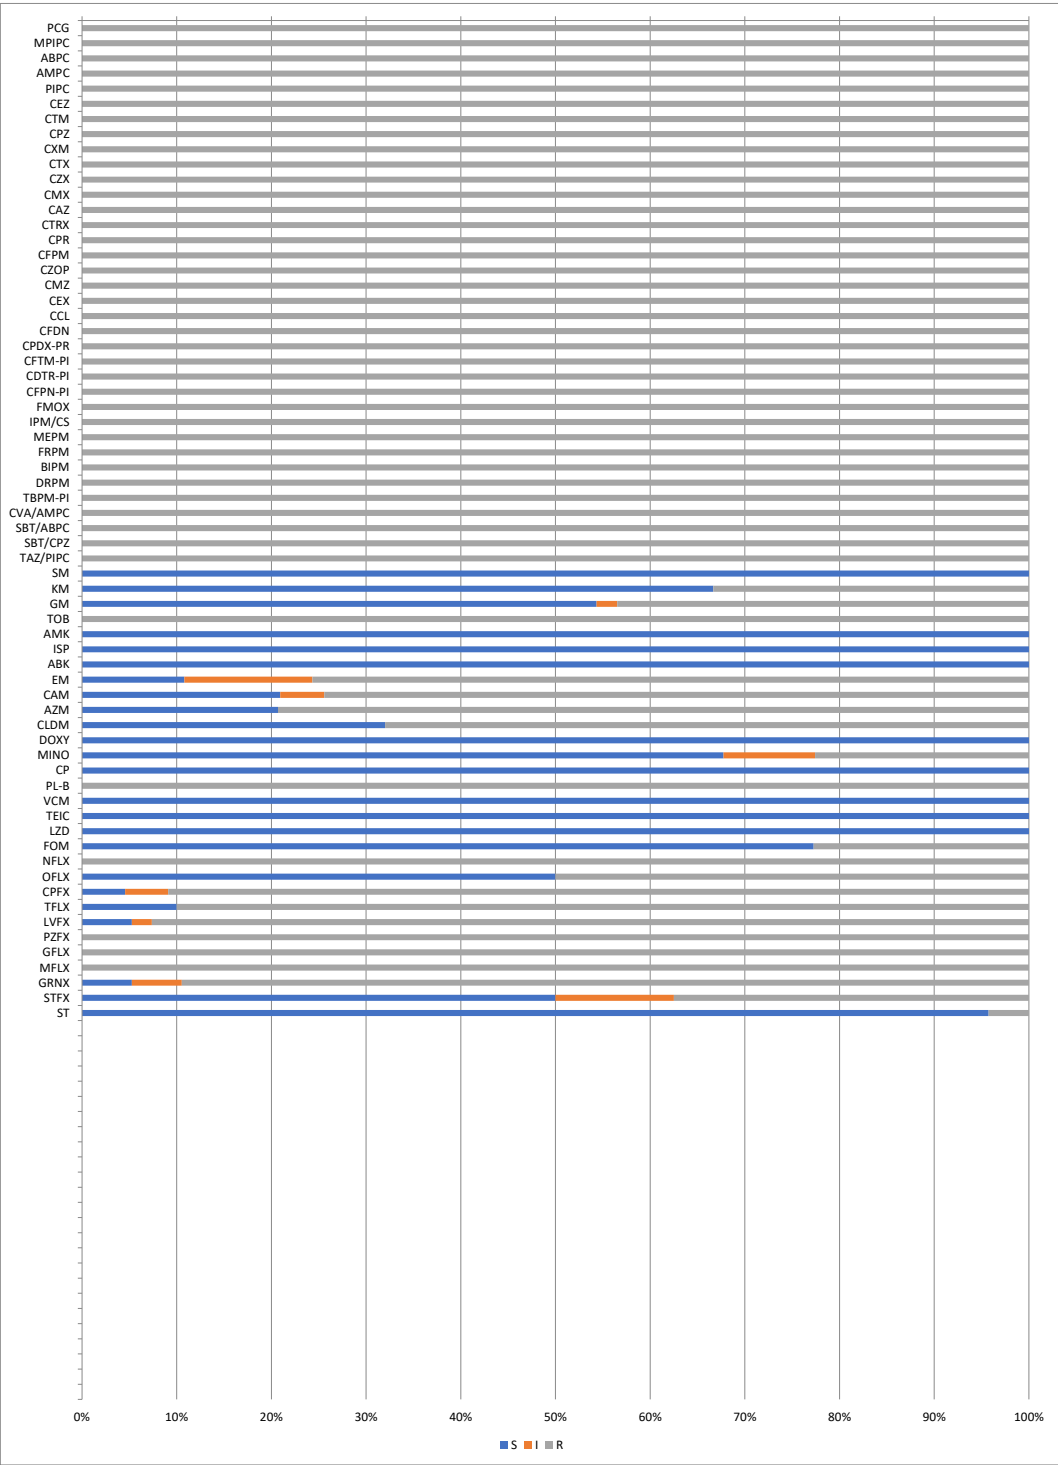

指定感染菌 薬剤感受性状況

受付日	菌
2026/06/01～2026/06/30	S.aureus (MRSA)

指定感染菌	薬剤感受性状況表			
	S	I	R	合計
PCG	0(0%)	0(0%)	48(100%)	48(100%)
MPIPC	0(0%)	0(0%)	51(100%)	51(100%)
ABPC	0(0%)	0(0%)	12(100%)	12(100%)
AMPC	0(0%)	0(0%)	25(100%)	25(100%)
PIPC	0(0%)	0(0%)	43(100%)	43(100%)
CEZ	0(0%)	0(0%)	71(100%)	71(100%)
CTM	0(0%)	0(0%)	62(100%)	62(100%)
CPZ	0(0%)	0(0%)	1(100%)	1(100%)
CXM	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	54(100%)	54(100%)
CZX	0(0%)	0(0%)	1(100%)	1(100%)
CMX	0(0%)	0(0%)	2(100%)	2(100%)
CAZ	0(0%)	0(0%)	31(100%)	31(100%)
CTRX	0(0%)	0(0%)	42(100%)	42(100%)
CPR	0(0%)	0(0%)	1(100%)	1(100%)
CFPM	0(0%)	0(0%)	74(100%)	74(100%)
CZOP	0(0%)	0(0%)	1(100%)	1(100%)
CMZ	0(0%)	0(0%)	75(100%)	75(100%)
CEX	0(0%)	0(0%)	3(100%)	3(100%)
CGL	0(0%)	0(0%)	12(100%)	12(100%)
CFDN	0(0%)	0(0%)	10(100%)	10(100%)
CPDX-PR	0(0%)	0(0%)	5(100%)	5(100%)
CFTM-PI	0(0%)	0(0%)	5(100%)	5(100%)
CDTR-PI	0(0%)	0(0%)	25(100%)	25(100%)
CFPN-PI	0(0%)	0(0%)	20(100%)	20(100%)
FMOX	0(0%)	0(0%)	49(100%)	49(100%)
IPM/CS	0(0%)	0(0%)	74(100%)	74(100%)
MEPM	0(0%)	0(0%)	41(100%)	41(100%)
FRPM	0(0%)	0(0%)	16(100%)	16(100%)
BIPM	0(0%)	0(0%)	6(100%)	6(100%)
DRPM	0(0%)	0(0%)	5(100%)	5(100%)
TBPM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CVA/AMPC	0(0%)	0(0%)	21(100%)	21(100%)
SBT/ABPC	0(0%)	0(0%)	87(100%)	87(100%)
SBT/CPZ	0(0%)	0(0%)	69(100%)	69(100%)
TAZ/PIPC	0(0%)	0(0%)	36(100%)	36(100%)
SM	12(100%)	0(0%)	0(0%)	12(100%)
KM	2(66.7%)	0(0%)	1(33.3%)	3(100%)
GM	25(54.3%)	1(2.2%)	20(43.5%)	46(100%)
TOB	0(0%)	0(0%)	1(100%)	1(100%)
AMK	31(100%)	0(0%)	0(0%)	31(100%)
ISP	2(100%)	0(0%)	0(0%)	2(100%)
ABK	53(100%)	0(0%)	0(0%)	53(100%)
EM	4(10.8%)	5(13.5%)	28(75.7%)	37(100%)
CAM	9(20.9%)	2(4.7%)	32(74.4%)	43(100%)
AZM	6(20.7%)	0(0%)	23(79.3%)	29(100%)
CLDM	24(32.0%)	0(0%)	51(68.0%)	75(100%)
DOXY	2(100%)	0(0%)	0(0%)	2(100%)
MINO	63(67.7%)	9(9.7%)	21(22.6%)	93(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
PL-B	0(0%)	0(0%)	6(100%)	6(100%)
VCM	91(100%)	0(0%)	0(0%)	91(100%)
TEIC	70(100%)	0(0%)	0(0%)	70(100%)
LZD	64(100%)	0(0%)	0(0%)	64(100%)
FOM	17(77.3%)	0(0%)	5(22.7%)	22(100%)
NFLX	0(0%)	0(0%)	2(100%)	2(100%)
OFLX	1(50.0%)	0(0%)	1(50.0%)	2(100%)
CPFX	1(4.5%)	1(4.5%)	20(90.9%)	22(100%)
TFLX	1(10.0%)	0(0%)	9(90.0%)	10(100%)
LVFX	5(5.3%)	2(2.1%)	88(92.6%)	95(100%)
PZFX	0(0%)	0(0%)	7(100%)	7(100%)
GFLX	0(0%)	0(0%)	1(100%)	1(100%)
MFLX	0(0%)	0(0%)	3(100%)	3(100%)
GRNX	1(5.3%)	1(5.3%)	17(89.5%)	19(100%)
STFX	4(50.0%)	1(12.5%)	3(37.5%)	8(100%)
ST	45(95.7%)	0(0%)	2(4.3%)	47(100%)
		</		