


指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2015/10/01~2015/10/31	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

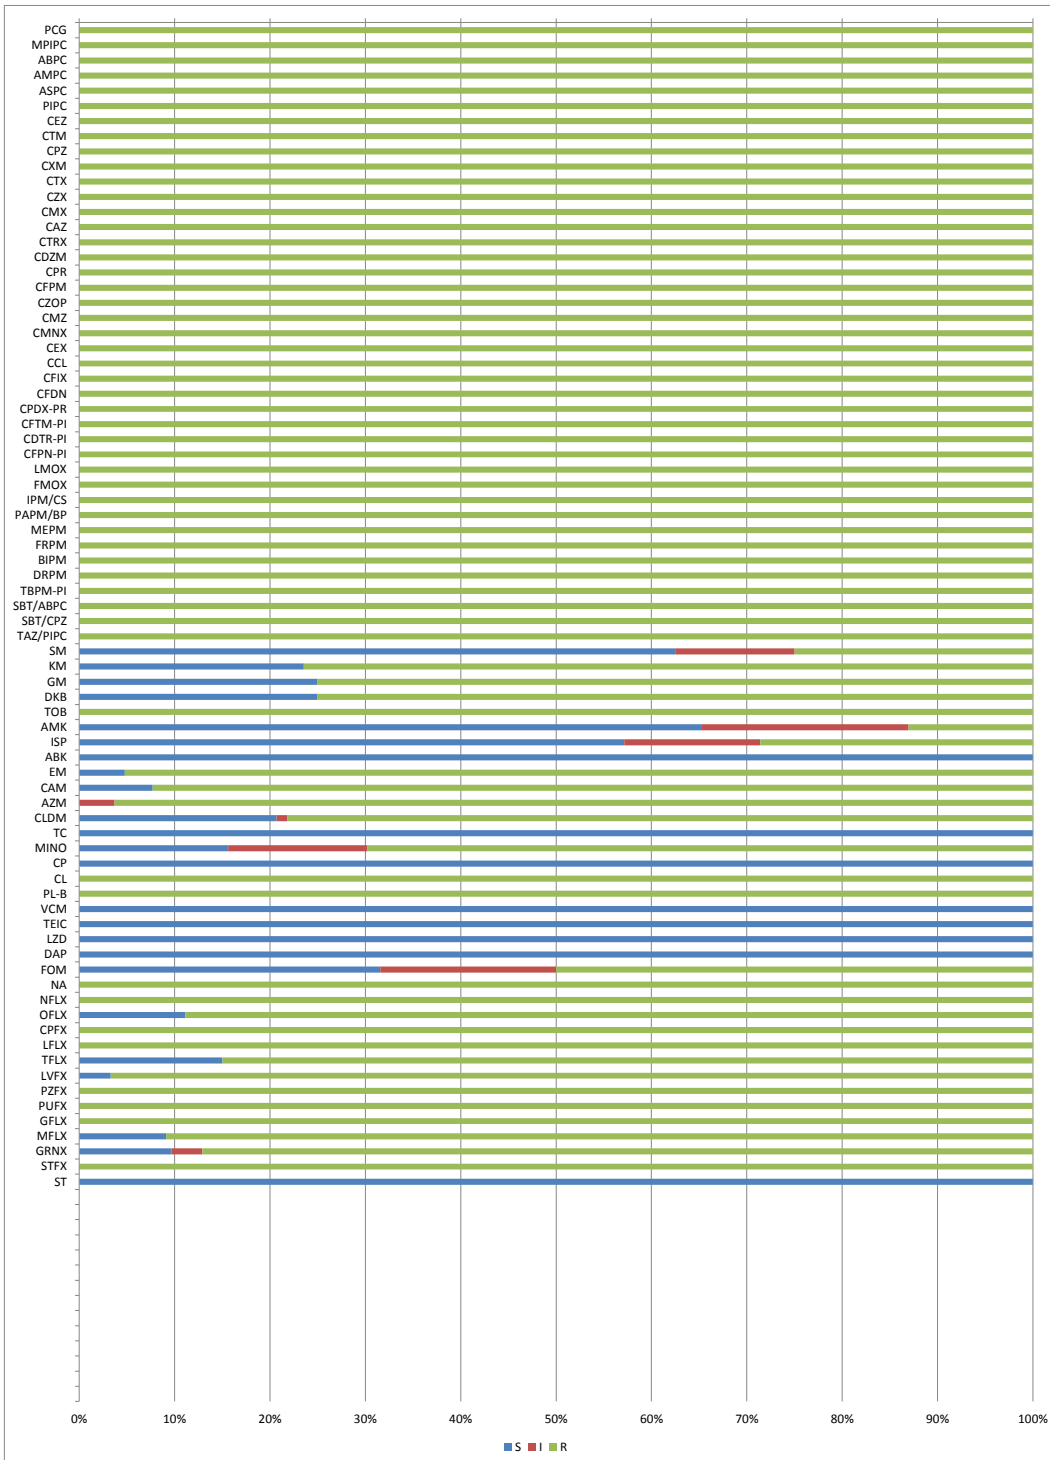

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2015/10/01~2015/10/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

薬剤	S (%)	I (%)	R (%)	合計
PCG	0(0%)	0(0%)	46(100%)	46(100%)
MPIP	0(0%)	0(0%)	47(100%)	47(100%)
ABPC	0(0%)	0(0%)	9(100%)	9(100%)
AMPC	0(0%)	0(0%)	28(100%)	28(100%)
ASPC	0(0%)	0(0%)	2(100%)	2(100%)
PIPC	0(0%)	0(0%)	48(100%)	48(100%)
CEZ	0(0%)	0(0%)	69(100%)	69(100%)
CTM	0(0%)	0(0%)	75(100%)	75(100%)
CPZ	0(0%)	0(0%)	2(100%)	2(100%)
CXM	0(0%)	0(0%)	2(100%)	2(100%)
CTX	0(0%)	0(0%)	50(100%)	50(100%)
CZX	0(0%)	0(0%)	2(100%)	2(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
CAZ	0(0%)	0(0%)	30(100%)	30(100%)
CTR	0(0%)	0(0%)	44(100%)	44(100%)
CDZ	0(0%)	0(0%)	1(100%)	1(100%)
CPR	0(0%)	0(0%)	2(100%)	2(100%)
CFPM	0(0%)	0(0%)	78(100%)	78(100%)
CZOP	0(0%)	0(0%)	28(100%)	28(100%)
CMZ	0(0%)	0(0%)	47(100%)	47(100%)
CMNX	0(0%)	0(0%)	1(100%)	1(100%)
CEX	0(0%)	0(0%)	5(100%)	5(100%)
CCL	0(0%)	0(0%)	16(100%)	16(100%)
CFIX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	9(100%)	9(100%)
CPDX-PI	0(0%)	0(0%)	4(100%)	4(100%)
CDTR-PI	0(0%)	0(0%)	5(100%)	5(100%)
CFPN-PI	0(0%)	0(0%)	12(100%)	12(100%)
LMOX	0(0%)	0(0%)	30(100%)	30(100%)
FMOX	0(0%)	0(0%)	1(100%)	1(100%)
IPM/CS	0(0%)	0(0%)	49(100%)	49(100%)
PAPM/BP	0(0%)	0(0%)	77(100%)	77(100%)
MEPM	0(0%)	0(0%)	3(100%)	3(100%)
FRPM	0(0%)	0(0%)	43(100%)	43(100%)
BIPM	0(0%)	0(0%)	8(100%)	8(100%)
DRPM	0(0%)	0(0%)	13(100%)	13(100%)
TBPM-PI	0(0%)	0(0%)	26(100%)	26(100%)
SBT/ABPC	0(0%)	0(0%)	6(100%)	6(100%)
TAZ/CPZ	0(0%)	0(0%)	73(100%)	73(100%)
SM	5(62.5%)	1(12.5%)	2(25.0%)	8(100%)
KM	4(23.5%)	0(0%)	13(76.5%)	17(100%)
GM	10(25.0%)	0(0%)	30(75.0%)	40(100%)
DKB	1(25.0%)	0(0%)	3(75.0%)	4(100%)
TOB	0(0%)	0(0%)	4(100%)	4(100%)
AMK	15(65.2%)	5(21.7%)	3(13.0%)	23(100%)
ISP	4(57.1%)	1(14.3%)	2(28.6%)	7(100%)
ABK	64(100%)	0(0%)	0(0%)	64(100%)
EM	1(4.8%)	0(0%)	20(95.2%)	21(100%)
CAM	3(7.7%)	0(0%)	36(92.3%)	39(100%)
AZM	0(0%)	1(3.7%)	26(96.3%)	27(100%)
CLDM	18(20.7%)	1(1.1%)	68(78.2%)	87(100%)
TC	1(100%)	0(0%)	0(0%)	1(100%)
MINO	15(15.6%)	14(14.6%)	67(69.8%)	96(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
CL	0(0%)	0(0%)	1(100%)	1(100%)
PL-B	0(0%)	0(0%)	17(100%)	17(100%)
VCM	94(100%)	0(0%)	0(0%)	94(100%)
TEIC	77(100%)	0(0%)	0(0%)	77(100%)
LZD	60(100%)	0(0%)	0(0%)	60(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	12(31.6%)	7(18.4%)	19(50.0%)	38(100%)
NA	0(0%)	0(0%)	1(100%)	1(100%)
NFLX	0(0%)	0(0%)	11(100%)	11(100%)
OFLX	1(11.1%)	0(0%)	8(88.9%)	9(100%)
CPFX	0(0%)	0(0%)	28(100%)	28(100%)
LFLEX	0(0%)	0(0%)	2(100%)	2(100%)
TFLEX	3(15.0%)	0(0%)	17(85.0%)	20(100%)
LVFX	3(3.3%)	0(0%)	88(96.7%)	91(100%)
PZFX	0(0%)	0(0%)	18(100%)	18(100%)
PUFX	0(0%)	0(0%)	1(100%)	1(100%)
GFLX	0(0%)	0(0%)	2(100%)	2(100%)
MFLX	1(9.1%)	0(0%)	10(90.9%)	11(100%)
GRNX	3(9.7%)	1(3.2%)	27(87.1%)	31(100%)
STFX	0(0%)	0(0%)	2(100%)	2(100%)
ST	26(100%)	0(0%)	0(0%)	26(100%)