


指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2016/02/01~2016/02/29	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

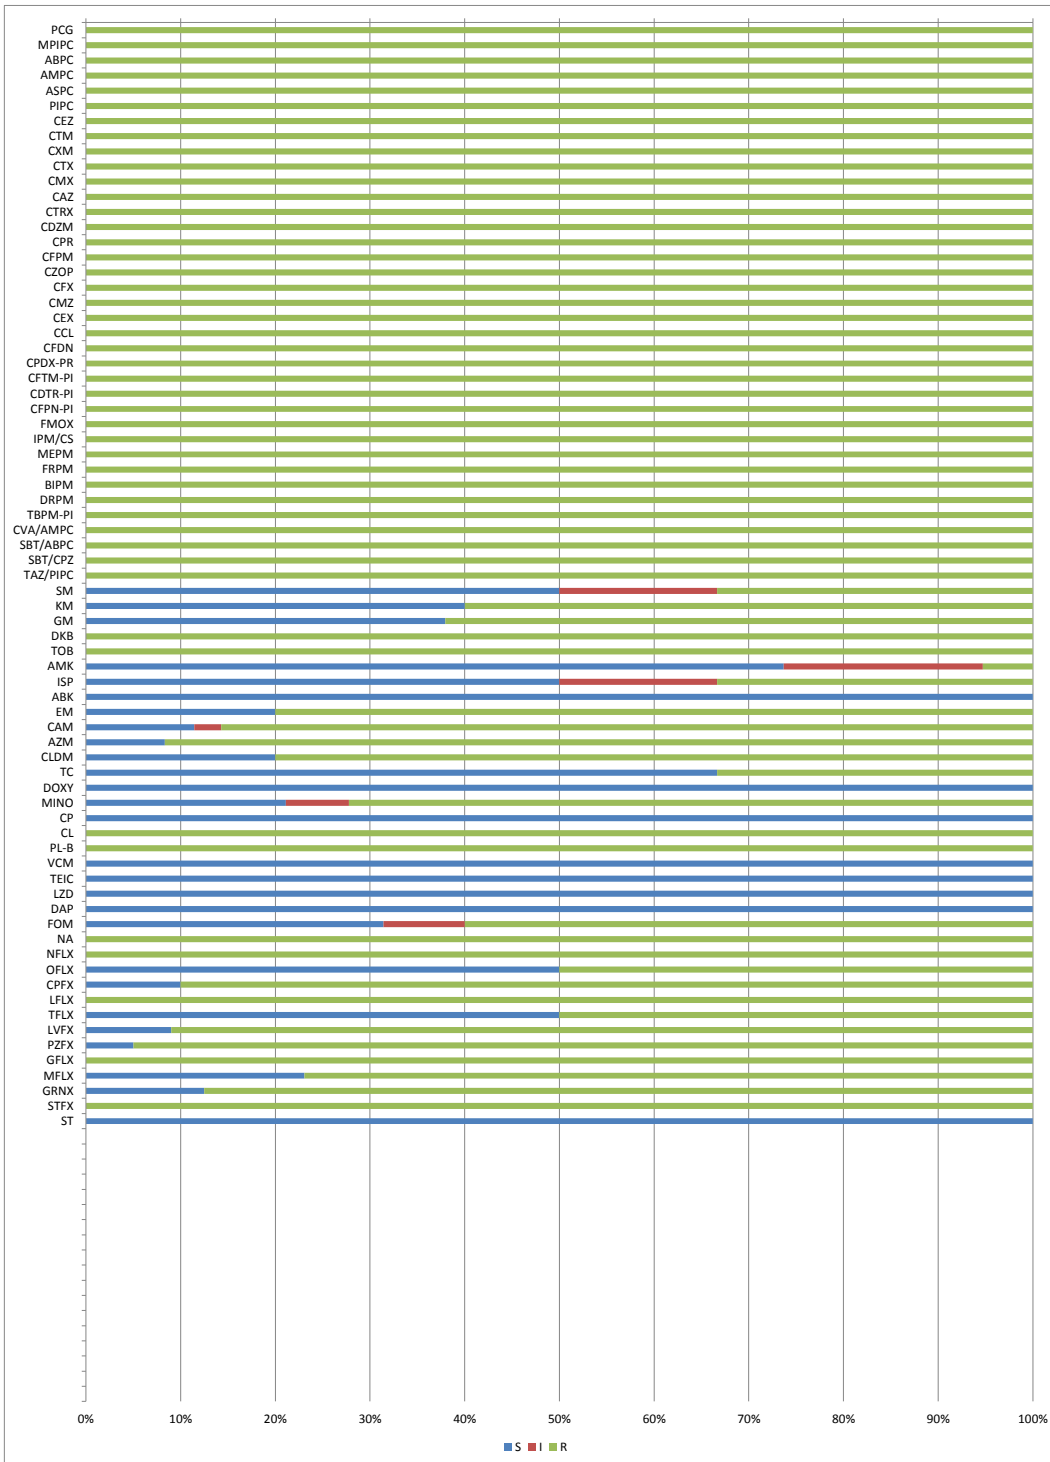

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2016/02/01~2016/02/29	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

薬剤	S (%)	I (%)	R (%)	合計
PCG	0(0%)	0(0%)	44(100%)	44(100%)
MPIP	0(0%)	0(0%)	46(100%)	46(100%)
ABPC	0(0%)	0(0%)	14(100%)	14(100%)
AMPC	0(0%)	0(0%)	21(100%)	21(100%)
ASPC	0(0%)	0(0%)	3(100%)	3(100%)
PIPC	0(0%)	0(0%)	43(100%)	43(100%)
CEZ	0(0%)	0(0%)	72(100%)	72(100%)
CTM	0(0%)	0(0%)	71(100%)	71(100%)
CXM	0(0%)	0(0%)	2(100%)	2(100%)
CTX	0(0%)	0(0%)	45(100%)	45(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
CAZ	0(0%)	0(0%)	22(100%)	22(100%)
CTR	0(0%)	0(0%)	40(100%)	40(100%)
CDZ	0(0%)	0(0%)	1(100%)	1(100%)
CPR	0(0%)	0(0%)	1(100%)	1(100%)
CFPM	0(0%)	0(0%)	67(100%)	67(100%)
CZOP	0(0%)	0(0%)	26(100%)	26(100%)
CFX	0(0%)	0(0%)	2(100%)	2(100%)
CMZ	0(0%)	0(0%)	47(100%)	47(100%)
CEX	0(0%)	0(0%)	4(100%)	4(100%)
CCL	0(0%)	0(0%)	17(100%)	17(100%)
CFDN	0(0%)	0(0%)	14(100%)	14(100%)
CPDX-PR	0(0%)	0(0%)	9(100%)	9(100%)
CFTM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CDTR-PI	0(0%)	0(0%)	9(100%)	9(100%)
CFPN-PI	0(0%)	0(0%)	29(100%)	29(100%)
FMOX	0(0%)	0(0%)	44(100%)	44(100%)
IPM/CS	0(0%)	0(0%)	73(100%)	73(100%)
MEPM	0(0%)	0(0%)	37(100%)	37(100%)
FRPM	0(0%)	0(0%)	12(100%)	12(100%)
BIPM	0(0%)	0(0%)	10(100%)	10(100%)
DRPM	0(0%)	0(0%)	24(100%)	24(100%)
TBPM-PI	0(0%)	0(0%)	2(100%)	2(100%)
CVA/AMPC	0(0%)	0(0%)	3(100%)	3(100%)
SBT/ABPC	0(0%)	0(0%)	66(100%)	66(100%)
SBT/CPZ	0(0%)	0(0%)	78(100%)	78(100%)
TAZ/PIPC	0(0%)	0(0%)	21(100%)	21(100%)
SM	3(50.0%)	1(16.7%)	2(33.3%)	6(100%)
KM	4(40.0%)	0(0%)	6(60.0%)	10(100%)
GM	11(37.9%)	0(0%)	18(62.1%)	29(100%)
DKB	0(0%)	0(0%)	7(100%)	7(100%)
TOB	0(0%)	0(0%)	6(100%)	6(100%)
AMK	14(73.7%)	4(21.1%)	1(5.3%)	19(100%)
ISP	3(50.0%)	1(16.7%)	2(33.3%)	6(100%)
ABK	60(100%)	0(0%)	0(0%)	60(100%)
EM	3(20.0%)	0(0%)	12(80.0%)	15(100%)
CAM	4(11.4%)	1(2.9%)	30(85.7%)	35(100%)
AZM	2(8.3%)	0(0%)	22(91.7%)	24(100%)
CLDM	16(20.0%)	0(0%)	64(80.0%)	80(100%)
TC	2(66.7%)	0(0%)	1(33.3%)	3(100%)
DOXY	2(100%)	0(0%)	0(0%)	2(100%)
MINO	19(21.1%)	6(6.7%)	65(72.2%)	90(100%)
CP	3(100%)	0(0%)	0(0%)	3(100%)
CL	0(0%)	0(0%)	3(100%)	3(100%)
PL-B	0(0%)	0(0%)	11(100%)	11(100%)
VCM	86(100%)	0(0%)	0(0%)	86(100%)
TEIC	70(100%)	0(0%)	0(0%)	70(100%)
LZD	55(100%)	0(0%)	0(0%)	55(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	11(31.4%)	3(8.6%)	21(60.0%)	35(100%)
NA	0(0%)	0(0%)	1(100%)	1(100%)
NFLX	0(0%)	0(0%)	12(100%)	12(100%)
OFLX	5(50.0%)	0(0%)	5(50.0%)	10(100%)
CPFX	2(10.0%)	0(0%)	18(90.0%)	20(100%)
LFLX	0(0%)	0(0%)	4(100%)	4(100%)
LVFX	5(50.0%)	0(0%)	5(50.0%)	10(100%)
PZFX	1(5.0%)	0(0%)	19(95.0%)	20(100%)
GFLX	0(0%)	0(0%)	3(100%)	3(100%)
MFLX	3(23.1%)	0(0%)	10(76.9%)	13(100%)
GRNX	3(12.5%)	0(0%)	21(87.5%)	24(100%)
STFX	0(0%)	0(0%)	6(100%)	6(100%)
ST	21(100%)	0(0%)	0(0%)	21(100%)

