


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2017/03/01~2017/03/31	P.aeruginosa (MDR)	

指定感染菌 検出推移グラフ

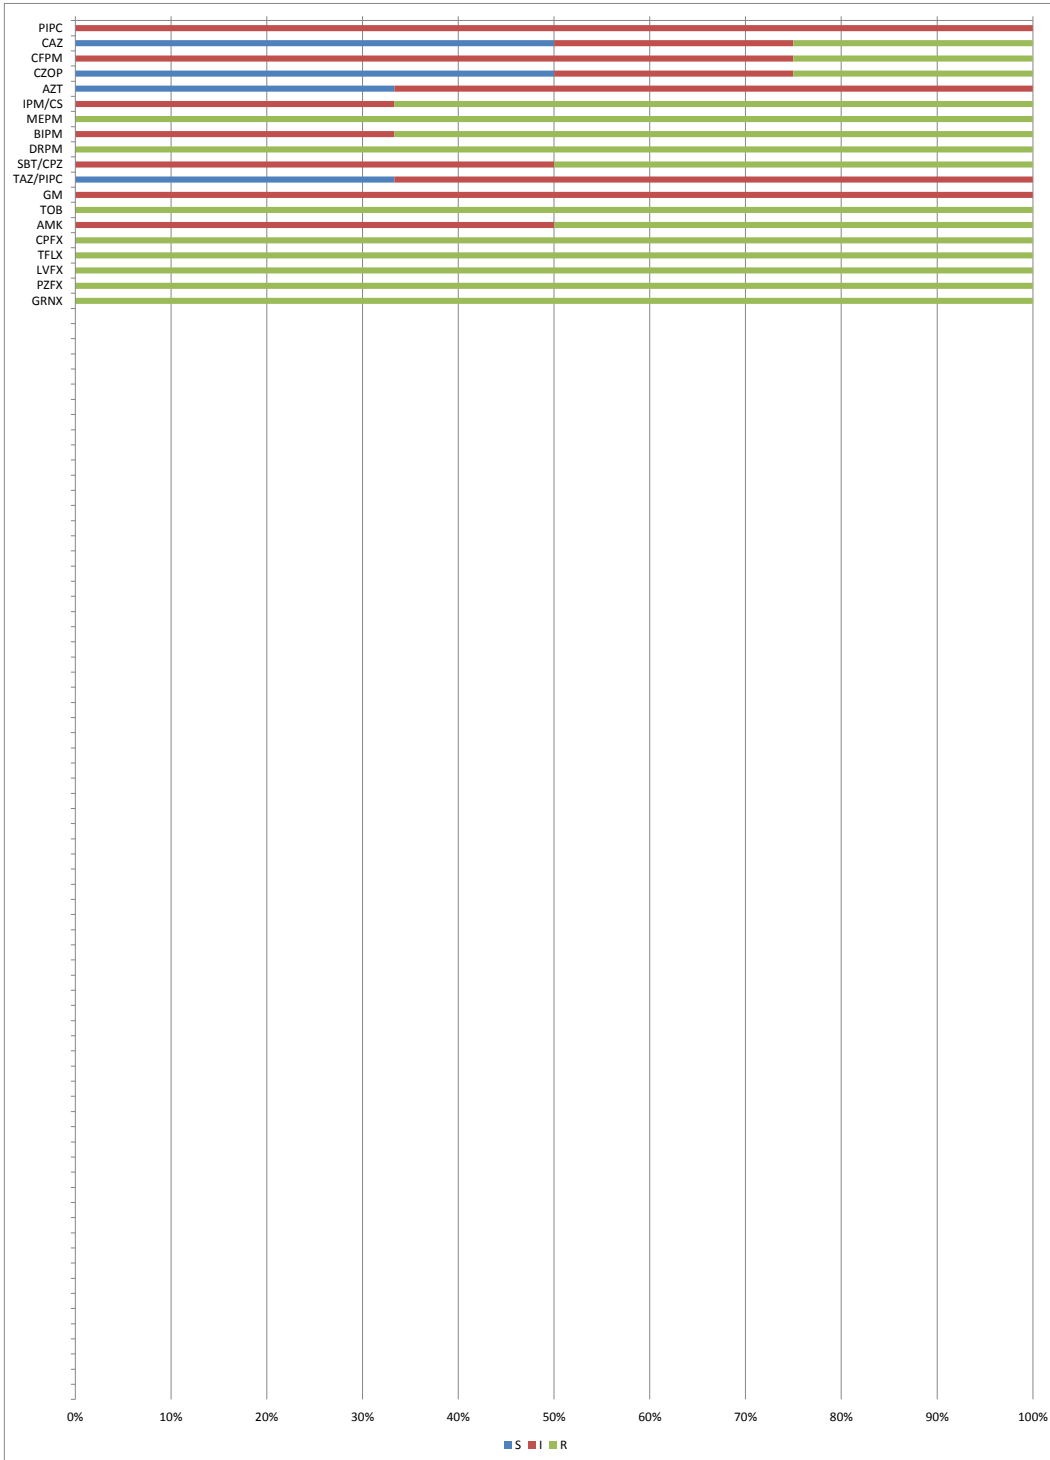

指定感染菌 薬剤感受性状況

受付日	菌
2017/03/01~2017/03/31	P.aeruginosa (MDR)

指定感染菌 薬剤感受性状況表

薬剤	S	I	R	合計
PIPC	0(0%)	4(100%)	0(0%)	4(100%)
CAZ	2(50.0%)	1(25.0%)	1(25.0%)	4(100%)
CFPM	0(0%)	3(75.0%)	1(25.0%)	4(100%)
CZOP	2(50.0%)	1(25.0%)	1(25.0%)	4(100%)
AZT	1(33.3%)	2(66.7%)	0(0%)	3(100%)
IPM/CS	0(0%)	1(33.3%)	2(66.7%)	3(100%)
MEPM	0(0%)	0(0%)	4(100%)	4(100%)
BIPM	0(0%)	1(33.3%)	2(66.7%)	3(100%)
DRPM	0(0%)	0(0%)	1(100%)	1(100%)
SBT/CPZ	0(0%)	2(50.0%)	2(50.0%)	4(100%)
TAZ/PIPC	1(33.3%)	2(66.7%)	0(0%)	3(100%)
GM	0(0%)	1(100%)	0(0%)	1(100%)
TOB	0(0%)	0(0%)	3(100%)	3(100%)
AMK	0(0%)	2(50.0%)	2(50.0%)	4(100%)
CPFX	0(0%)	0(0%)	3(100%)	3(100%)
TFLX	0(0%)	0(0%)	3(100%)	3(100%)
LVFX	0(0%)	0(0%)	4(100%)	4(100%)
PZFX	0(0%)	0(0%)	4(100%)	4(100%)
GRNX	0(0%)	0(0%)	1(100%)	1(100%)

指定感染菌 薬剤感受性状況

印刷日: 2017/04/25 12:17:36

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2017/03/01~2017/03/31	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ



指定感染菌 薬剤感受性状況表

薬剤	S (%)	I (%)	R (%)	合計
PCG	0(0%)	0(0%)	48(100%)	48(100%)
MPIP	0(0%)	0(0%)	48(100%)	48(100%)
ABPC	0(0%)	0(0%)	16(100%)	16(100%)
AMPC	0(0%)	0(0%)	36(100%)	36(100%)
PIP	0(0%)	0(0%)	72(100%)	72(100%)
CEZ	0(0%)	0(0%)	83(100%)	83(100%)
CTM	0(0%)	0(0%)	82(100%)	82(100%)
CTX	0(0%)	0(0%)	51(100%)	51(100%)
CZX	0(0%)	0(0%)	1(100%)	1(100%)
CMX	0(0%)	0(0%)	1(100%)	1(100%)
CAZ	0(0%)	0(0%)	47(100%)	47(100%)
CTRX	0(0%)	0(0%)	67(100%)	67(100%)
CDZM	0(0%)	0(0%)	1(100%)	1(100%)
CPR	0(0%)	0(0%)	6(100%)	6(100%)
CFPM	0(0%)	0(0%)	94(100%)	94(100%)
CZOP	0(0%)	0(0%)	26(100%)	26(100%)
CMZ	0(0%)	0(0%)	49(100%)	49(100%)
CEX	0(0%)	0(0%)	3(100%)	3(100%)
CCL	0(0%)	0(0%)	24(100%)	24(100%)
CFDN	0(0%)	0(0%)	24(100%)	24(100%)
CPDX-PR	0(0%)	0(0%)	8(100%)	8(100%)
CFTM-PI	0(0%)	0(0%)	6(100%)	6(100%)
CDTR-PI	0(0%)	0(0%)	13(100%)	13(100%)
CFPN-PI	0(0%)	0(0%)	32(100%)	32(100%)
FMOX	0(0%)	0(0%)	45(100%)	45(100%)
IPM/CS	0(0%)	0(0%)	74(100%)	74(100%)
PAPM/BP	0(0%)	0(0%)	8(100%)	8(100%)
MEPM	0(0%)	0(0%)	52(100%)	52(100%)
FRPM	0(0%)	0(0%)	12(100%)	12(100%)
BIPM	0(0%)	0(0%)	12(100%)	12(100%)
DRPM	0(0%)	0(0%)	33(100%)	33(100%)
TBPM-PI	0(0%)	0(0%)	2(100%)	2(100%)
CVA/AMPC	0(0%)	0(0%)	6(100%)	6(100%)
SBT/ABPC	0(0%)	0(0%)	92(100%)	92(100%)
SBT/CPZ	0(0%)	0(0%)	105(100%)	105(100%)
TAZ/PIPC	0(0%)	0(0%)	25(100%)	25(100%)
SM	11(68.8%)	3(18.8%)	2(12.5%)	16(100%)
KM	2(20.0%)	0(0%)	8(80.0%)	10(100%)
GM	11(24.4%)	2(4.4%)	32(71.1%)	45(100%)
DKB	1(33.3%)	0(0%)	2(66.7%)	3(100%)
TOB	3(60.0%)	0(0%)	2(40.0%)	5(100%)
AMK	33(89.2%)	2(5.4%)	2(5.4%)	37(100%)
ISP	4(40.0%)	4(40.0%)	2(20.0%)	10(100%)
ABK	65(100%)	0(0%)	0(0%)	65(100%)
EM	0(0%)	1(4.5%)	21(95.5%)	22(100%)
CAM	4(6.7%)	0(0%)	56(93.3%)	60(100%)
AZM	3(10.0%)	0(0%)	27(90.0%)	30(100%)
CLDM	21(20.8%)	2(2.0%)	78(77.2%)	101(100%)
DOXY	1(100%)	0(0%)	0(0%)	1(100%)
MINO	31(25.8%)	9(7.5%)	80(66.7%)	120(100%)
PL-B	0(0%)	0(0%)	12(100%)	12(100%)
VCM	116(100%)	0(0%)	0(0%)	116(100%)
TEIC	81(100%)	0(0%)	0(0%)	81(100%)
LZD	56(100%)	0(0%)	0(0%)	56(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
NA	17(38.6%)	3(6.8%)	24(54.5%)	44(100%)
NFLX	0(0%)	0(0%)	4(100%)	4(100%)
OFLX	1(20.0%)	1(20.0%)	3(60.0%)	5(100%)
CPFX	0(0%)	0(0%)	32(100%)	32(100%)
LFLX	1(50.0%)	0(0%)	1(50.0%)	2(100%)
TFLX	3(16.7%)	0(0%)	15(83.3%)	18(100%)
LVFX	6(5.1%)	0(0%)	112(94.9%)	118(100%)
PZFX	3(1.1%)	0(0%)	24(88.9%)	27(100%)
PUFX	0(0%)	0(0%)	1(100%)	1(100%)
MFLX	0(0%)	0(0%)	8(100%)	8(100%)
GRNX	3(6.7%)	0(0%)	42(93.3%)	45(100%)
STFX	2(28.8%)	1(14.3%)	4(57.1%)	7(100%)
ST	33(100%)	0(0%)	0(0%)	33(100%)


指定感染菌 薬剤感受性状況

印刷日: 2017/04/25 12:17:36

指定感染菌 薬剤感受性状況

抽出条件		
受付日	菌	医療機関
2017/03/01~2017/03/31	S.pneumoniae (PRSP)	

指定感染菌 検出推移グラフ

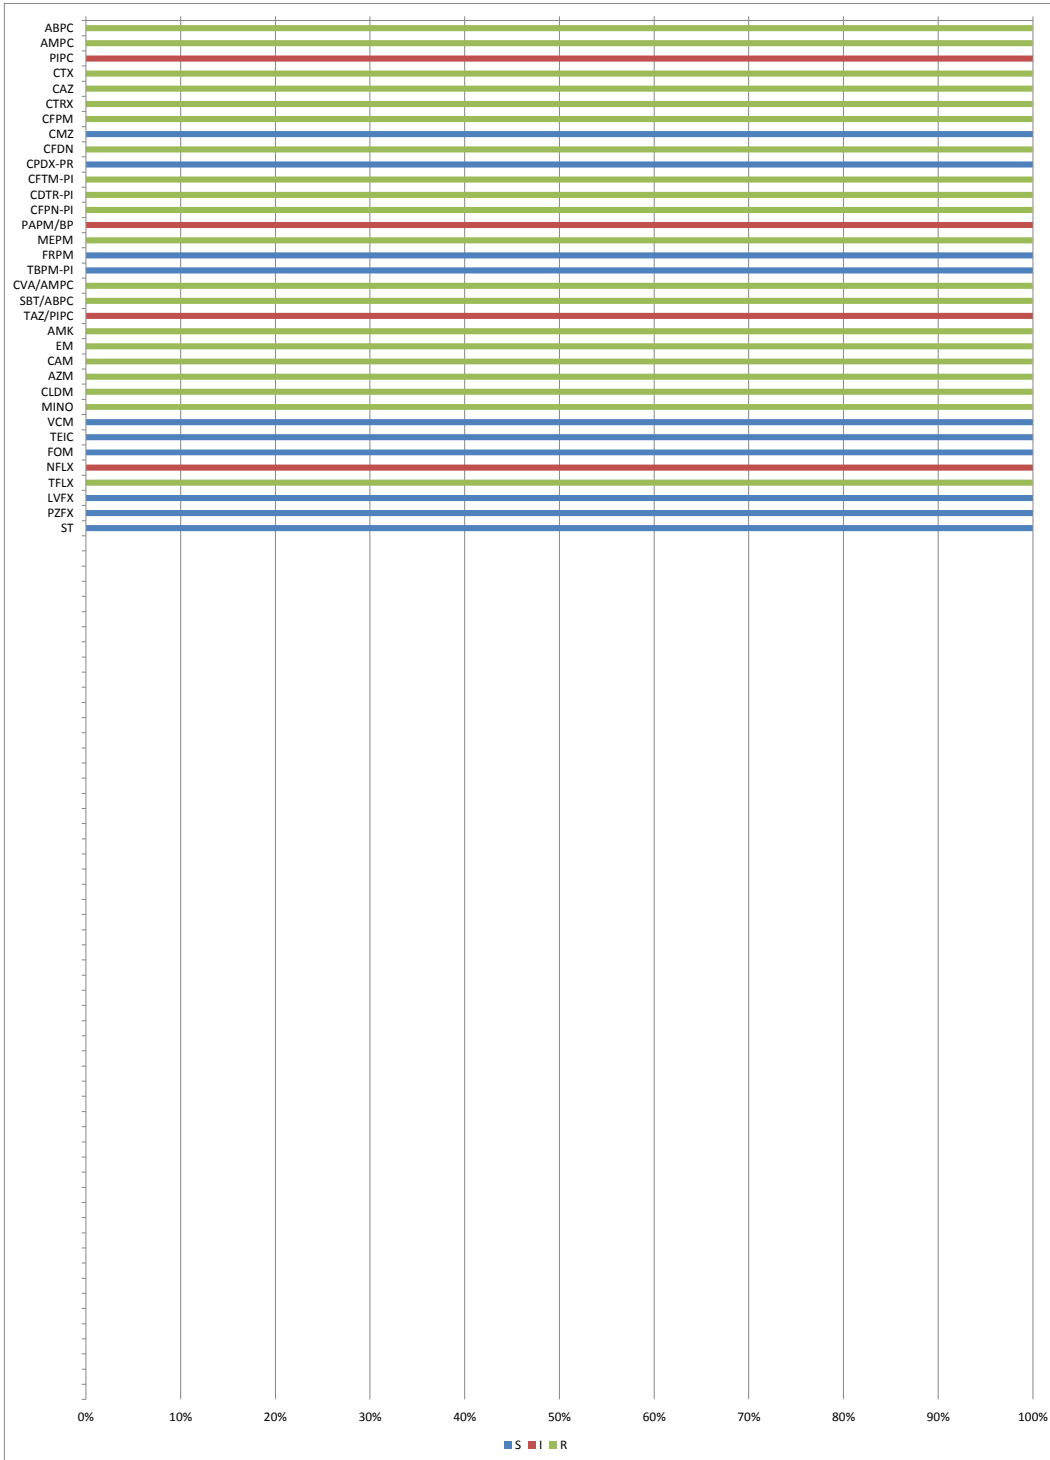

指定感染菌 薬剤感受性状況表

薬剤	S	I	R	合計
ABPC	0(0%)	0(0%)	1(100%)	1(100%)
AMPC	0(0%)	0(0%)	1(100%)	1(100%)
PIPC	0(0%)	1(100%)	0(0%)	1(100%)
CTX	0(0%)	0(0%)	1(100%)	1(100%)
CAZ	0(0%)	0(0%)	1(100%)	1(100%)
CTRX	0(0%)	0(0%)	1(100%)	1(100%)
CFPM	0(0%)	0(0%)	1(100%)	1(100%)
CMZ	1(100%)	0(0%)	0(0%)	1(100%)
CFDN	0(0%)	0(0%)	1(100%)	1(100%)
CPDX-PR	1(100%)	0(0%)	0(0%)	1(100%)
CFTM-PI	0(0%)	0(0%)	1(100%)	1(100%)
CDTR-PI	0(0%)	0(0%)	1(100%)	1(100%)
CFPN-PI	0(0%)	0(0%)	1(100%)	1(100%)
PAPM/BP	0(0%)	1(100%)	0(0%)	1(100%)
MEPM	0(0%)	0(0%)	1(100%)	1(100%)
FRPM	1(100%)	0(0%)	0(0%)	1(100%)
TBPM-PI	1(100%)	0(0%)	0(0%)	1(100%)
CVA/AMPC	0(0%)	0(0%)	1(100%)	1(100%)
SBT/ABPC	0(0%)	0(0%)	1(100%)	1(100%)
TAZ/PIPC	0(0%)	1(100%)	0(0%)	1(100%)
AMK	0(0%)	0(0%)	1(100%)	1(100%)
EM	0(0%)	0(0%)	1(100%)	1(100%)
CAM	0(0%)	0(0%)	1(100%)	1(100%)
AZM	0(0%)	0(0%)	1(100%)	1(100%)
CLDM	0(0%)	0(0%)	1(100%)	1(100%)
MINO	0(0%)	0(0%)	1(100%)	1(100%)
VCM	1(100%)	0(0%)	0(0%)	1(100%)
TEIC	1(100%)	0(0%)	0(0%)	1(100%)
FOM	1(100%)	0(0%)	0(0%)	1(100%)
NFLX	0(0%)	1(100%)	0(0%)	1(100%)
TFLX	0(0%)	0(0%)	1(100%)	1(100%)
LVFX	1(100%)	0(0%)	0(0%)	1(100%)
PZFX	1(100%)	0(0%)	0(0%)	1(100%)
ST	1(100%)	0(0%)	0(0%)	1(100%)