


指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2017/04/01~2017/04/30	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

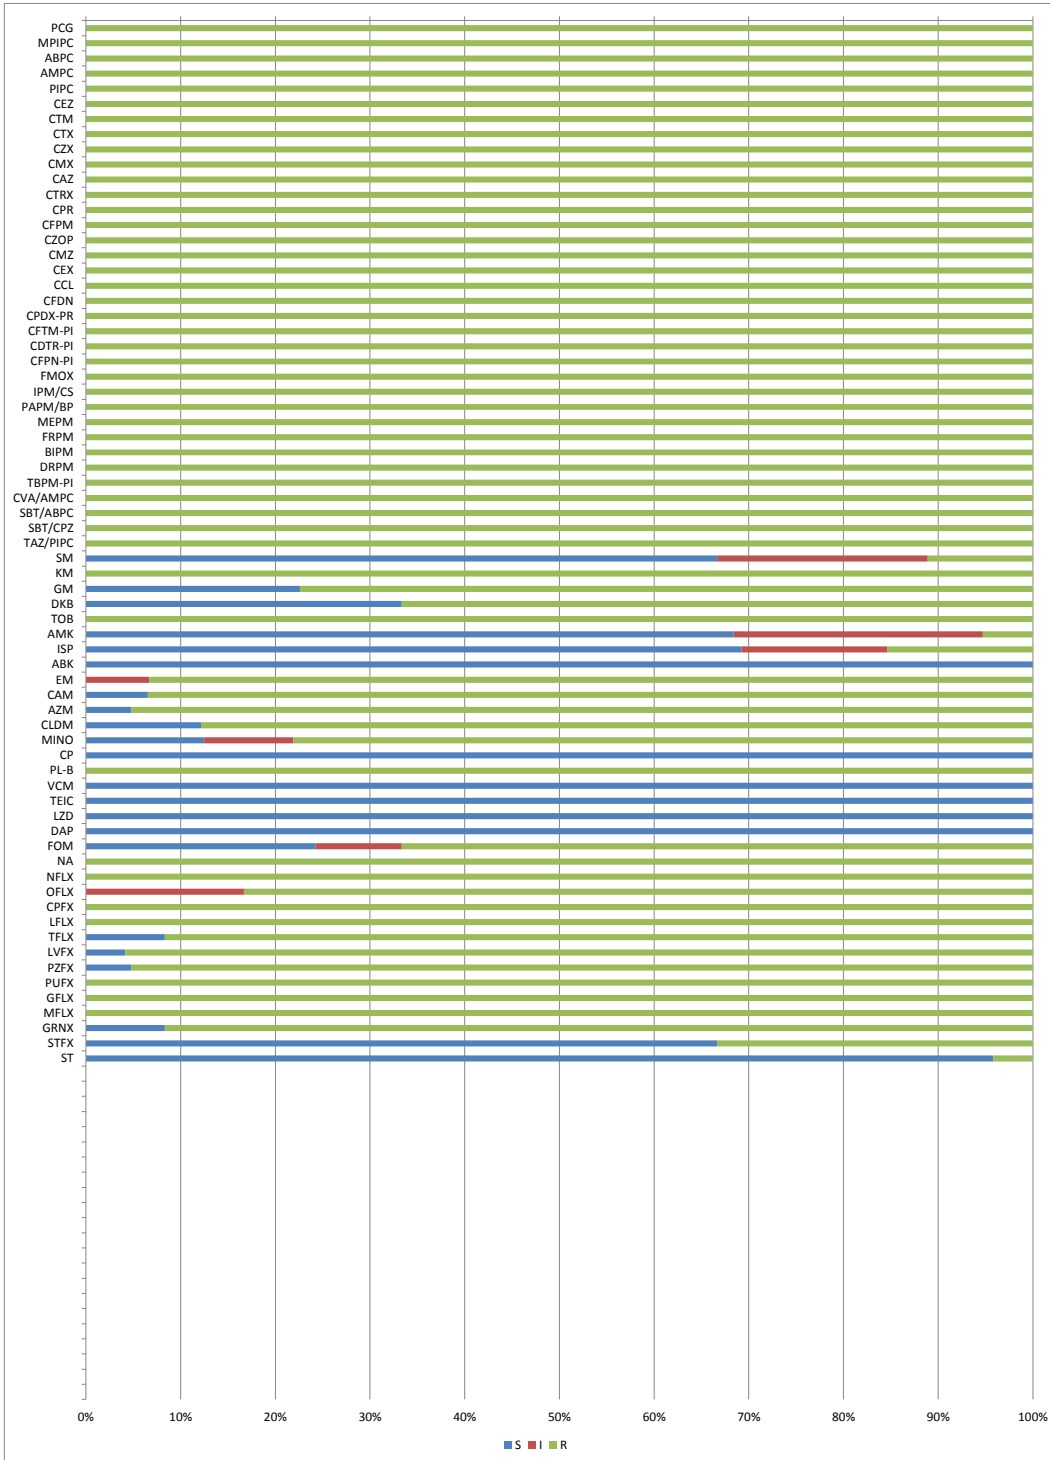

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2017/04/01~2017/04/30	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

薬剤	S (%)	I (%)	R (%)	合計
PCG	0(0%)	0(0%)	42(100%)	42(100%)
MPIPC	0(0%)	0(0%)	45(100%)	45(100%)
ABPC	0(0%)	0(0%)	7(100%)	7(100%)
AMPC	0(0%)	0(0%)	26(100%)	26(100%)
PIPC	0(0%)	0(0%)	49(100%)	49(100%)
CEZ	0(0%)	0(0%)	62(100%)	62(100%)
CTM	0(0%)	0(0%)	63(100%)	63(100%)
CTX	0(0%)	0(0%)	43(100%)	43(100%)
CZX	0(0%)	0(0%)	3(100%)	3(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
GAZ	0(0%)	0(0%)	36(100%)	36(100%)
CTRX	0(0%)	0(0%)	45(100%)	45(100%)
CPR	0(0%)	0(0%)	4(100%)	4(100%)
CFPM	0(0%)	0(0%)	72(100%)	72(100%)
CZOP	0(0%)	0(0%)	20(100%)	20(100%)
CMZ	0(0%)	0(0%)	50(100%)	50(100%)
CEX	0(0%)	0(0%)	2(100%)	2(100%)
CCL	0(0%)	0(0%)	13(100%)	13(100%)
CFDN	0(0%)	0(0%)	13(100%)	13(100%)
CPDX-PR	0(0%)	0(0%)	3(100%)	3(100%)
CFPM-PI	0(0%)	0(0%)	1(100%)	1(100%)
CDTR-PI	0(0%)	0(0%)	17(100%)	17(100%)
CFPN-PI	0(0%)	0(0%)	25(100%)	25(100%)
FMOX	0(0%)	0(0%)	42(100%)	42(100%)
IPM/CS	0(0%)	0(0%)	60(100%)	60(100%)
PAPM/BP	0(0%)	0(0%)	1(100%)	1(100%)
MEPM	0(0%)	0(0%)	39(100%)	39(100%)
FRPM	0(0%)	0(0%)	11(100%)	11(100%)
BIPM	0(0%)	0(0%)	7(100%)	7(100%)
DRPM	0(0%)	0(0%)	23(100%)	23(100%)
TBPM-PI	0(0%)	0(0%)	1(100%)	1(100%)
CVA/AMPC	0(0%)	0(0%)	5(100%)	5(100%)
SBT/ABPC	0(0%)	0(0%)	74(100%)	74(100%)
SBT/CPZ	0(0%)	0(0%)	86(100%)	86(100%)
TAZ/PIPC	0(0%)	0(0%)	9(100%)	9(100%)
SM	6(66.7%)	2(22.2%)	1(11.1%)	9(100%)
KM	0(0%)	0(0%)	5(100%)	5(100%)
GM	7(22.8%)	0(0%)	24(77.4%)	31(100%)
DKB	1(33.3%)	0(0%)	2(66.7%)	3(100%)
TOB	0(0%)	0(0%)	2(100%)	2(100%)
AMK	13(68.4%)	5(26.3%)	1(5.3%)	19(100%)
ISP	9(99.2%)	2(15.4%)	2(15.4%)	13(100%)
ABK	54(100%)	0(0%)	0(0%)	54(100%)
EM	0(0%)	1(6.7%)	14(93.3%)	15(100%)
CAM	3(6.5%)	0(0%)	43(93.5%)	46(100%)
AZM	1(4.8%)	0(0%)	20(95.2%)	21(100%)
CLDM	9(12.2%)	0(0%)	65(87.8%)	74(100%)
MINO	12(12.5%)	9(9.4%)	75(78.1%)	96(100%)
CP	1(100%)	0(0%)	0(0%)	1(100%)
PL-B	0(0%)	0(0%)	9(100%)	9(100%)
VCM	94(100%)	0(0%)	0(0%)	94(100%)
TEIC	66(100%)	0(0%)	0(0%)	66(100%)
LZD	47(100%)	0(0%)	0(0%)	47(100%)
DAP	2(100%)	0(0%)	0(0%)	2(100%)
FOM	8(24.2%)	3(9.1%)	22(66.7%)	33(100%)
NA	0(0%)	0(0%)	3(100%)	3(100%)
NFLX	0(0%)	0(0%)	1(100%)	1(100%)
OFLX	0(0%)	1(16.7%)	5(83.3%)	6(100%)
CPFX	0(0%)	0(0%)	26(100%)	26(100%)
LVFX	0(0%)	0(0%)	4(100%)	4(100%)
PZFX	1(8.3%)	0(0%)	11(91.7%)	12(100%)
PUFX	4(4.2%)	0(0%)	92(95.8%)	96(100%)
GFLX	1(4.8%)	0(0%)	20(95.2%)	21(100%)
PUFX	0(0%)	0(0%)	2(100%)	2(100%)
GFLX	0(0%)	0(0%)	2(100%)	2(100%)
MFLX	0(0%)	0(0%)	5(100%)	5(100%)
GRNX	3(8.3%)	0(0%)	33(91.7%)	36(100%)
STFX	2(66.7%)	0(0%)	1(33.3%)	3(100%)
ST	23(95.8%)	0(0%)	1(4.2%)	24(100%)

