

指定感染症 薬剤感受性状況


指定感染症 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2018/04/01~2018/04/30	P.aeruginosa (MDR)	

受付日	菌
2018/04/01~2018/04/30	P.aeruginosa (MDR)

指定感染症 検出推移グラフ

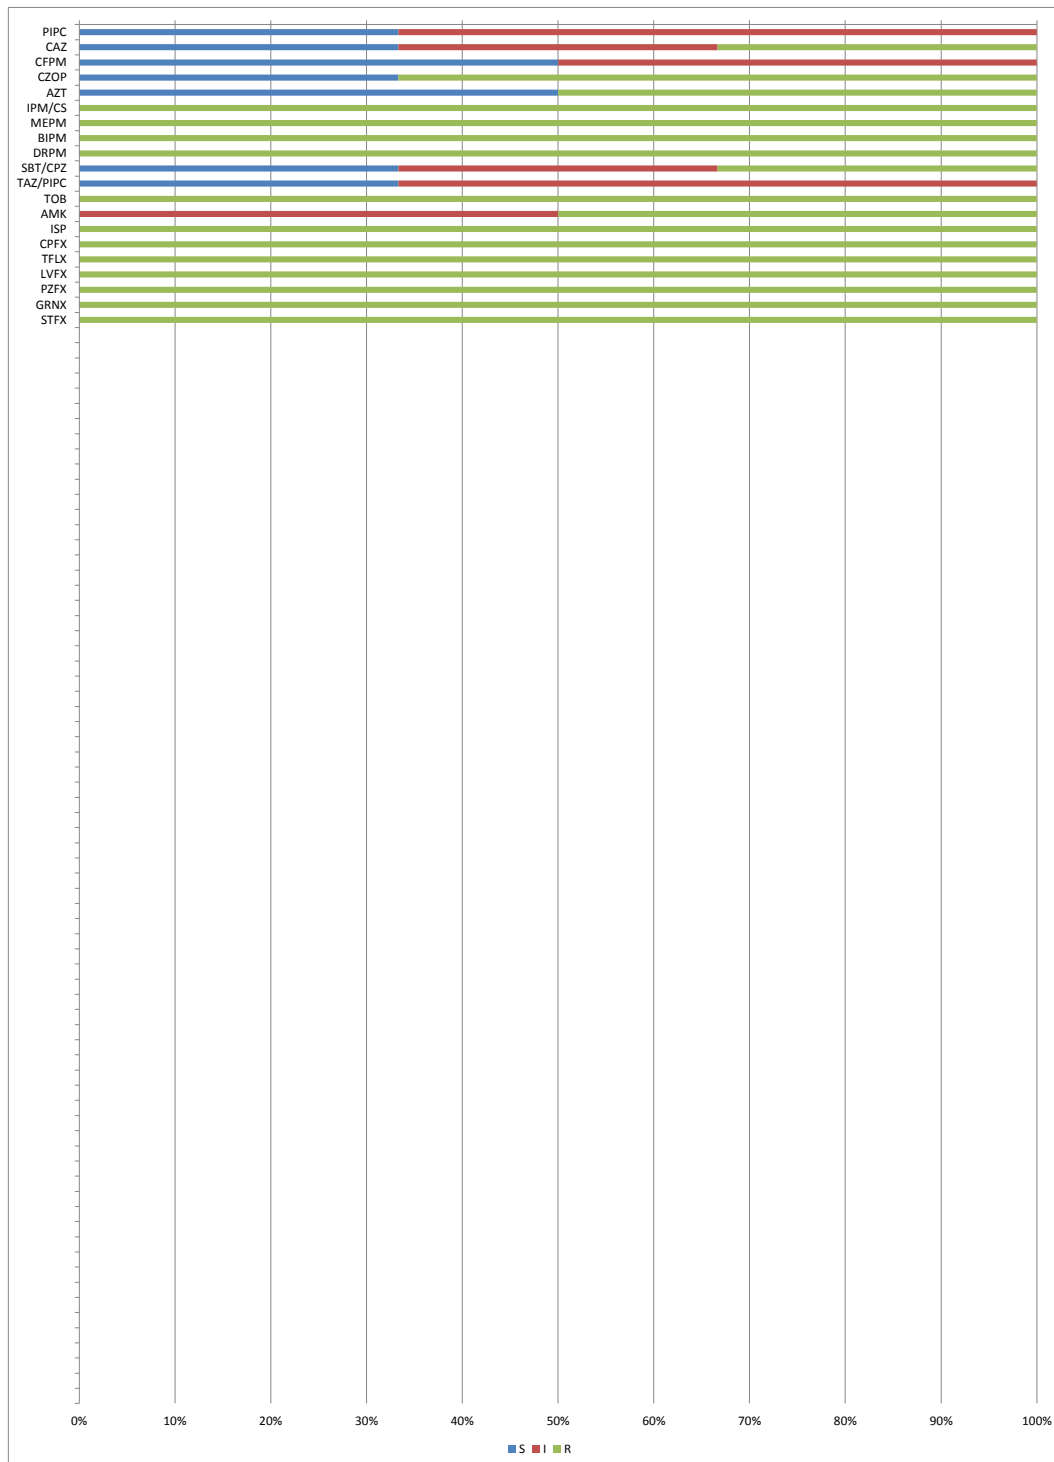

指定感染症 薬剤感受性状況表


薬剤	S	I	R	合計
PIPC	1(33.3%)	2(66.7%)	0(0%)	3(100%)
CAZ	1(33.3%)	1(33.3%)	1(33.3%)	3(100%)
CFPM	1(50.0%)	1(50.0%)	0(0%)	2(100%)
CZOP	1(33.3%)	0(0%)	2(66.7%)	3(100%)
AZT	1(50.0%)	0(0%)	1(50.0%)	2(100%)
IPM/CS	0(0%)	0(0%)	2(100%)	2(100%)
MEPM	0(0%)	0(0%)	3(100%)	3(100%)
BIPM	0(0%)	0(0%)	2(100%)	2(100%)
DRPM	0(0%)	0(0%)	1(100%)	1(100%)
SBT/CPZ	1(33.3%)	1(33.3%)	1(33.3%)	3(100%)
TAZ/PIPC	1(33.3%)	2(66.7%)	0(0%)	3(100%)
TOB	0(0%)	0(0%)	2(100%)	2(100%)
AMK	0(0%)	1(50.0%)	1(50.0%)	2(100%)
ISP	0(0%)	0(0%)	1(100%)	1(100%)
CPFX	0(0%)	0(0%)	2(100%)	2(100%)
TFLX	0(0%)	0(0%)	2(100%)	2(100%)
LVFX	0(0%)	0(0%)	3(100%)	3(100%)
PZFX	0(0%)	0(0%)	3(100%)	3(100%)
GRNX	0(0%)	0(0%)	1(100%)	1(100%)
STFX	0(0%)	0(0%)	1(100%)	1(100%)

指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2018/04/01~2018/04/30	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

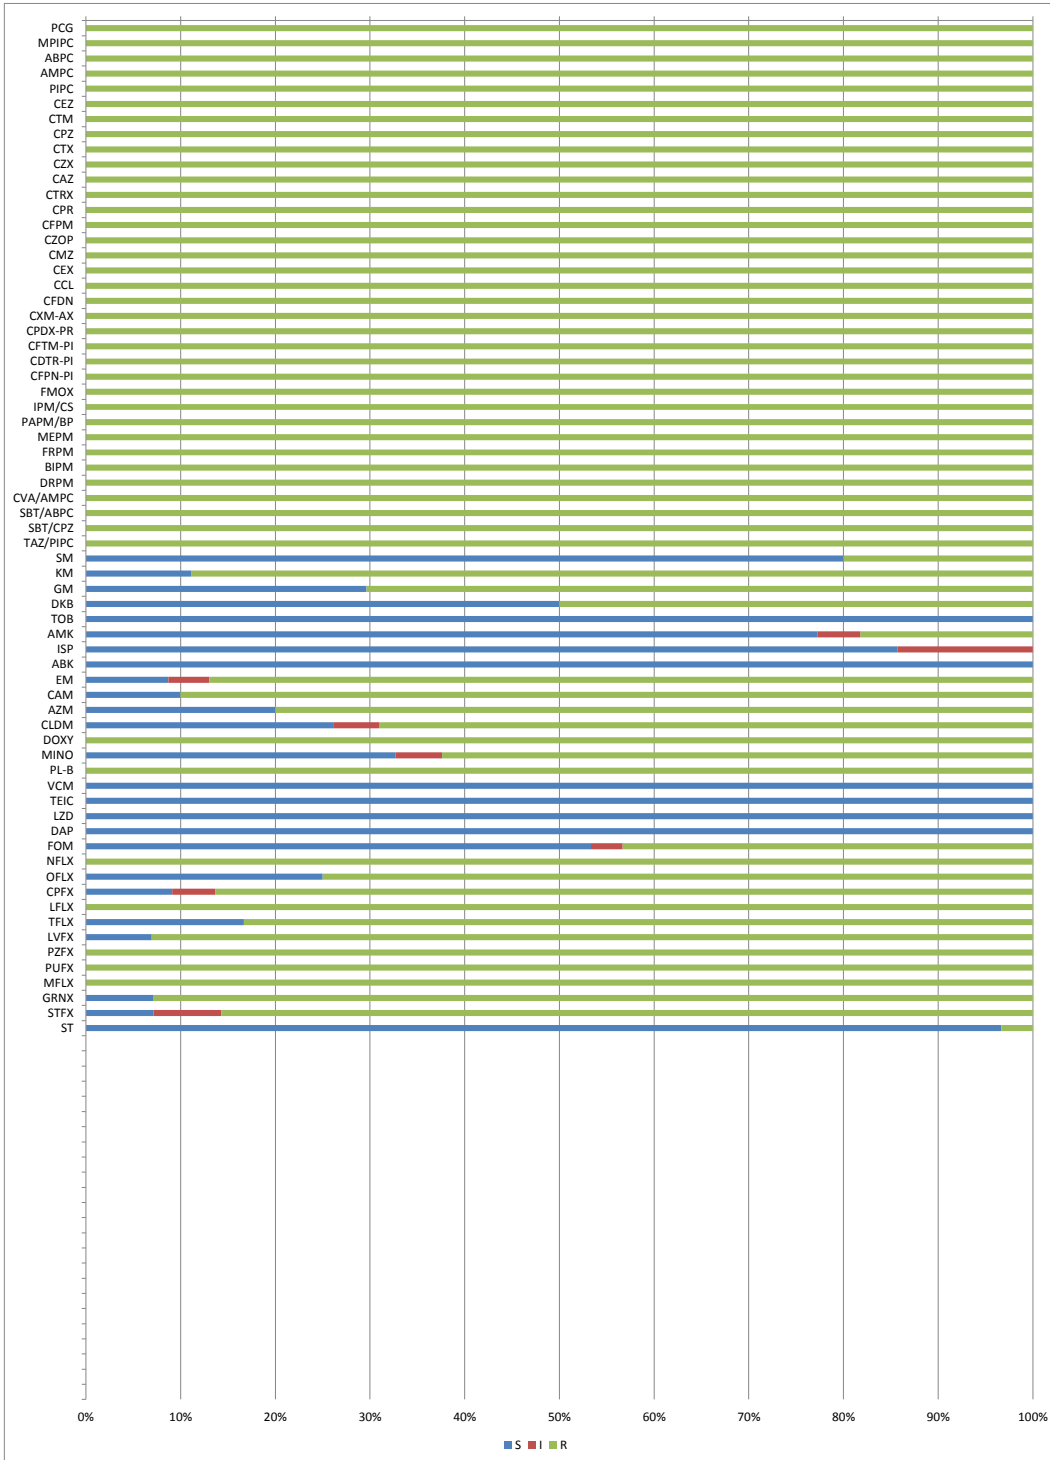

指定感染菌 薬剤感受性状況

受付日	菌
2018/04/01~2018/04/30	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	56(100%)	56(100%)
MPIP	0(0%)	0(0%)	57(100%)	57(100%)
ABPC	0(0%)	0(0%)	10(100%)	10(100%)
AMPC	0(0%)	0(0%)	30(100%)	30(100%)
PIP	0(0%)	0(0%)	45(100%)	45(100%)
CEZ	0(0%)	0(0%)	82(100%)	82(100%)
CTM	0(0%)	0(0%)	80(100%)	80(100%)
CPZ	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	55(100%)	55(100%)
CZX	0(0%)	0(0%)	1(100%)	1(100%)
GAZ	0(0%)	0(0%)	26(100%)	26(100%)
CTR	0(0%)	0(0%)	42(100%)	42(100%)
CPR	0(0%)	0(0%)	4(100%)	4(100%)
CFPM	0(0%)	0(0%)	81(100%)	81(100%)
CZOP	0(0%)	0(0%)	17(100%)	17(100%)
CMZ	0(0%)	0(0%)	66(100%)	66(100%)
CEX	0(0%)	0(0%)	7(100%)	7(100%)
CCL	0(0%)	0(0%)	27(100%)	27(100%)
CFDN	0(0%)	0(0%)	18(100%)	18(100%)
CXM-AX	0(0%)	0(0%)	1(100%)	1(100%)
CPDX-PR	0(0%)	0(0%)	7(100%)	7(100%)
CFTM-PI	0(0%)	0(0%)	4(100%)	4(100%)
CDTR-PI	0(0%)	0(0%)	9(100%)	9(100%)
CFPN-PI	0(0%)	0(0%)	24(100%)	24(100%)
FMOX	0(0%)	0(0%)	57(100%)	57(100%)
IPM/CS	0(0%)	0(0%)	74(100%)	74(100%)
PAPM/BP	0(0%)	0(0%)	7(100%)	7(100%)
MEPM	0(0%)	0(0%)	36(100%)	36(100%)
FRPM	0(0%)	0(0%)	19(100%)	19(100%)
BIPM	0(0%)	0(0%)	6(100%)	6(100%)
DRPM	0(0%)	0(0%)	19(100%)	19(100%)
CVA/AMPC	0(0%)	0(0%)	4(100%)	4(100%)
SBT/ABPC	0(0%)	0(0%)	82(100%)	82(100%)
SBT/CPZ	0(0%)	0(0%)	89(100%)	89(100%)
TAZ/PIP	0(0%)	0(0%)	28(100%)	28(100%)
SM	8(80.0%)	0(0%)	2(20.0%)	10(100%)
KM	1(11.1%)	0(0%)	8(88.9%)	9(100%)
GM	8(29.6%)	0(0%)	19(70.4%)	27(100%)
DKB	2(50.0%)	0(0%)	2(50.0%)	4(100%)
TOB	1(100%)	0(0%)	0(0%)	1(100%)
AMK	17(77.3%)	1(4.5%)	4(18.2%)	22(100%)
ISP	6(85.7%)	1(14.3%)	0(0%)	7(100%)
ABK	64(100%)	0(0%)	0(0%)	64(100%)
EM	2(8.7%)	1(4.3%)	20(87.0%)	23(100%)
CAM	4(10.0%)	0(0%)	36(90.0%)	40(100%)
AZM	4(20.0%)	0(0%)	16(80.0%)	20(100%)
CLDM	22(26.2%)	4(4.8%)	58(69.0%)	84(100%)
DOXY	0(0%)	0(0%)	1(100%)	1(100%)
MINO	33(32.7%)	5(5.0%)	63(62.4%)	101(100%)
PL-B	0(0%)	0(0%)	11(100%)	11(100%)
VCM	101(100%)	0(0%)	0(0%)	101(100%)
TEIC	77(100%)	0(0%)	0(0%)	77(100%)
LZD	68(100%)	0(0%)	0(0%)	68(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	16(53.3%)	1(3.3%)	13(43.3%)	30(100%)
NFLX	0(0%)	0(0%)	5(100%)	5(100%)
OFLX	1(25.0%)	0(0%)	3(75.0%)	4(100%)
CPFX	2(9.1%)	1(4.5%)	19(86.4%)	22(100%)
LFLX	0(0%)	0(0%)	1(100%)	1(100%)
TFLX	2(16.7%)	0(0%)	10(83.3%)	12(100%)
LVFX	7(6.9%)	0(0%)	94(93.1%)	101(100%)
PZFX	0(0%)	0(0%)	16(100%)	16(100%)
PUFX	0(0%)	0(0%)	5(100%)	5(100%)
MFLX	0(0%)	0(0%)	9(100%)	9(100%)
GRNX	2(7.1%)	0(0%)	26(92.9%)	28(100%)
STFX	1(7.1%)	1(7.1%)	12(85.7%)	14(100%)
ST	29(96.7%)	0(0%)	1(3.3%)	30(100%)