


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2018/05/01~2018/05/31	P.aeruginosa (MDR)	

指定感染菌 検出推移グラフ

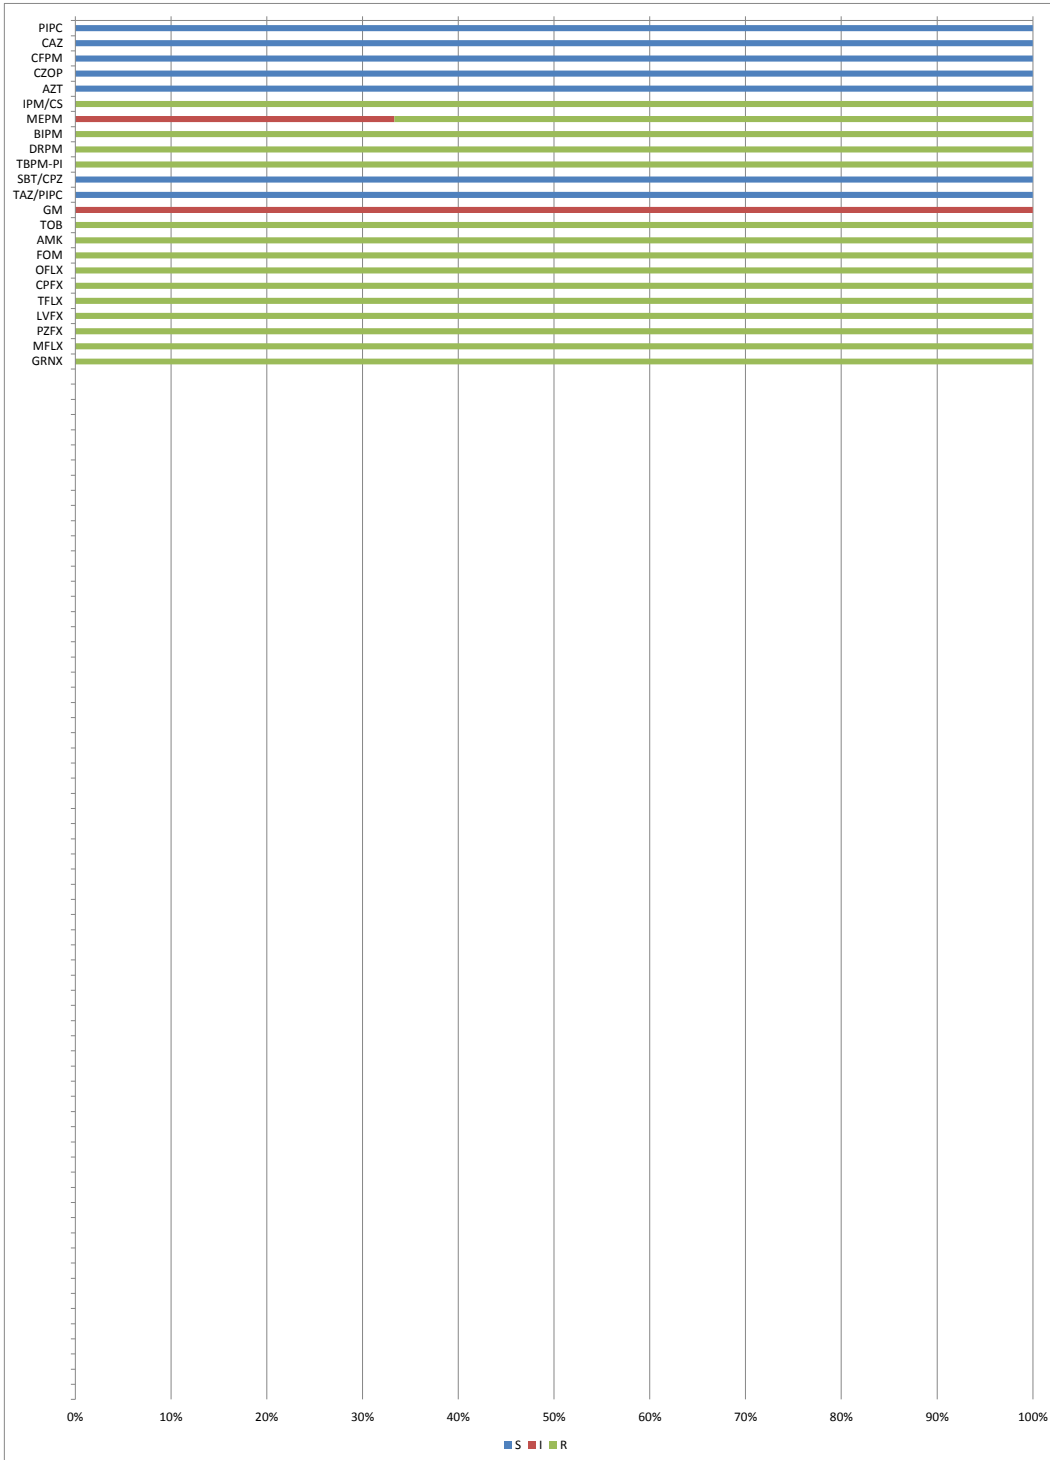

指定感染菌 薬剤感受性状況

受付日	菌
2018/05/01~2018/05/31	P.aeruginosa (MDR)

指定感染菌 薬剤感受性状況表

薬剤	S	I	R	合計
PIPC	2(100%)	0(0%)	0(0%)	2(100%)
CAZ	2(100%)	0(0%)	0(0%)	2(100%)
CFPM	3(100%)	0(0%)	0(0%)	3(100%)
CZOP	2(100%)	0(0%)	0(0%)	2(100%)
AZT	1(100%)	0(0%)	0(0%)	1(100%)
IPM/CS	0(0%)	0(0%)	1(100%)	1(100%)
MEPM	0(0%)	1(33.3%)	2(66.7%)	3(100%)
BIPM	0(0%)	0(0%)	1(100%)	1(100%)
DRPM	0(0%)	0(0%)	1(100%)	1(100%)
TBPM-PI	0(0%)	0(0%)	1(100%)	1(100%)
SBT/CPZ	2(100%)	0(0%)	0(0%)	2(100%)
TAZ/PIPC	3(100%)	0(0%)	0(0%)	3(100%)
GM	0(0%)	1(100%)	0(0%)	1(100%)
TOB	0(0%)	0(0%)	1(100%)	1(100%)
AMK	0(0%)	0(0%)	2(100%)	2(100%)
FOM	0(0%)	0(0%)	1(100%)	1(100%)
OFLX	0(0%)	0(0%)	1(100%)	1(100%)
CPFX	0(0%)	0(0%)	1(100%)	1(100%)
TFX	0(0%)	0(0%)	2(100%)	2(100%)
LVFX	0(0%)	0(0%)	3(100%)	3(100%)
PZFX	0(0%)	0(0%)	2(100%)	2(100%)
MFLX	0(0%)	0(0%)	1(100%)	1(100%)
GRNX	0(0%)	0(0%)	2(100%)	2(100%)

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2018/05/01~2018/05/31	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ



指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2018/05/01~2018/05/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

薬剤	S	I	R	合計
PCG	0(0%)	0(0%)	51(100%)	51(100%)
MPIP	0(0%)	0(0%)	49(100%)	49(100%)
ABPC	0(0%)	0(0%)	12(100%)	12(100%)
AMPC	0(0%)	0(0%)	29(100%)	29(100%)
PIP	0(0%)	0(0%)	47(100%)	47(100%)
CEZ	0(0%)	0(0%)	80(100%)	80(100%)
CTM	0(0%)	0(0%)	70(100%)	70(100%)
CTX	0(0%)	0(0%)	55(100%)	55(100%)
CZX	0(0%)	0(0%)	1(100%)	1(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
GAZ	0(0%)	0(0%)	34(100%)	34(100%)
CTRX	0(0%)	0(0%)	46(100%)	46(100%)
CPR	0(0%)	0(0%)	4(100%)	4(100%)
CFPM	0(0%)	0(0%)	80(100%)	80(100%)
CZOP	0(0%)	0(0%)	26(100%)	26(100%)
CMZ	0(0%)	0(0%)	61(100%)	61(100%)
CEX	0(0%)	0(0%)	5(100%)	5(100%)
CCL	0(0%)	0(0%)	18(100%)	18(100%)
CFDN	0(0%)	0(0%)	17(100%)	17(100%)
CPDX-PR	0(0%)	0(0%)	6(100%)	6(100%)
CFM-PI	0(0%)	0(0%)	5(100%)	5(100%)
CDTR-PI	0(0%)	0(0%)	13(100%)	13(100%)
CFPN-PI	0(0%)	0(0%)	26(100%)	26(100%)
FMOX	0(0%)	0(0%)	49(100%)	49(100%)
IPM/CS	0(0%)	0(0%)	72(100%)	72(100%)
PAPM/BP	0(0%)	0(0%)	3(100%)	3(100%)
MEPM	0(0%)	0(0%)	40(100%)	40(100%)
FRPM	0(0%)	0(0%)	16(100%)	16(100%)
BIPM	0(0%)	0(0%)	6(100%)	6(100%)
DRPM	0(0%)	0(0%)	25(100%)	25(100%)
TBPM-PI	0(0%)	0(0%)	4(100%)	4(100%)
CVA/AMPC	0(0%)	0(0%)	9(100%)	9(100%)
SBT/ABPC	0(0%)	0(0%)	85(100%)	85(100%)
SBT/CPZ	0(0%)	0(0%)	87(100%)	87(100%)
TAZ/PIPC	0(0%)	0(0%)	28(100%)	28(100%)
SM	6(60.0%)	0(0%)	4(40.0%)	10(100%)
KM	1(16.7%)	1(16.7%)	4(66.7%)	6(100%)
GM	11(31.4%)	1(2.9%)	23(65.7%)	35(100%)
DKB	0(0%)	0(0%)	1(100%)	1(100%)
TOB	2(40.0%)	0(0%)	3(60.0%)	5(100%)
AMK	15(55.6%)	8(29.6%)	4(14.8%)	27(100%)
ISP	4(50.0%)	1(12.5%)	3(37.5%)	8(100%)
ABK	58(100%)	0(0%)	0(0%)	58(100%)
EM	2(11.8%)	1(5.9%)	14(82.4%)	17(100%)
CAM	3(7.5%)	2(5.0%)	35(87.5%)	40(100%)
AZM	2(10.0%)	0(0%)	18(90.0%)	20(100%)
CLDM	21(23.6%)	3(3.4%)	65(73.0%)	89(100%)
TC	1(100%)	0(0%)	0(0%)	1(100%)
CP	31(31.0%)	8(8.0%)	61(61.0%)	100(100%)
CL	0(0%)	0(0%)	1(100%)	1(100%)
PL-B	0(0%)	0(0%)	7(100%)	7(100%)
VCM	97(100%)	0(0%)	0(0%)	97(100%)
TEIC	76(100%)	0(0%)	0(0%)	76(100%)
LZD	60(100%)	0(0%)	0(0%)	60(100%)
DAP	2(100%)	0(0%)	0(0%)	2(100%)
FOM	12(41.4%)	4(13.8%)	13(44.8%)	29(100%)
NFLX	2(40.0%)	0(0%)	3(60.0%)	5(100%)
OFLX	2(40.0%)	0(0%)	3(60.0%)	5(100%)
CPFX	0(0%)	1(5.6%)	17(94.4%)	18(100%)
LFX	3(60.0%)	0(0%)	2(40.0%)	5(100%)
TFLX	1(9.1%)	0(0%)	10(90.9%)	11(100%)
LVFX	6(5.9%)	1(1.0%)	95(93.1%)	102(100%)
PZFX	1(4.3%)	0(0%)	22(95.7%)	23(100%)
GFLX	1(33.3%)	0(0%)	2(66.7%)	3(100%)
MFLX	1(12.5%)	0(0%)	7(87.5%)	8(100%)
GRNX	3(8.8%)	0(0%)	31(91.2%)	34(100%)
STFX	2(20.0%)	0(0%)	8(80.0%)	10(100%)
ST	22(91.7%)	0(0%)	2(8.3%)	24(100%)


指定感染菌 薬剤感受性状況

印刷日 : 2018/06/25 14:33:22

抽出条件

受付日	菌	医療機関
2018/05/01~2018/05/31	S.pneumoniae (PRSP)	

指定感染菌 検出推移グラフ

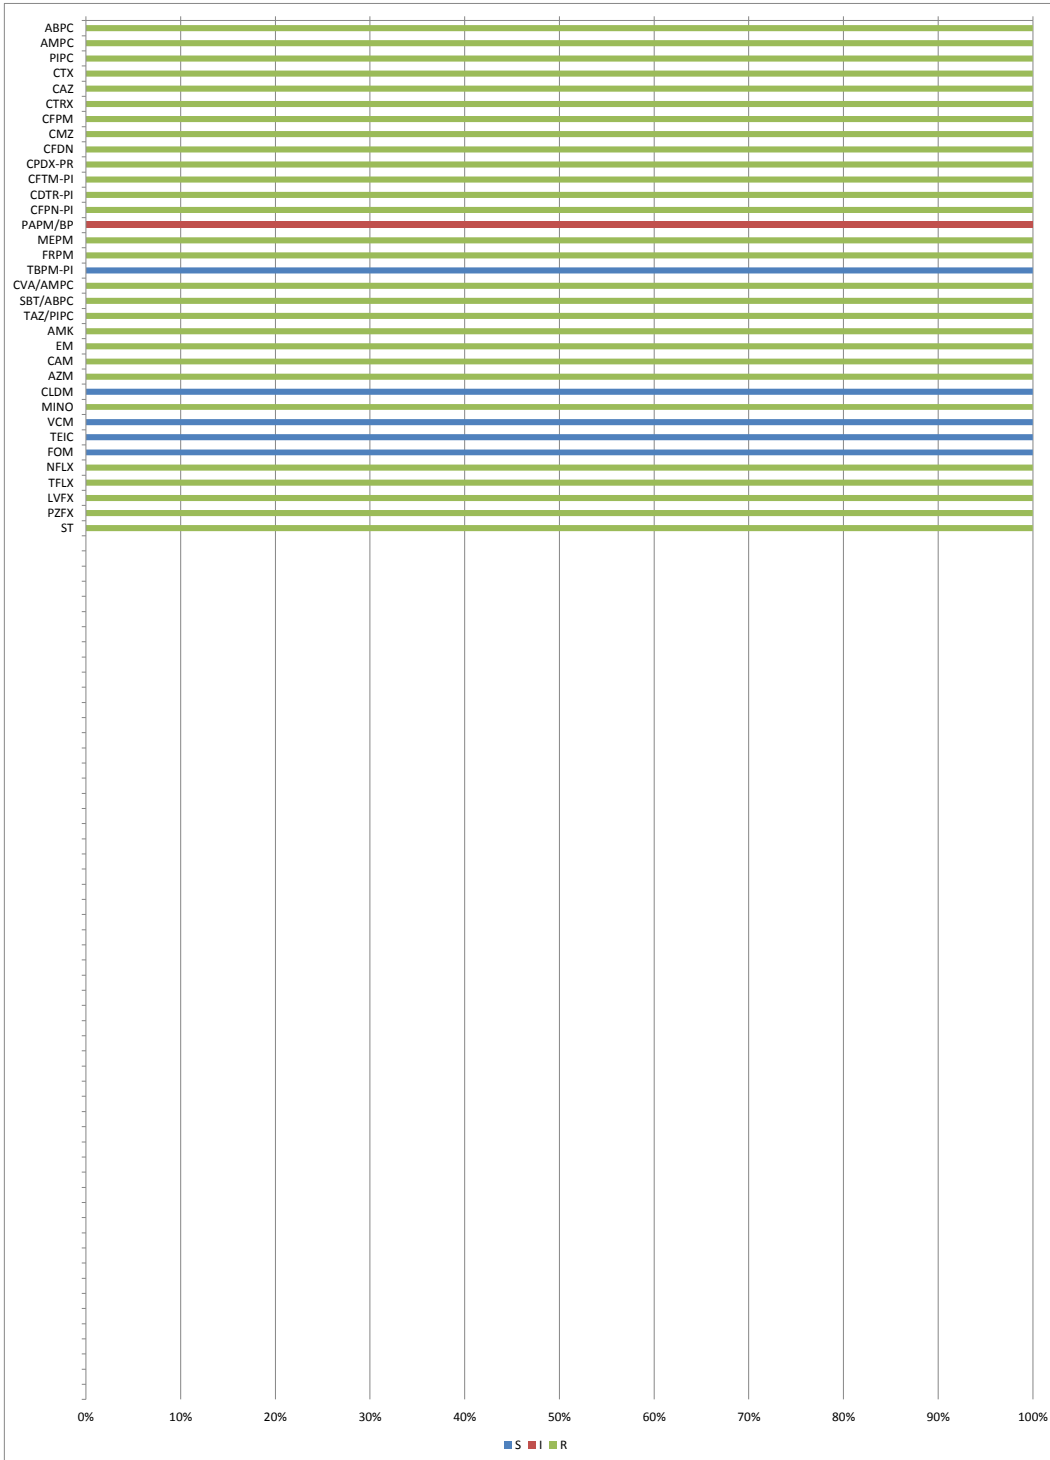

指定感染菌 薬剤感受性状況

受付日	菌
2018/05/01~2018/05/31	S.pneumoniae (PRSP)

指定感染菌 薬剤感受性状況表

薬剤	S	I	R	合計
ABPC	0(0%)	0(0%)	1(100%)	1(100%)
AMPC	0(0%)	0(0%)	1(100%)	1(100%)
PIPC	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	1(100%)	1(100%)
CAZ	0(0%)	0(0%)	1(100%)	1(100%)
CTRX	0(0%)	0(0%)	1(100%)	1(100%)
CFPM	0(0%)	0(0%)	1(100%)	1(100%)
CMZ	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	1(100%)	1(100%)
CPDX-PR	0(0%)	0(0%)	1(100%)	1(100%)
CFTM-PI	0(0%)	0(0%)	1(100%)	1(100%)
CDTR-PI	0(0%)	0(0%)	1(100%)	1(100%)
CFPN-PI	0(0%)	0(0%)	1(100%)	1(100%)
PAPM/BP	0(0%)	1(100%)	0(0%)	1(100%)
MEPM	0(0%)	0(0%)	1(100%)	1(100%)
FRPM	0(0%)	0(0%)	1(100%)	1(100%)
TBPM-PI	1(100%)	0(0%)	0(0%)	1(100%)
CVA/AMPC	0(0%)	0(0%)	1(100%)	1(100%)
SBT/ABPC	0(0%)	0(0%)	1(100%)	1(100%)
TAZ/PIPC	0(0%)	0(0%)	1(100%)	1(100%)
AMK	0(0%)	0(0%)	1(100%)	1(100%)
EM	0(0%)	0(0%)	1(100%)	1(100%)
CAM	0(0%)	0(0%)	1(100%)	1(100%)
AZM	0(0%)	0(0%)	1(100%)	1(100%)
CLDM	1(100%)	0(0%)	0(0%)	1(100%)
MINO	0(0%)	0(0%)	1(100%)	1(100%)
VCM	1(100%)	0(0%)	0(0%)	1(100%)
TEIC	1(100%)	0(0%)	0(0%)	1(100%)
FOM	1(100%)	0(0%)	0(0%)	1(100%)
NFLX	0(0%)	0(0%)	1(100%)	1(100%)
TFLX	0(0%)	0(0%)	1(100%)	1(100%)
LVFX	0(0%)	0(0%)	1(100%)	1(100%)
PZFX	0(0%)	0(0%)	1(100%)	1(100%)
ST	0(0%)	0(0%)	1(100%)	1(100%)