




指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2018/10/01~2018/10/31	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

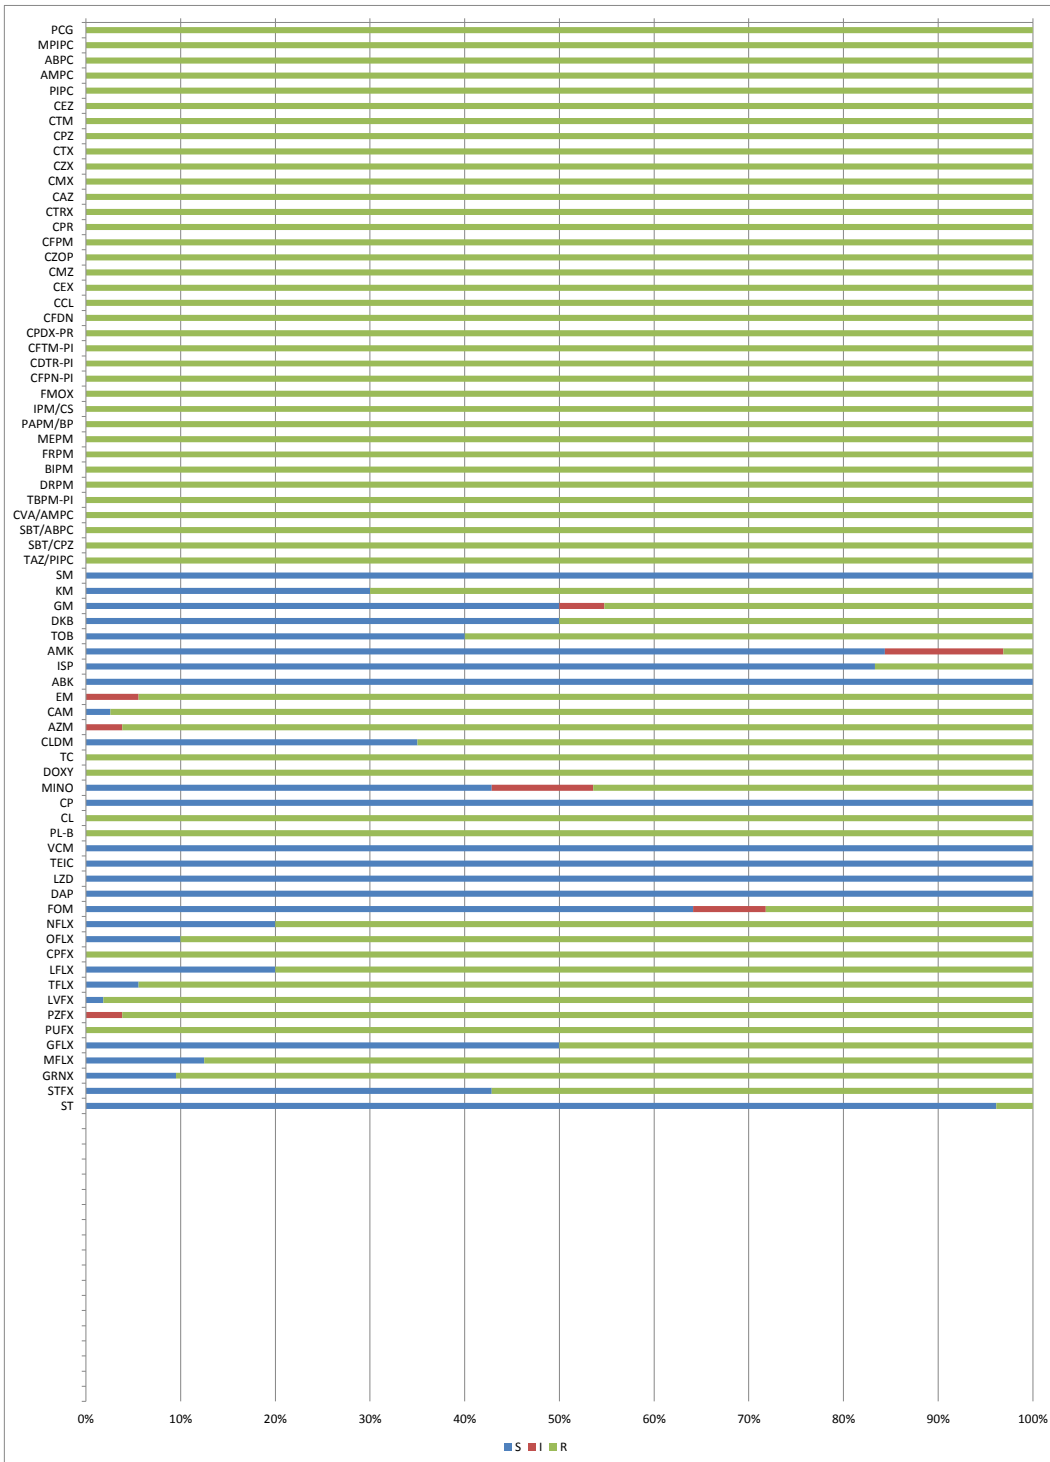

指定感染菌 薬剤感受性状況

受付日	菌
2018/10/01~2018/10/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

薬剤	S	I	R	合計
PCG	0(0%)	0(0%)	55(100%)	55(100%)
MPIP	0(0%)	0(0%)	55(100%)	55(100%)
ABPC	0(0%)	0(0%)	29(100%)	29(100%)
AMPC	0(0%)	0(0%)	25(100%)	25(100%)
PIP	0(0%)	0(0%)	53(100%)	53(100%)
CEZ	0(0%)	0(0%)	94(100%)	94(100%)
CTM	0(0%)	0(0%)	79(100%)	79(100%)
CPZ	0(0%)	0(0%)	2(100%)	2(100%)
CTX	0(0%)	0(0%)	57(100%)	57(100%)
CZX	0(0%)	0(0%)	2(100%)	2(100%)
CMX	0(0%)	0(0%)	5(100%)	5(100%)
GAZ	0(0%)	0(0%)	38(100%)	38(100%)
CTR	0(0%)	0(0%)	51(100%)	51(100%)
CPR	0(0%)	0(0%)	7(100%)	7(100%)
CFPM	0(0%)	0(0%)	86(100%)	86(100%)
CZOP	0(0%)	0(0%)	28(100%)	28(100%)
CMZ	0(0%)	0(0%)	74(100%)	74(100%)
CEX	0(0%)	0(0%)	3(100%)	3(100%)
CCL	0(0%)	0(0%)	14(100%)	14(100%)
CFDN	0(0%)	0(0%)	19(100%)	19(100%)
CPDX-PR	0(0%)	0(0%)	6(100%)	6(100%)
CFTM-PI	0(0%)	0(0%)	7(100%)	7(100%)
CDTR-PI	0(0%)	0(0%)	12(100%)	12(100%)
CFPN-PI	0(0%)	0(0%)	32(100%)	32(100%)
FMOX	0(0%)	0(0%)	56(100%)	56(100%)
IPM/CS	0(0%)	0(0%)	83(100%)	83(100%)
PAPM/BP	0(0%)	0(0%)	4(100%)	4(100%)
MEPM	0(0%)	0(0%)	47(100%)	47(100%)
FRPM	0(0%)	0(0%)	8(100%)	8(100%)
BIPM	0(0%)	0(0%)	12(100%)	12(100%)
DRPM	0(0%)	0(0%)	29(100%)	29(100%)
TBPM-PI	0(0%)	0(0%)	4(100%)	4(100%)
CVA/AMPC	0(0%)	0(0%)	12(100%)	12(100%)
SBT/ABPC	0(0%)	0(0%)	89(100%)	89(100%)
SBT/CPZ	0(0%)	0(0%)	99(100%)	99(100%)
TAZ/PIP	0(0%)	0(0%)	43(100%)	43(100%)
SM	5(100%)	0(0%)	0(0%)	5(100%)
KM	3(30.0%)	0(0%)	7(70.0%)	10(100%)
GM	21(50.0%)	2(4.8%)	19(45.2%)	42(100%)
DKB	2(50.0%)	0(0%)	2(50.0%)	4(100%)
TOB	2(40.0%)	0(0%)	3(60.0%)	5(100%)
AMK	27(84.4%)	4(12.5%)	1(3.1%)	32(100%)
ISP	5(83.3%)	0(0%)	1(16.7%)	6(100%)
ABK	64(100%)	0(0%)	0(0%)	64(100%)
EM	0(0%)	1(5.6%)	17(94.4%)	18(100%)
CAM	1(2.6%)	0(0%)	38(97.4%)	39(100%)
AZM	0(0%)	1(3.8%)	25(96.2%)	26(100%)
CLDM	35(35.0%)	0(0%)	65(65.0%)	100(100%)
DOXY	0(0%)	0(0%)	1(100%)	1(100%)
MINO	48(42.9%)	12(10.7%)	52(46.4%)	112(100%)
CP	1(100%)	0(0%)	0(0%)	1(100%)
CL	0(0%)	0(0%)	1(100%)	1(100%)
PL-B	0(0%)	0(0%)	11(100%)	11(100%)
VCM	106(100%)	0(0%)	0(0%)	106(100%)
TEIC	89(100%)	0(0%)	0(0%)	89(100%)
LZD	70(100%)	0(0%)	0(0%)	70(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	25(64.1%)	3(7.7%)	11(28.2%)	39(100%)
NFLX	1(20.0%)	0(0%)	4(80.0%)	5(100%)
OFLX	1(10.0%)	0(0%)	9(90.0%)	10(100%)
CPFX	0(0%)	0(0%)	20(100%)	20(100%)
LFLX	1(20.0%)	0(0%)	4(80.0%)	5(100%)
TLFX	1(5.8%)	0(0%)	17(94.4%)	18(100%)
LVFX	2(1.8%)	0(0%)	108(98.2%)	110(100%)
PZFX	0(0%)	1(3.8%)	25(96.2%)	26(100%)
PUFX	0(0%)	0(0%)	2(100%)	2(100%)
GFLX	1(50.0%)	0(0%)	1(50.0%)	2(100%)
MFLX	1(12.5%)	0(0%)	7(87.5%)	8(100%)
GRNX	4(9.5%)	0(0%)	38(90.5%)	42(100%)
STFX	3(42.9%)	0(0%)	4(57.1%)	7(100%)
ST	25(96.2%)	0(0%)	1(3.8%)	26(100%)