


指定感染菌 薬剤感受性状況

抽出条件	菌	医療機関
受付日 2021/04/01~2021/04/30	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

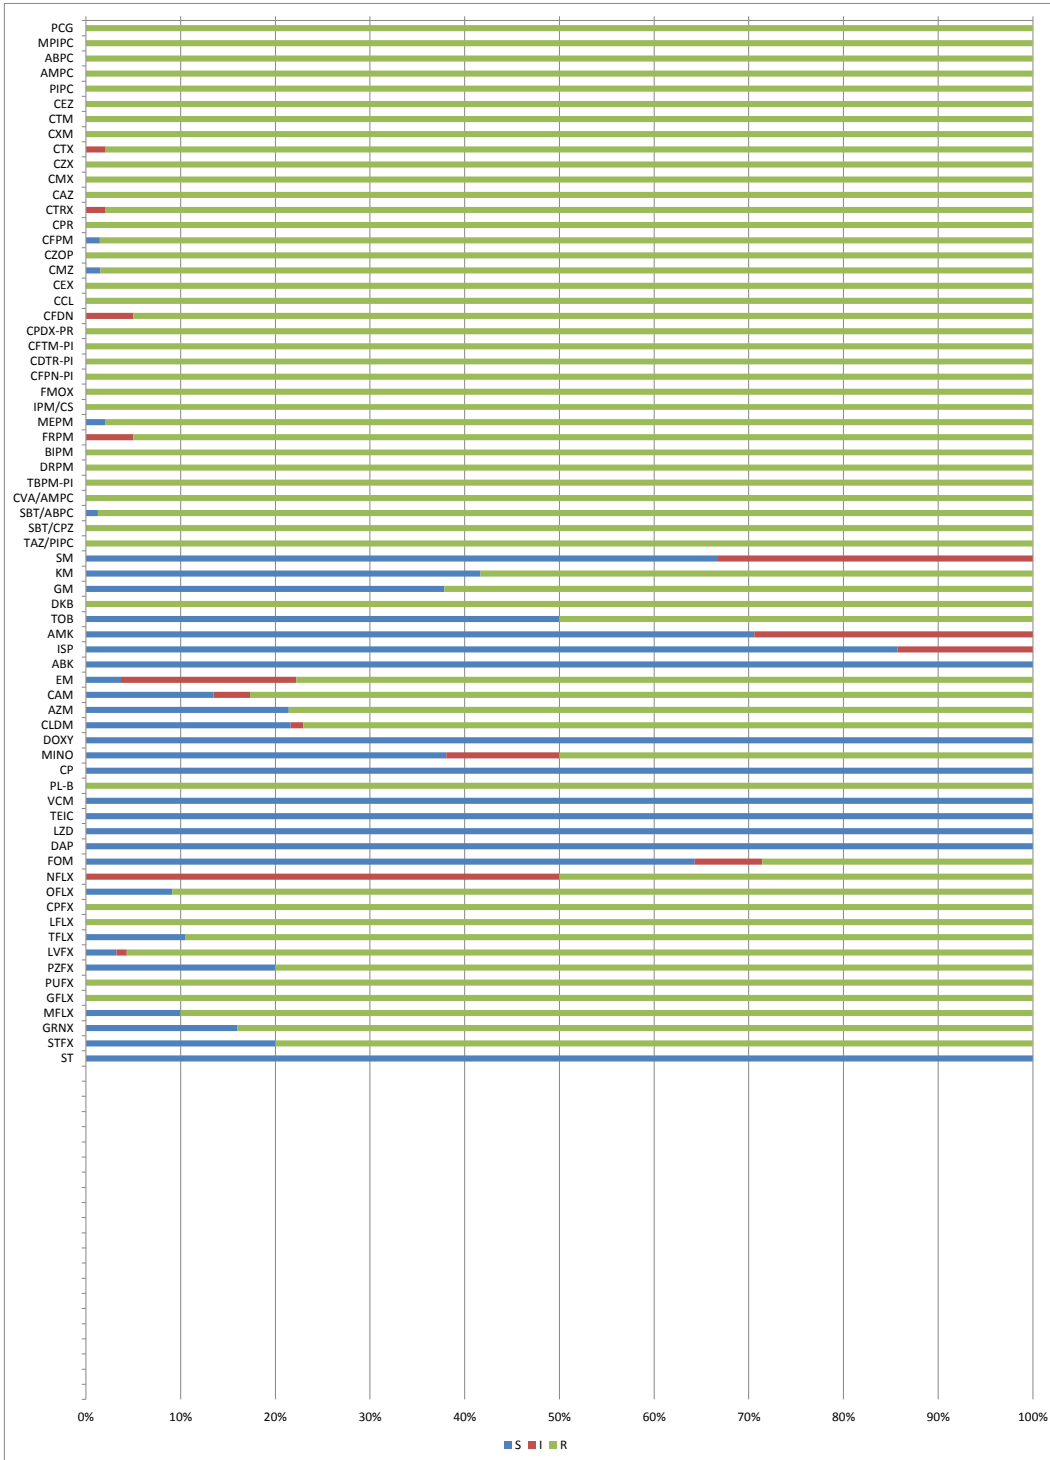

指定感染菌 薬剤感受性状況

受付日	菌
2021/04/01~2021/04/30	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	41(100%)	41(100%)
MPIP	0(0%)	0(0%)	42(100%)	42(100%)
ABPC	0(0%)	0(0%)	24(100%)	24(100%)
AMPC	0(0%)	0(0%)	29(100%)	29(100%)
PIP	0(0%)	0(0%)	48(100%)	48(100%)
CEZ	0(0%)	0(0%)	64(100%)	64(100%)
CTM	0(0%)	0(0%)	63(100%)	63(100%)
CXM	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	1(2.1%)	47(97.9%)	48(100%)
CZX	0(0%)	0(0%)	4(100%)	4(100%)
CMX	0(0%)	0(0%)	4(100%)	4(100%)
GAZ	0(0%)	0(0%)	35(100%)	35(100%)
CTR	0(0%)	1(2.1%)	47(97.9%)	48(100%)
CPR	0(0%)	0(0%)	7(100%)	7(100%)
CFPM	1(1.5%)	0(0%)	67(98.5%)	68(100%)
CZOP	0(0%)	0(0%)	13(100%)	13(100%)
CMZ	1(1.5%)	0(0%)	64(98.5%)	65(100%)
CEX	0(0%)	0(0%)	7(100%)	7(100%)
CCL	0(0%)	0(0%)	25(100%)	25(100%)
CFDN	0(0%)	1(5.0%)	19(95.0%)	20(100%)
CPDX-PR	0(0%)	0(0%)	15(100%)	15(100%)
CFTM-PI	0(0%)	0(0%)	5(100%)	5(100%)
CDTR-PI	0(0%)	0(0%)	11(100%)	11(100%)
CFPN-PI	0(0%)	0(0%)	32(100%)	32(100%)
FMOX	0(0%)	0(0%)	40(100%)	40(100%)
IPM/CS	0(0%)	0(0%)	63(100%)	63(100%)
MEPM	1(2.1%)	0(0%)	47(97.9%)	48(100%)
FRPM	0(0%)	1(5.0%)	19(95.0%)	20(100%)
BIPM	0(0%)	0(0%)	7(100%)	7(100%)
DRPM	0(0%)	0(0%)	13(100%)	13(100%)
TBPM-PI	0(0%)	0(0%)	2(100%)	2(100%)
CVA/AMPC	0(0%)	0(0%)	9(100%)	9(100%)
SBT/ABPC	1(1.3%)	0(0%)	78(98.7%)	79(100%)
SBT/CPZ	0(0%)	0(0%)	80(100%)	80(100%)
TAZ/PIP	0(0%)	0(0%)	34(100%)	34(100%)
SM	10(66.7%)	5(33.3%)	0(0%)	15(100%)
KM	5(41.7%)	0(0%)	7(58.3%)	12(100%)
GM	14(37.8%)	0(0%)	23(62.2%)	37(100%)
DKB	0(0%)	0(0%)	2(100%)	2(100%)
TOB	2(50.0%)	0(0%)	2(50.0%)	4(100%)
AMK	24(70.6%)	10(29.4%)	0(0%)	34(100%)
ISP	6(85.7%)	1(14.3%)	0(0%)	7(100%)
ABK	52(100%)	0(0%)	0(0%)	52(100%)
EM	1(3.7%)	5(18.5%)	21(77.8%)	27(100%)
CAM	7(13.5%)	2(3.8%)	43(82.7%)	52(100%)
AZM	6(21.4%)	0(0%)	22(78.6%)	28(100%)
CLDM	16(21.6%)	1(1.4%)	57(77.0%)	74(100%)
DOXY	1(100%)	0(0%)	0(0%)	1(100%)
MINO	35(38.0%)	11(12.0%)	46(50.0%)	92(100%)
CP	3(100%)	0(0%)	0(0%)	3(100%)
PL-B	0(0%)	0(0%)	14(100%)	14(100%)
VCM	90(100%)	0(0%)	0(0%)	90(100%)
TEIC	64(100%)	0(0%)	0(0%)	64(100%)
LZD	51(100%)	0(0%)	0(0%)	51(100%)
DAP	2(100%)	0(0%)	0(0%)	2(100%)
FOM	27(64.3%)	3(7.1%)	12(28.6%)	42(100%)
NFLX	0(0%)	1(50.0%)	1(50.0%)	2(100%)
OFLX	1(9.1%)	0(0%)	10(90.9%)	11(100%)
CPFX	0(0%)	0(0%)	30(100%)	30(100%)
LFLEX	0(0%)	0(0%)	1(100%)	1(100%)
TFLX	2(10.5%)	0(0%)	17(89.5%)	19(100%)
LVFX	3(3.2%)	1(1.1%)	89(95.7%)	93(100%)
PZFX	2(20.0%)	0(0%)	8(80.0%)	10(100%)
PUFX	0(0%)	0(0%)	1(100%)	1(100%)
GFLX	0(0%)	0(0%)	1(100%)	1(100%)
MFLX	1(10.0%)	0(0%)	9(90.0%)	10(100%)
GRNX	4(16.0%)	0(0%)	21(84.0%)	25(100%)
STFX	2(20.0%)	0(0%)	8(80.0%)	10(100%)
ST	40(100%)	0(0%)	0(0%)	40(100%)