


指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2021/09/01~2021/09/30	S.aureus (MRSA)
	医療機関

指定感染菌 検出推移グラフ

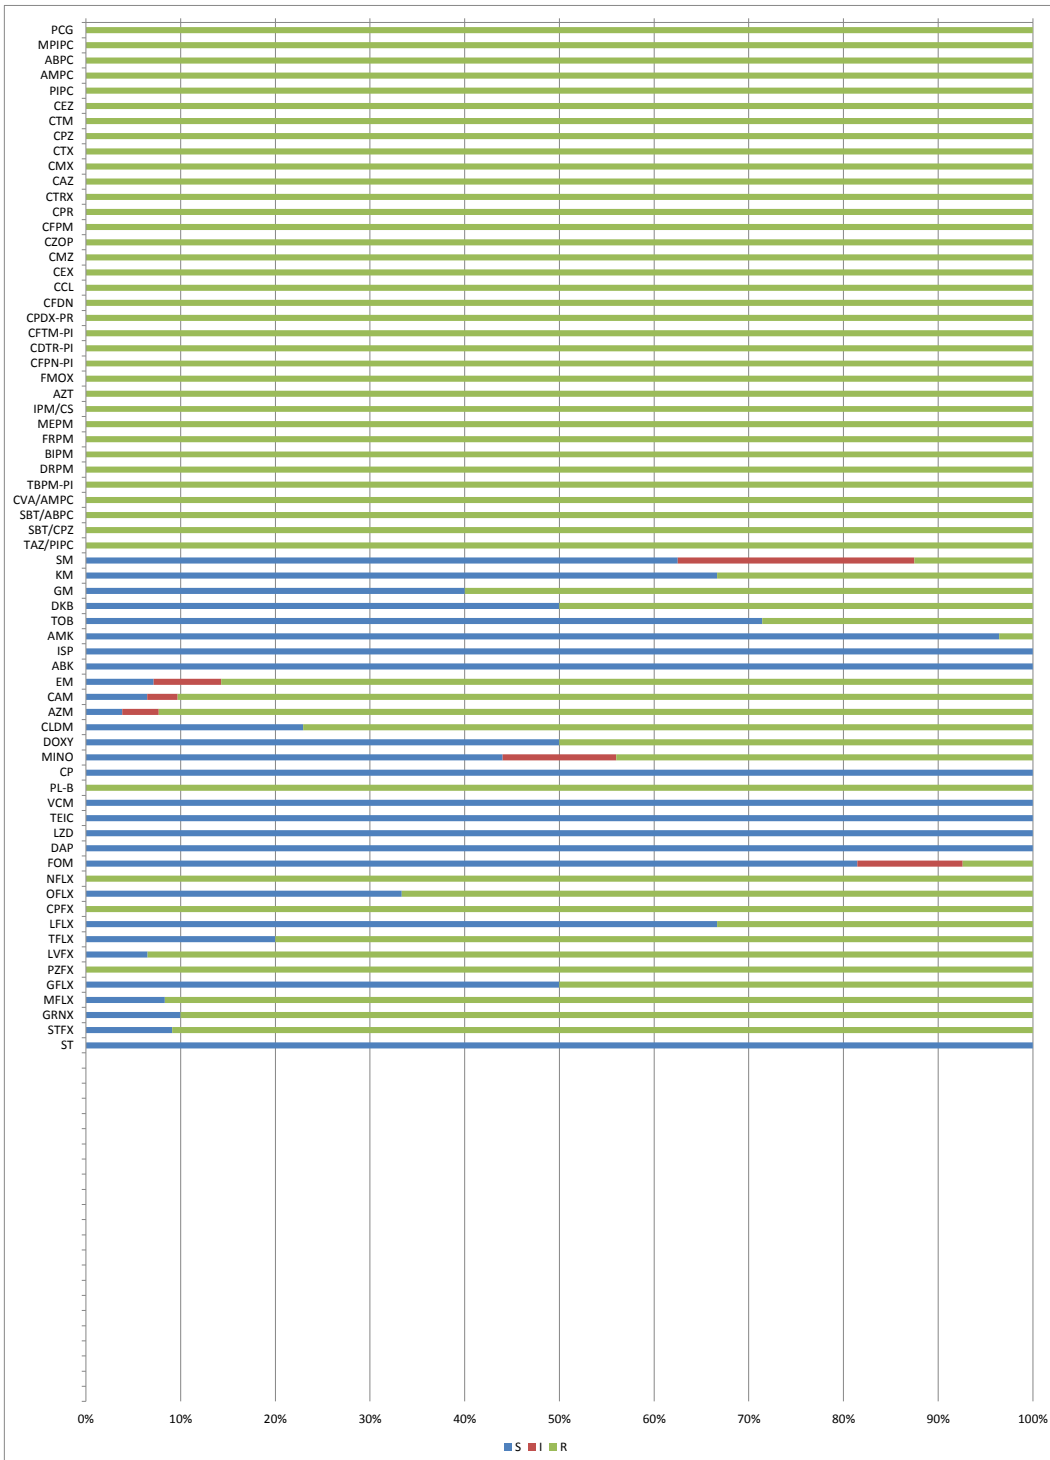

指定感染菌 薬剤感受性状況

抽出条件	
受付日	菌
2021/09/01~2021/09/30	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

薬剤	S (%)	I (%)	R (%)	合計
PCG	0(0%)	0(0%)	33(100%)	33(100%)
MPIP	0(0%)	0(0%)	35(100%)	35(100%)
ABPC	0(0%)	0(0%)	14(100%)	14(100%)
AMPC	0(0%)	0(0%)	24(100%)	24(100%)
PIP	0(0%)	0(0%)	42(100%)	42(100%)
CEZ	0(0%)	0(0%)	57(100%)	57(100%)
CTM	0(0%)	0(0%)	48(100%)	48(100%)
CPZ	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	41(100%)	41(100%)
CMX	0(0%)	0(0%)	5(100%)	5(100%)
CAZ	0(0%)	0(0%)	31(100%)	31(100%)
CTRX	0(0%)	0(0%)	42(100%)	42(100%)
CPR	0(0%)	0(0%)	2(100%)	2(100%)
CFPM	0(0%)	0(0%)	52(100%)	52(100%)
CZOP	0(0%)	0(0%)	19(100%)	19(100%)
CMZ	0(0%)	0(0%)	56(100%)	56(100%)
CEX	0(0%)	0(0%)	2(100%)	2(100%)
CCL	0(0%)	0(0%)	16(100%)	16(100%)
CFDN	0(0%)	0(0%)	13(100%)	13(100%)
CPDX-PR	0(0%)	0(0%)	9(100%)	9(100%)
CFPM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CDTR-PI	0(0%)	0(0%)	6(100%)	6(100%)
CFPN-PI	0(0%)	0(0%)	20(100%)	20(100%)
FMOX	0(0%)	0(0%)	41(100%)	41(100%)
AZT	0(0%)	0(0%)	6(100%)	6(100%)
IPM/CS	0(0%)	0(0%)	57(100%)	57(100%)
MEPM	0(0%)	0(0%)	38(100%)	38(100%)
FRPM	0(0%)	0(0%)	12(100%)	12(100%)
BIPM	0(0%)	0(0%)	5(100%)	5(100%)
DRPM	0(0%)	0(0%)	13(100%)	13(100%)
TBPM-PI	0(0%)	0(0%)	2(100%)	2(100%)
CVA/AMPC	0(0%)	0(0%)	14(100%)	14(100%)
SBT/ABPC	0(0%)	0(0%)	67(100%)	67(100%)
SBT/CPZ	0(0%)	0(0%)	64(100%)	64(100%)
TAZ/PIPC	0(0%)	0(0%)	29(100%)	29(100%)
SM	5(62.5%)	2(25.0%)	1(12.5%)	8(100%)
KM	4(66.7%)	0(0%)	2(33.3%)	6(100%)
GM	12(40.0%)	0(0%)	18(60.0%)	30(100%)
DKB	1(50.0%)	0(0%)	1(50.0%)	2(100%)
TOB	5(71.4%)	0(0%)	2(28.6%)	7(100%)
AMK	27(96.4%)	0(0%)	1(3.6%)	28(100%)
ISP	2(100%)	0(0%)	0(0%)	2(100%)
ABK	39(100%)	0(0%)	0(0%)	39(100%)
EM	1(7.1%)	1(7.1%)	12(85.7%)	14(100%)
CAM	2(6.5%)	1(3.2%)	28(90.3%)	31(100%)
AZM	1(3.8%)	1(3.8%)	24(92.3%)	26(100%)
CLDM	14(23.0%)	0(0%)	47(77.0%)	61(100%)
DOXY	1(50.0%)	0(0%)	1(50.0%)	2(100%)
MINO	33(44.0%)	9(12.0%)	33(44.0%)	75(100%)
CP	3(100%)	0(0%)	0(0%)	3(100%)
PL-B	0(0%)	0(0%)	6(100%)	6(100%)
VCM	74(100%)	0(0%)	0(0%)	74(100%)
TEIC	56(100%)	0(0%)	0(0%)	56(100%)
LZD	56(100%)	0(0%)	0(0%)	56(100%)
DAP	3(100%)	0(0%)	0(0%)	3(100%)
FOM	22(81.5%)	3(11.1%)	2(7.4%)	27(100%)
NFLX	0(0%)	0(0%)	1(100%)	1(100%)
OFLX	2(33.3%)	0(0%)	4(66.7%)	6(100%)
CPFX	0(0%)	0(0%)	25(100%)	25(100%)
LFLEX	2(66.7%)	0(0%)	1(33.3%)	3(100%)
TFLX	2(20.0%)	0(0%)	8(80.0%)	10(100%)
LVFX	5(6.5%)	0(0%)	72(93.5%)	77(100%)
PZFX	0(0%)	0(0%)	2(100%)	2(100%)
GFLX	1(50.0%)	0(0%)	1(50.0%)	2(100%)
MFLX	1(8.3%)	0(0%)	11(91.7%)	12(100%)
GRNX	3(10.0%)	0(0%)	27(90.0%)	30(100%)
STFX	1(9.1%)	0(0%)	10(90.9%)	11(100%)
ST	35(100%)	0(0%)	0(0%)	35(100%)