


指定感染菌 薬剤感受性状況

抽出条件	菌	医療機関
2022/01/01~2022/01/31	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

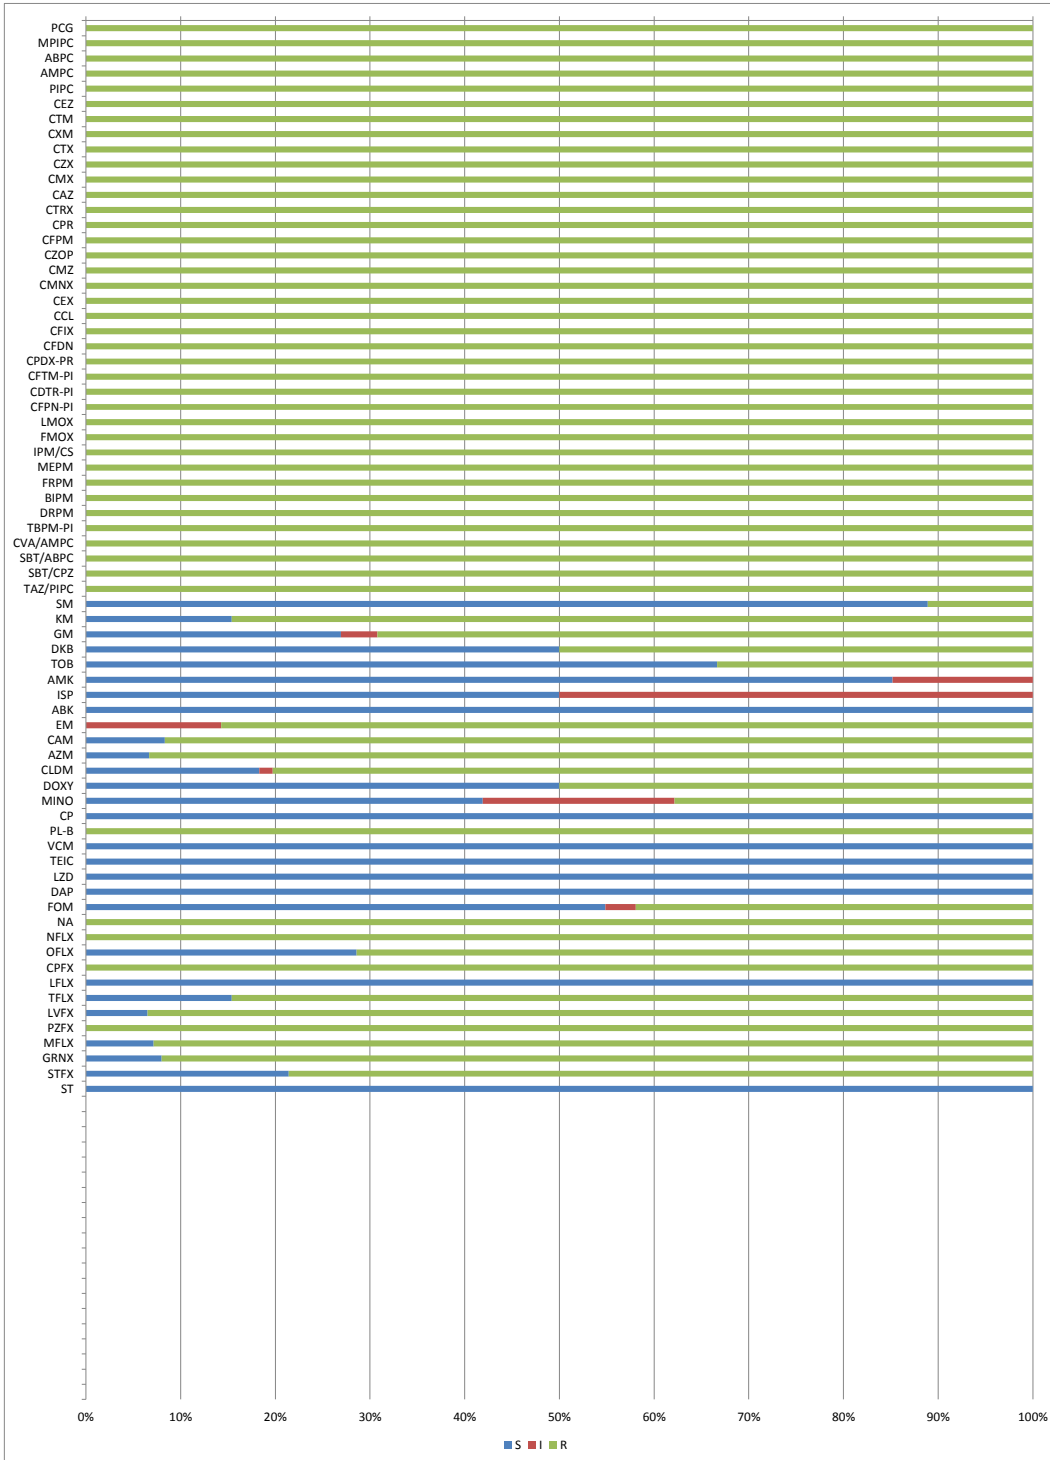

指定感染菌 薬剤感受性状況

抽出条件	菌
2022/01/01~2022/01/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

指定感染菌	S	I	R	合計
PCG	0(0%)	0(0%)	39(100%)	39(100%)
MPIP	0(0%)	0(0%)	41(100%)	41(100%)
ABPC	0(0%)	0(0%)	13(100%)	13(100%)
AMPC	0(0%)	0(0%)	21(100%)	21(100%)
PIP	0(0%)	0(0%)	35(100%)	35(100%)
CEZ	0(0%)	0(0%)	63(100%)	63(100%)
CTM	0(0%)	0(0%)	58(100%)	58(100%)
CXM	0(0%)	0(0%)	4(100%)	4(100%)
CTX	0(0%)	0(0%)	47(100%)	47(100%)
CZX	0(0%)	0(0%)	1(100%)	1(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
GAZ	0(0%)	0(0%)	19(100%)	19(100%)
CTR	0(0%)	0(0%)	38(100%)	38(100%)
CPR	0(0%)	0(0%)	1(100%)	1(100%)
CFPM	0(0%)	0(0%)	59(100%)	59(100%)
CZOP	0(0%)	0(0%)	17(100%)	17(100%)
CMZ	0(0%)	0(0%)	66(100%)	66(100%)
CMNX	0(0%)	0(0%)	1(100%)	1(100%)
CEX	0(0%)	0(0%)	11(100%)	11(100%)
CCL	0(0%)	0(0%)	15(100%)	15(100%)
CFIX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	8(100%)	8(100%)
CPDX-PR	0(0%)	0(0%)	12(100%)	12(100%)
CFTM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CDTR-PI	0(0%)	0(0%)	6(100%)	6(100%)
CFPN-PI	0(0%)	0(0%)	27(100%)	27(100%)
LMOX	0(0%)	0(0%)	1(100%)	1(100%)
FMOX	0(0%)	0(0%)	41(100%)	41(100%)
IPM/CS	0(0%)	0(0%)	64(100%)	64(100%)
MEPM	0(0%)	0(0%)	33(100%)	33(100%)
FRPM	0(0%)	0(0%)	11(100%)	11(100%)
BIPM	0(0%)	0(0%)	7(100%)	7(100%)
DRPM	0(0%)	0(0%)	12(100%)	12(100%)
TBPM-PI	0(0%)	0(0%)	2(100%)	2(100%)
GVA/AMPC	0(0%)	0(0%)	11(100%)	11(100%)
SBT/ABPC	0(0%)	0(0%)	72(100%)	72(100%)
SBT/CPZ	0(0%)	0(0%)	69(100%)	69(100%)
TAZ/PIP	0(0%)	0(0%)	32(100%)	32(100%)
SM	8(88.9%)	0(0%)	1(11.1%)	9(100%)
KM	2(15.4%)	0(0%)	11(84.6%)	13(100%)
GM	7(26.9%)	1(3.8%)	18(69.2%)	26(100%)
DKB	1(50.0%)	0(0%)	1(50.0%)	2(100%)
TOB	2(66.7%)	0(0%)	1(33.3%)	3(100%)
AMK	23(85.2%)	4(14.8%)	0(0%)	27(100%)
ISP	1(50.0%)	1(50.0%)	0(0%)	2(100%)
ABK	52(100%)	0(0%)	0(0%)	52(100%)
EM	0(0%)	2(14.3%)	12(85.7%)	14(100%)
CAM	3(8.3%)	0(0%)	33(91.7%)	36(100%)
AZM	2(6.7%)	0(0%)	28(93.3%)	30(100%)
CLDM	13(18.3%)	1(1.4%)	57(80.3%)	71(100%)
DOXY	2(50.0%)	0(0%)	2(50.0%)	4(100%)
MINO	31(41.9%)	15(20.3%)	28(37.8%)	74(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
PL-B	0(0%)	0(0%)	14(100%)	14(100%)
VCM	72(100%)	0(0%)	0(0%)	72(100%)
TEIC	65(100%)	0(0%)	0(0%)	65(100%)
LZD	56(100%)	0(0%)	0(0%)	56(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	17(54.8%)	1(3.2%)	13(41.9%)	31(100%)
NA	0(0%)	0(0%)	1(100%)	1(100%)
NFLX	0(0%)	0(0%)	1(100%)	1(100%)
OFLX	2(28.6%)	0(0%)	5(71.4%)	7(100%)
CPFX	0(0%)	0(0%)	23(100%)	23(100%)
FLX	1(100%)	0(0%)	0(0%)	1(100%)
TFLX	2(15.4%)	0(0%)	11(84.6%)	13(100%)
LVFX	5(6.5%)	0(0%)	72(93.5%)	77(100%)
PZFX	0(0%)	0(0%)	7(100%)	7(100%)
MFLX	1(7.1%)	0(0%)	13(92.9%)	14(100%)
GRNX	2(8.0%)	0(0%)	23(92.0%)	25(100%)
STFX	3(21.4%)	0(0%)	11(78.6%)	14(100%)
ST	31(100%)	0(0%)	0(0%)	31(100%)