


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2023/07/01~2023/07/31	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

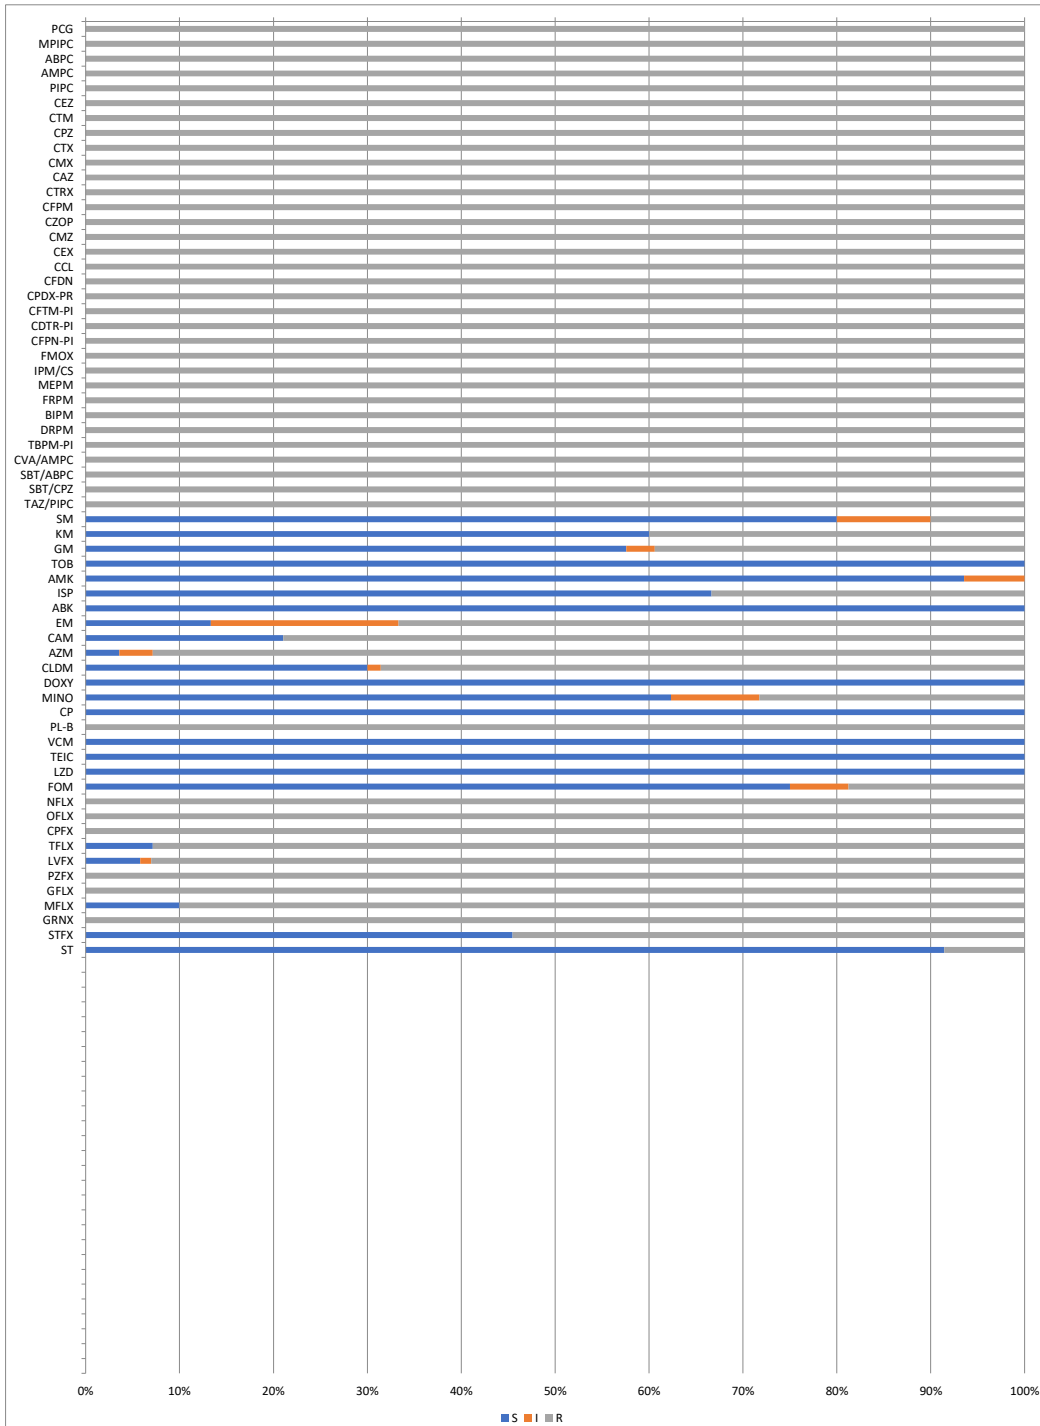

印刷日: 2023/08/30 13:57:05

指定感染菌 薬剤感受性状況

受付日

受付日	菌
2023/07/01~2023/07/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	44(100%)	44(100%)
MPiPC	0(0%)	0(0%)	44(100%)	44(100%)
ABPC	0(0%)	0(0%)	15(100%)	15(100%)
AMPc	0(0%)	0(0%)	24(100%)	24(100%)
PIPC	0(0%)	0(0%)	39(100%)	39(100%)
CEZ	0(0%)	0(0%)	63(100%)	63(100%)
CTM	0(0%)	0(0%)	68(100%)	68(100%)
CPZ	0(0%)	0(0%)	2(100%)	2(100%)
CTX	0(0%)	0(0%)	54(100%)	54(100%)
CMX	0(0%)	0(0%)	2(100%)	2(100%)
CAZ	0(0%)	0(0%)	27(100%)	27(100%)
CTRX	0(0%)	0(0%)	38(100%)	38(100%)
CFPM	0(0%)	0(0%)	64(100%)	64(100%)
CZOP	0(0%)	0(0%)	17(100%)	17(100%)
CMZ	0(0%)	0(0%)	68(100%)	68(100%)
CEX	0(0%)	0(0%)	9(100%)	9(100%)
CCL	0(0%)	0(0%)	16(100%)	16(100%)
CFDN	0(0%)	0(0%)	16(100%)	16(100%)
CPDX-PR	0(0%)	0(0%)	14(100%)	14(100%)
CFTM-PI	0(0%)	0(0%)	2(100%)	2(100%)
CDTR-PI	0(0%)	0(0%)	13(100%)	13(100%)
CFPN-PI	0(0%)	0(0%)	26(100%)	26(100%)
FMOX	0(0%)	0(0%)	46(100%)	46(100%)
IPM/CS	0(0%)	0(0%)	69(100%)	69(100%)
MEPM	0(0%)	0(0%)	35(100%)	35(100%)
FRPM	0(0%)	0(0%)	14(100%)	14(100%)
BiPM	0(0%)	0(0%)	10(100%)	10(100%)
DRPM	0(0%)	0(0%)	15(100%)	15(100%)
TBPM-PI	0(0%)	0(0%)	2(100%)	2(100%)
CVA/AMPc	0(0%)	0(0%)	8(100%)	8(100%)
SBT/ABPC	0(0%)	0(0%)	83(100%)	83(100%)
SBT/CPZ	0(0%)	0(0%)	75(100%)	75(100%)
TAZ/PIPC	0(0%)	0(0%)	33(100%)	33(100%)
SM	8(80.0)	1(10.0)	1(10.0)	10(100)
KM	9(60.0)	0(0)	6(40.0)	15(100)
GM	19(57.6)	1(3.0)	13(39.4)	33(100)
TOB	1(100.0)	0(0)	0(0)	1(100)
AMK	29(93.5)	2(6.5)	0(0)	31(100)
ISP	2(66.7)	0(0)	1(33.3)	3(100)
ABK	61(100.0)	0(0)	0(0)	61(100)
EM	2(13.3)	3(20.0)	10(66.7)	15(100)
CAM	8(21.1)	0(0)	30(78.9)	38(100)
AZM	1(3.6)	1(3.6)	26(92.9)	28(100)
CLDM	21(30.0)	1(1.4)	48(68.6)	70(100)
DOXY	1(100.0)	0(0)	0(0)	1(100)
MINO	53(64.4)	8(9.4)	24(28.2)	85(100)
CP	1(100.0)	0(0)	0(0)	1(100)
PL-B	0(0)	0(0)	17(100)	17(100)
VCM	84(100)	0(0)	0(0)	84(100)
TEC	69(100)	0(0)	0(0)	69(100)
LZD	57(100)	0(0)	0(0)	57(100)
FOM	24(75.0)	2(6.3)	6(18.8)	32(100)
NFLX	0(0)	0(0)	3(100)	3(100)
OFLEX	0(0)	0(0)	2(100)	2(100)
CPFX	0(0)	0(0)	19(100)	19(100)
TLFX	17(1.7)	0(0)	13(92.9)	14(100)
LVFL	5(5.8)	1(1.2)	80(93.0)	86(100)
PZFX	0(0)	0(0)	7(100)	7(100)
GZFX	0(0)	0(0)	1(100)	1(100)
MLFX	1(10.0)	0(0)	9(90.0)	10(100)
GRNX	0(0)	0(0)	18(100)	18(100)
STFX	5(45.5)	0(0)	6(54.5)	11(100)
ST	32(91.4)	0(0)	3(8.6)	35(100)