


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2023/08/01~2023/08/31	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

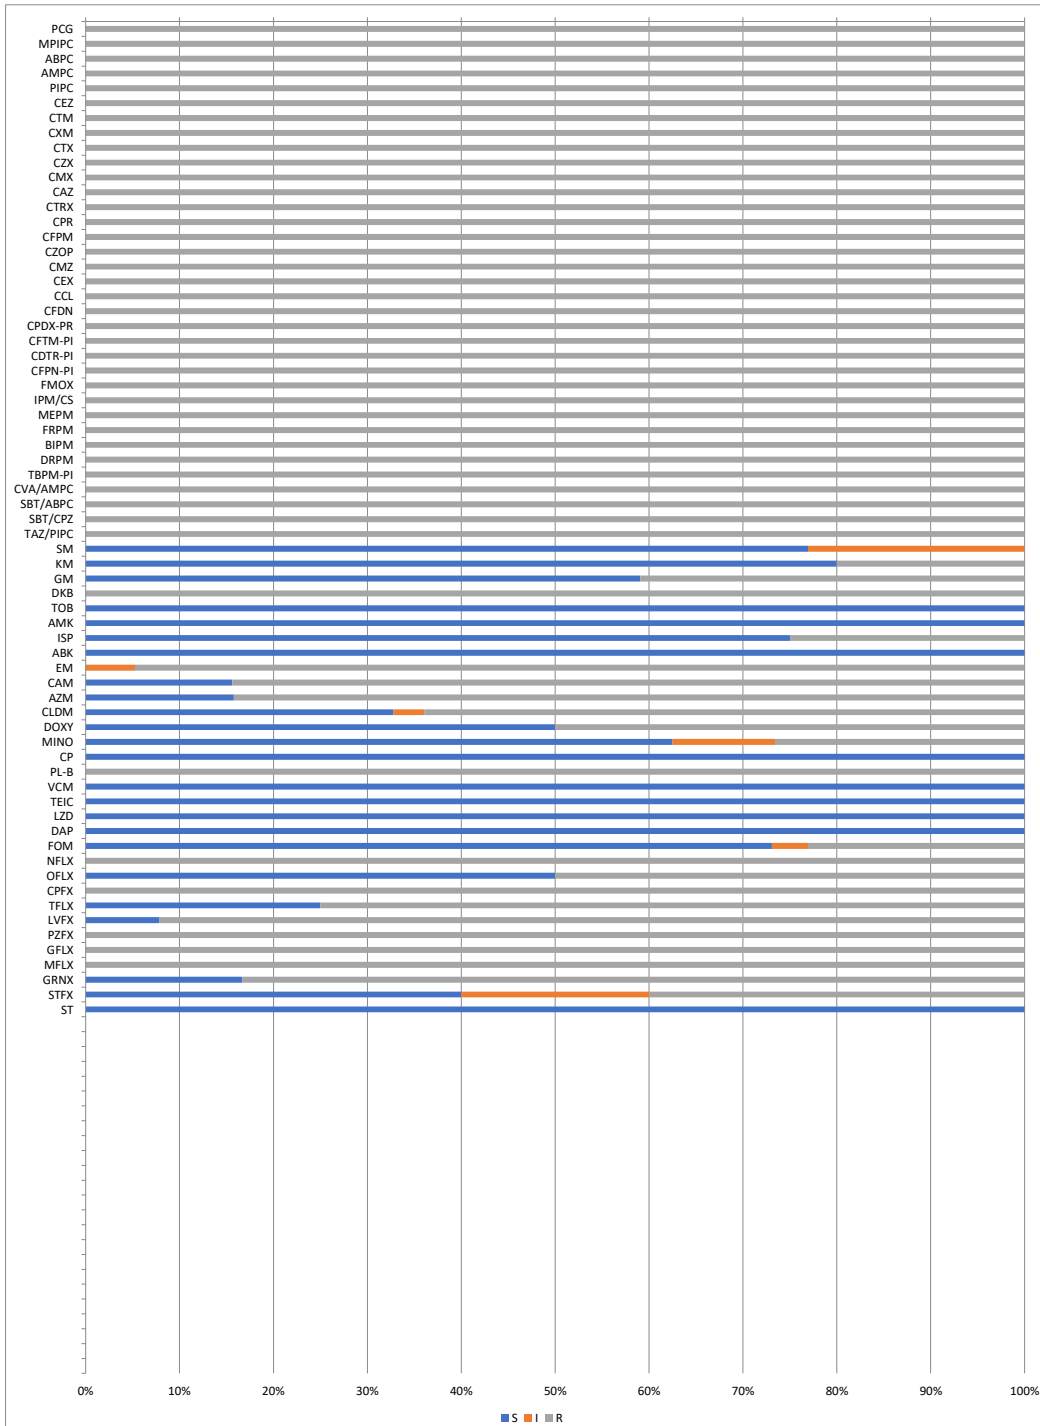

印刷日:2023/09/21 14:14:31

指定感染菌 薬剤感受性状況

受付日

受付日	菌
2023/08/01~2023/08/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	37(100%)	37(100%)
MPiPC	0(0%)	0(0%)	35(100%)	35(100%)
ABPC	0(0%)	0(0%)	12(100%)	12(100%)
AMPc	0(0%)	0(0%)	23(100%)	23(100%)
PIPC	0(0%)	0(0%)	28(100%)	28(100%)
CEZ	0(0%)	0(0%)	54(100%)	54(100%)
CTM	0(0%)	0(0%)	46(100%)	46(100%)
CXM	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	38(100%)	38(100%)
CZX	0(0%)	0(0%)	1(100%)	1(100%)
CMZ	0(0%)	0(0%)	3(100%)	3(100%)
CAZ	0(0%)	0(0%)	18(100%)	18(100%)
CTRX	0(0%)	0(0%)	30(100%)	30(100%)
CPR	0(0%)	0(0%)	4(100%)	4(100%)
CFPM	0(0%)	0(0%)	52(100%)	52(100%)
CZOP	0(0%)	0(0%)	6(100%)	6(100%)
CMZ	0(0%)	0(0%)	52(100%)	52(100%)
CEX	0(0%)	0(0%)	5(100%)	5(100%)
CCL	0(0%)	0(0%)	18(100%)	18(100%)
CFDN	0(0%)	0(0%)	10(100%)	10(100%)
CPDX-PR	0(0%)	0(0%)	8(100%)	8(100%)
CFTM-PI	0(0%)	0(0%)	6(100%)	6(100%)
CDTR-PI	0(0%)	0(0%)	9(100%)	9(100%)
CFPN-PI	0(0%)	0(0%)	18(100%)	18(100%)
FMOX	0(0%)	0(0%)	36(100%)	36(100%)
IPM/CS	0(0%)	0(0%)	47(100%)	47(100%)
MEPM	0(0%)	0(0%)	23(100%)	23(100%)
FRPM	0(0%)	0(0%)	19(100%)	19(100%)
BIPM	0(0%)	0(0%)	3(100%)	3(100%)
DRPM	0(0%)	0(0%)	5(100%)	5(100%)
TBPM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CVA/AMPC	0(0%)	0(0%)	16(100%)	16(100%)
SBT/ABPC	0(0%)	0(0%)	61(100%)	61(100%)
SBT/CPZ	0(0%)	0(0%)	56(100%)	56(100%)
TAZ/PIPC	0(0%)	0(0%)	24(100%)	24(100%)
SM	10(76.9%)	3(23.1%)	0(0%)	13(100%)
KM	4(80.0%)	0(0%)	1(20.0%)	5(100%)
GM	13(59.1%)	0(0%)	9(40.9%)	22(100%)
DKB	0(0%)	0(0%)	1(100%)	1(100%)
TOB	2(100%)	0(0%)	0(0%)	2(100%)
AMK	18(100%)	0(0%)	0(0%)	18(100%)
ISP	3(75.0%)	0(0%)	1(25.0%)	4(100%)
ABK	39(100%)	0(0%)	0(0%)	39(100%)
EM	0(0%)	1(5.3%)	18(94.7%)	19(100%)
CAM	5(15.6%)	0(0%)	27(84.4%)	32(100%)
AZM	3(15.8%)	0(0%)	16(84.2%)	19(100%)
CLDM	20(32.8%)	2(3.3%)	39(63.9%)	61(100%)
DOXY	1(50.0%)	0(0%)	1(50.0%)	2(100%)
MINO	40(62.5%)	7(10.9%)	17(26.6%)	64(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
PL-B	1(100%)	0(0%)	6(100%)	6(100%)
VCM	62(100%)	0(0%)	0(0%)	62(100%)
TEIC	55(100%)	0(0%)	0(0%)	55(100%)
LZD	48(100%)	0(0%)	0(0%)	48(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	19(73.1%)	1(3.8%)	6(23.1%)	26(100%)
NFLX	0(0%)	0(0%)	2(100%)	2(100%)
OFLEX	2(50.0%)	0(0%)	2(50.0%)	4(100%)
CPFX	0(0%)	0(0%)	18(100%)	18(100%)
TFX	3(25.0%)	0(0%)	9(75.0%)	12(100%)
LVFX	5(7.8%)	0(0%)	59(92.2%)	64(100%)
PZFX	0(0%)	0(0%)	4(100%)	4(100%)
GFLEX	0(0%)	0(0%)	2(100%)	2(100%)
MLFX	0(0%)	0(0%)	6(100%)	6(100%)
GRNX	3(16.7%)	0(0%)	15(83.3%)	18(100%)
STFX	2(40.0%)	1(20.0%)	2(40.0%)	5(100%)
ST	23(100%)	0(0%)	0(0%)	23(100%)

[illegible]