


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2023/09/01~2023/09/30	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

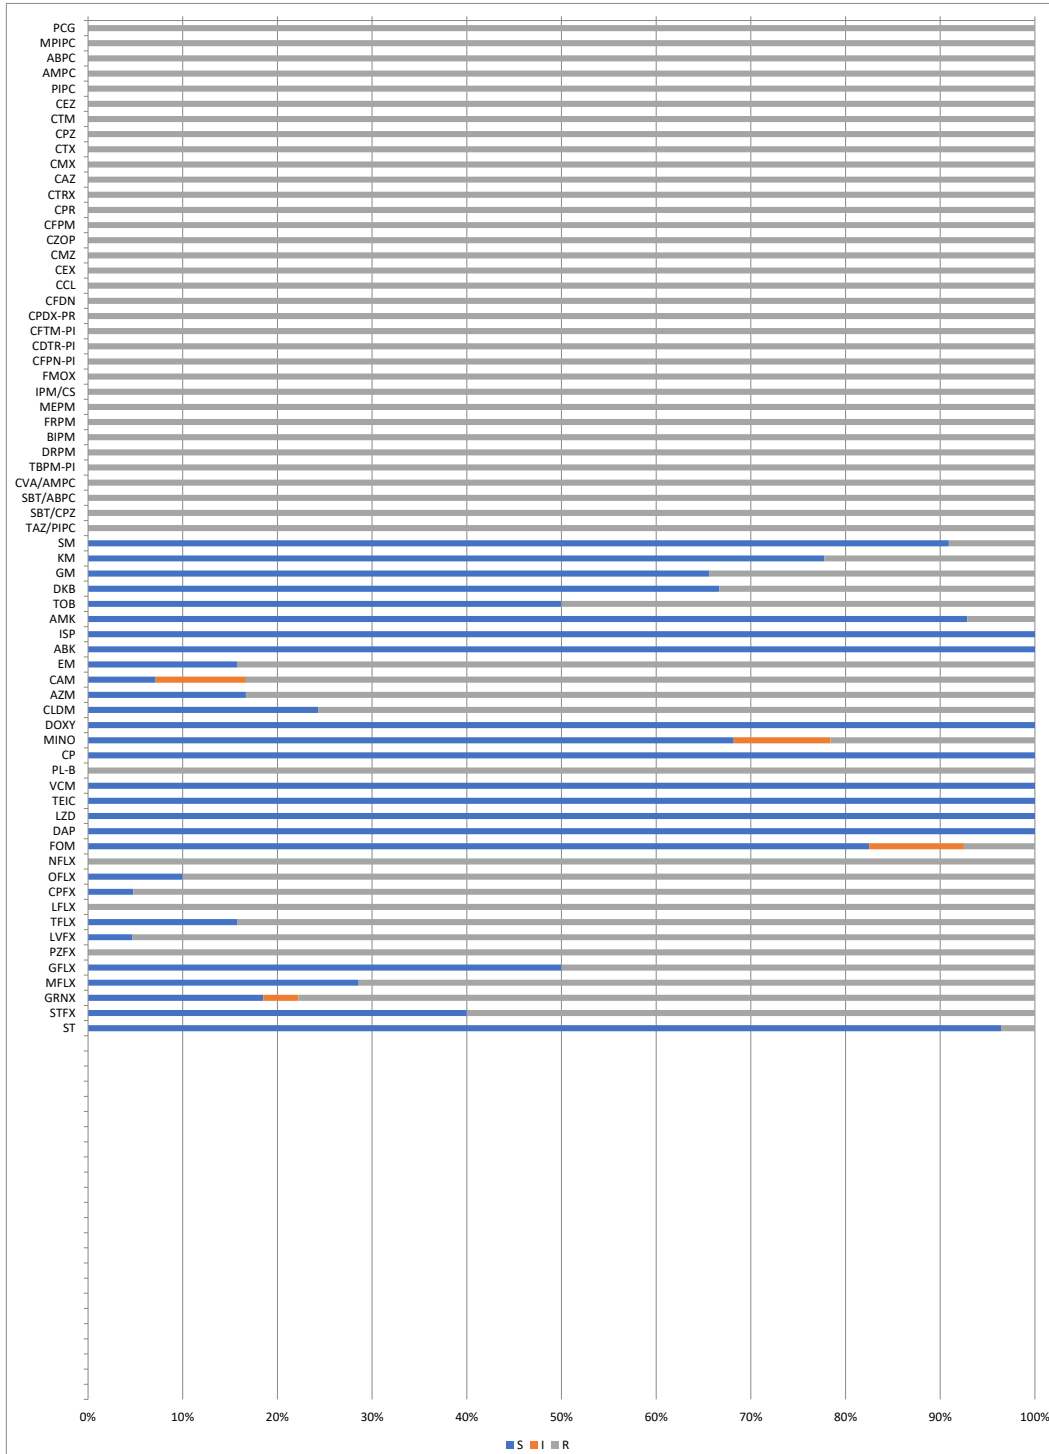

指定感染菌 薬剤感受性状況

受付目

受付日	菌
2023/09/01～2023/09/30	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表


	S	I	R	合計
PCG	0(0%)	0(0%)	44(100%)	44(100%)
MPICP	0(0%)	0(0%)	47(100%)	47(100%)
ABPC	0(0%)	0(0%)	16(100%)	16(100%)
AMPC	0(0%)	0(0%)	26(100%)	26(100%)
PIPC	0(0%)	0(0%)	40(100%)	40(100%)
CEZ	0(0%)	0(0%)	63(100%)	63(100%)
CTM	0(0%)	0(0%)	62(100%)	62(100%)
CPZ	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	48(100%)	48(100%)
CMX	0(0%)	0(0%)	5(100%)	5(100%)
CAZ	0(0%)	0(0%)	26(100%)	26(100%)
CTRX	0(0%)	0(0%)	40(100%)	40(100%)
CPR	0(0%)	0(0%)	4(100%)	4(100%)
CFPM	0(0%)	0(0%)	62(100%)	62(100%)
CZOP	0(0%)	0(0%)	13(100%)	13(100%)
CMZ	0(0%)	0(0%)	63(100%)	63(100%)
GEX	0(0%)	0(0%)	3(100%)	3(100%)
GCL	0(0%)	0(0%)	20(100%)	20(100%)
CFDN	0(0%)	0(0%)	21(100%)	21(100%)
CPDX-PR	0(0%)	0(0%)	14(100%)	14(100%)
CFTM-PI	0(0%)	0(0%)	8(100%)	8(100%)
CDTR-PI	0(0%)	0(0%)	14(100%)	14(100%)
CFPM-PI	0(0%)	0(0%)	25(100%)	25(100%)
FMOX	0(0%)	0(0%)	45(100%)	45(100%)
IPM/CS	0(0%)	0(0%)	66(100%)	66(100%)
MEPM	0(0%)	0(0%)	31(100%)	31(100%)
FRPM	0(0%)	0(0%)	17(100%)	17(100%)
BIPM	0(0%)	0(0%)	8(100%)	8(100%)
DRPM	0(0%)	0(0%)	11(100%)	11(100%)
TBPM-PI	0(0%)	0(0%)	6(100%)	6(100%)
CVA/AMPC	0(0%)	0(0%)	18(100%)	18(100%)
SBT/ABPC	0(0%)	0(0%)	80(100%)	80(100%)
SBT/CPZ	0(0%)	0(0%)	77(100%)	77(100%)
TAZ/PIPC	0(0%)	0(0%)	30(100%)	30(100%)
SM	10(90.9%)	0(0%)	1(9.1%)	11(100%)
KM	7(77.8%)	0(0%)	2(22.2%)	9(100%)
GM	21(65.6%)	0(0%)	11(34.4%)	32(100%)
DKB	2(66.7%)	0(0%)	1(33.3%)	3(100%)
TOB	1(50.0%)	0(0%)	1(50.0%)	2(100%)
AMK	26(92.9%)	0(0%)	2(7.1%)	28(100%)
ISP	2(100%)	0(0%)	0(0%)	2(100%)
ABK	50(100%)	0(0%)	0(0%)	50(100%)
EM	3(15.8%)	0(0%)	16(84.2%)	19(100%)
CAM	3(7.1%)	4(9.5%)	35(83.3%)	42(100%)
AZM	5(16.7%)	0(0%)	25(83.3%)	30(100%)
CLDM	18(24.3%)	0(0%)	56(75.7%)	74(100%)
DOXY	1(100%)	0(0%)	0(0%)	1(100%)
MINO	60(68.2%)	9(10.2%)	19(21.6%)	88(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
PL-B	0(0%)	0(0%)	11(100%)	11(100%)
YCM	80(100%)	0(0%)	0(0%)	80(100%)
TEIC	64(100%)	0(0%)	0(0%)	64(100%)
LZD	59(100%)	0(0%)	0(0%)	59(100%)
FAP	3(100%)	0(0%)	0(0%)	3(100%)
DOM	33(92.5%)	4(10.0%)	3(7.5%)	40(100%)
NFLX	0(0%)	0(0%)	2(100%)	2(100%)
OFLX	1(10.0%)	0(0%)	9(90.0%)	10(100%)
CPFX	1(4.8%)	0(0%)	20(95.2%)	21(100%)
LFLX	0(0%)	0(0%)	3(100%)	3(100%)
TLFX	3(15.8%)	0(0%)	16(84.2%)	19(100%)
LVFX	4(4.7%)	0(0%)	82(95.3%)	86(100%)
PZFX	0(0%)	0(0%)	5(100%)	5(100%)
GFLX	1(50.0%)	0(0%)	1(50.0%)	2(100%)
MFLX	2(28.6%)	0(0%)	5(71.4%)	7(100%)
GRNX	5(18.5%)	1(3.7%)	21(77.8%)	27(100%)
STFX	4(40.0%)	0(0%)	6(60.0%)	10(100%)
ST	27(96.4%)	0(0%)	1(3.6%)	28(100%)

[illegible]

抽出条件

受付日	菌	医療機関
2023/09/01～2023/09/30	<i>S.pneumoniae</i> (PISP)	

指定感染菌 検出推移グラフ

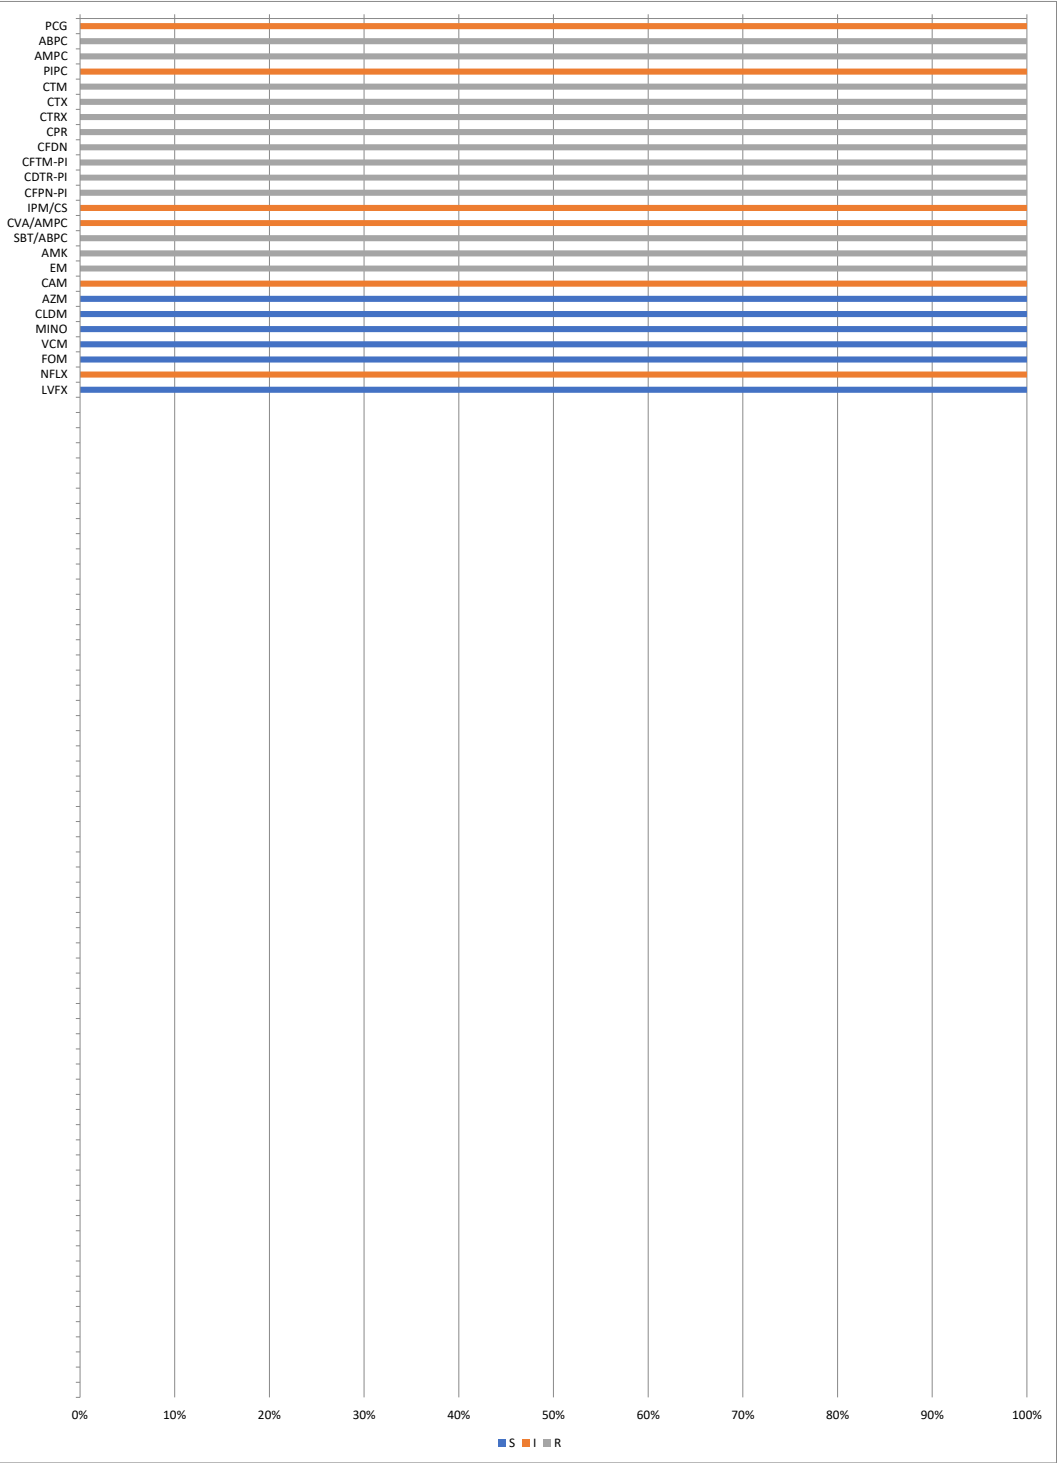

受付日

受付日	菌
2023/09/01~2023/09/30	S.pneumoniae (PISP)

指定感染菌 薬剤感受性状況表

[illegible]