


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2023/10/01~2023/10/31	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

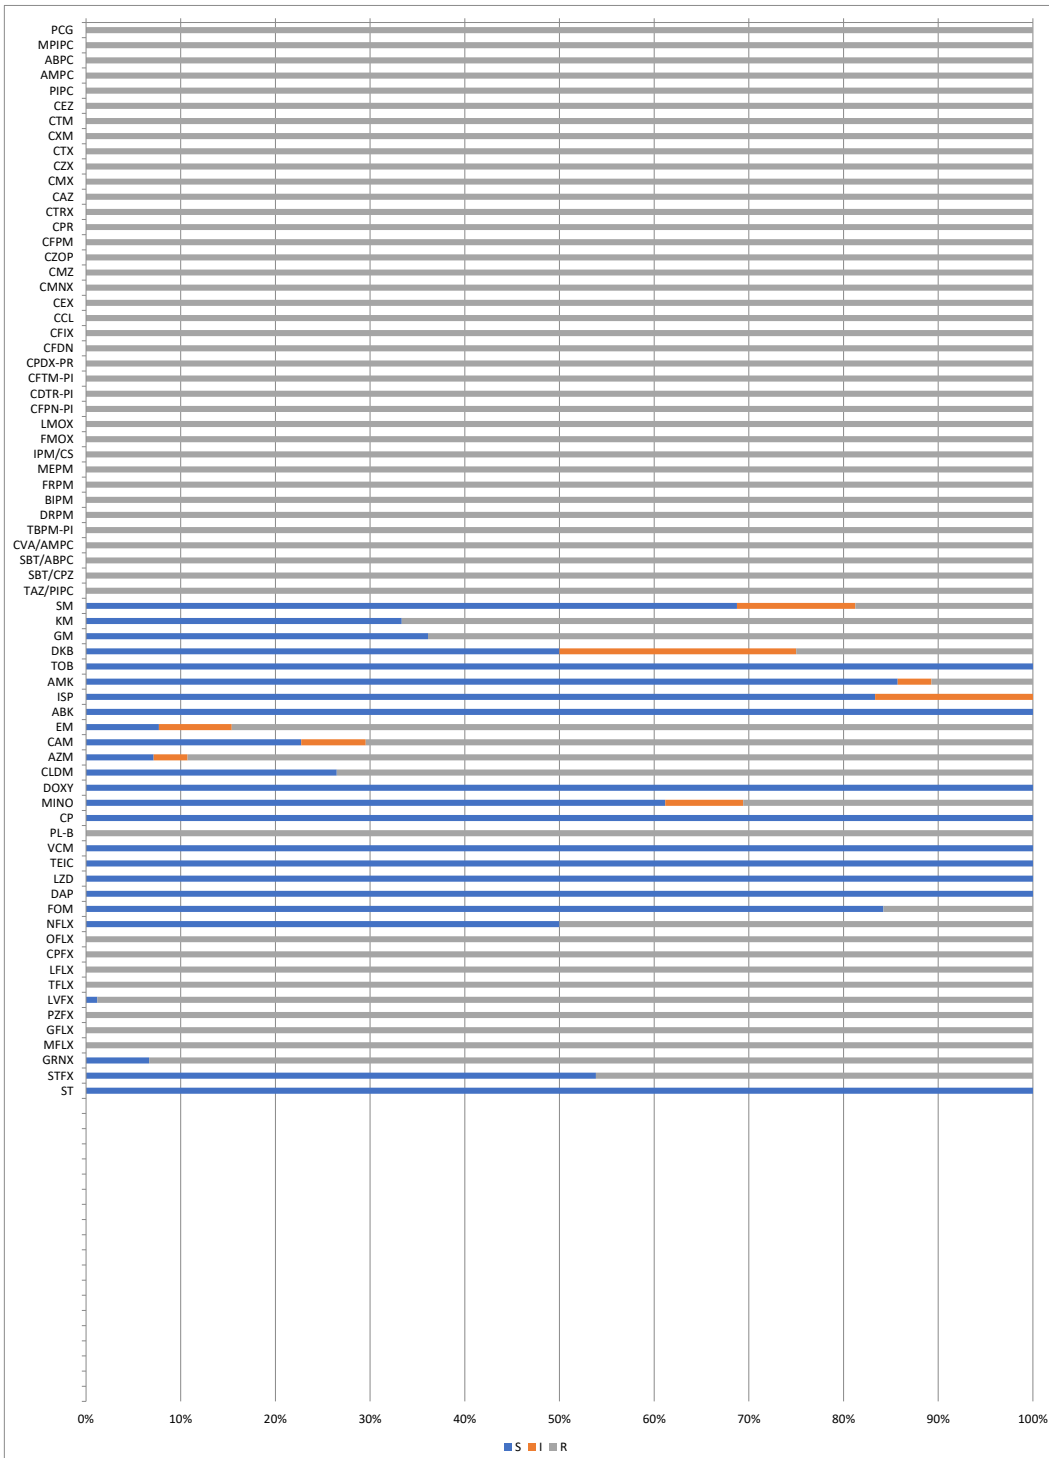

指定感染菌 薬剤感受性状況

受付日

受付日	菌
2023/10/01~2023/10/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	39(100%)	39(100%)
MPIPC	0(0%)	0(0%)	37(100%)	37(100%)
ABPC	0(0%)	0(0%)	14(100%)	14(100%)
AMPC	0(0%)	0(0%)	30(100%)	30(100%)
PIPC	0(0%)	0(0%)	45(100%)	45(100%)
CEZ	0(0%)	0(0%)	62(100%)	62(100%)
CTM	0(0%)	0(0%)	54(100%)	54(100%)
CXM	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	40(100%)	40(100%)
CZX	0(0%)	0(0%)	2(100%)	2(100%)
CMX	0(0%)	0(0%)	5(100%)	5(100%)
CAZ	0(0%)	0(0%)	31(100%)	31(100%)
CTRX	0(0%)	0(0%)	45(100%)	45(100%)
CPR	0(0%)	0(0%)	6(100%)	6(100%)
CFPM	0(0%)	0(0%)	58(100%)	58(100%)
CZOP	0(0%)	0(0%)	13(100%)	13(100%)
CMZ	0(0%)	0(0%)	62(100%)	62(100%)
CMNX	0(0%)	0(0%)	1(100%)	1(100%)
CEX	0(0%)	0(0%)	8(100%)	8(100%)
GCL	0(0%)	0(0%)	28(100%)	28(100%)
CFIX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	19(100%)	19(100%)
GPOX-PI	0(0%)	0(0%)	11(100%)	11(100%)
GFTM-PI	0(0%)	0(0%)	10(100%)	10(100%)
GDRP-PI	0(0%)	0(0%)	11(100%)	11(100%)
GFPN-PI	0(0%)	0(0%)	32(100%)	32(100%)
LMOX	0(0%)	0(0%)	1(100%)	1(100%)
FMOX	0(0%)	0(0%)	40(100%)	40(100%)
IPM/GS	0(0%)	0(0%)	58(100%)	58(100%)
MEPM	0(0%)	0(0%)	39(100%)	39(100%)
FRPM	0(0%)	0(0%)	17(100%)	17(100%)
BIPM	0(0%)	0(0%)	4(100%)	4(100%)
DRPM	0(0%)	0(0%)	9(100%)	9(100%)
TBPM-PI	0(0%)	0(0%)	5(100%)	5(100%)
CVA/AMPC	0(0%)	0(0%)	23(100%)	23(100%)
SBT/ABPC	0(0%)	0(0%)	78(100%)	78(100%)
SBT/GPZ	0(0%)	0(0%)	74(100%)	74(100%)
TAZ/PIPC	0(0%)	0(0%)	33(100%)	33(100%)
SM	11(68.8%)	2(12.5%)	31(81.8%)	16(100%)
KM	3(33.3%)	0(0%)	6(66.7%)	9(100%)
SM	13(36.1%)	0(0%)	23(63.9%)	36(100%)
DKB	2(50.0%)	1(25.0%)	1(25.0%)	4(100%)
TOB	2(100%)	0(0%)	0(0%)	2(100%)
AMK	24(85.7%)	1(3.6%)	3(10.7%)	28(100%)
ISP	5(83.3%)	1(16.7%)	0(0%)	6(100%)
ABK	43(100%)	0(0%)	0(0%)	43(100%)
EM	2(7.7%)	2(7.7%)	22(84.6%)	26(100%)
CAM	10(22.7%)	3(6.8%)	31(70.5%)	44(100%)
AZM	2(7.1%)	1(3.6%)	25(89.3%)	28(100%)
CLDM	18(26.5%)	0(0%)	50(73.5%)	68(100%)
DOXY	2(100%)	0(0%)	0(0%)	2(100%)
MINO	52(61.2%)	7(8.2%)	26(30.6%)	85(100%)
GP	2(100%)	0(0%)	0(0%)	2(100%)
PL-B	0(0%)	0(0%)	9(100%)	9(100%)
VCM	82(100%)	0(0%)	0(0%)	82(100%)
TEIC	66(100%)	0(0%)	0(0%)	66(100%)
LZD	56(100%)	0(0%)	0(0%)	56(100%)
DAP	5(100%)	0(0%)	0(0%)	5(100%)
FOM	32(64.2%)	0(0%)	6(15.8%)	38(100%)
NFLX	1(50.0%)	0(0%)	1(50.0%)	2(100%)
OFXL	0(0%)	0(0%)	9(100%)	9(100%)
CPFX	0(0%)	0(0%)	26(100%)	26(100%)
LFL	0(0%)	0(0%)	2(100%)	2(100%)
TLFX	0(0%)	0(0%)	20(100%)	20(100%)
LVFX	1(1.2%)	0(0%)	83(98.8%)	84(100%)
PZFX	0(0%)	0(0%)	5(100%)	5(100%)
GFLX	0(0%)	0(0%)	2(100%)	2(100%)
MFLX	0(0%)	0(0%)	11(100%)	11(100%)
GRNX	2(6.7%)	0(0%)	28(93.3%)	30(100%)
STFX	7(53.8%)	0(0%)	6(46.2%)	13(100%)
ST	37(100%)	0(0%)	0(0%)	37(100%)

[illegible]