


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2023/12/01～2023/12/31	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

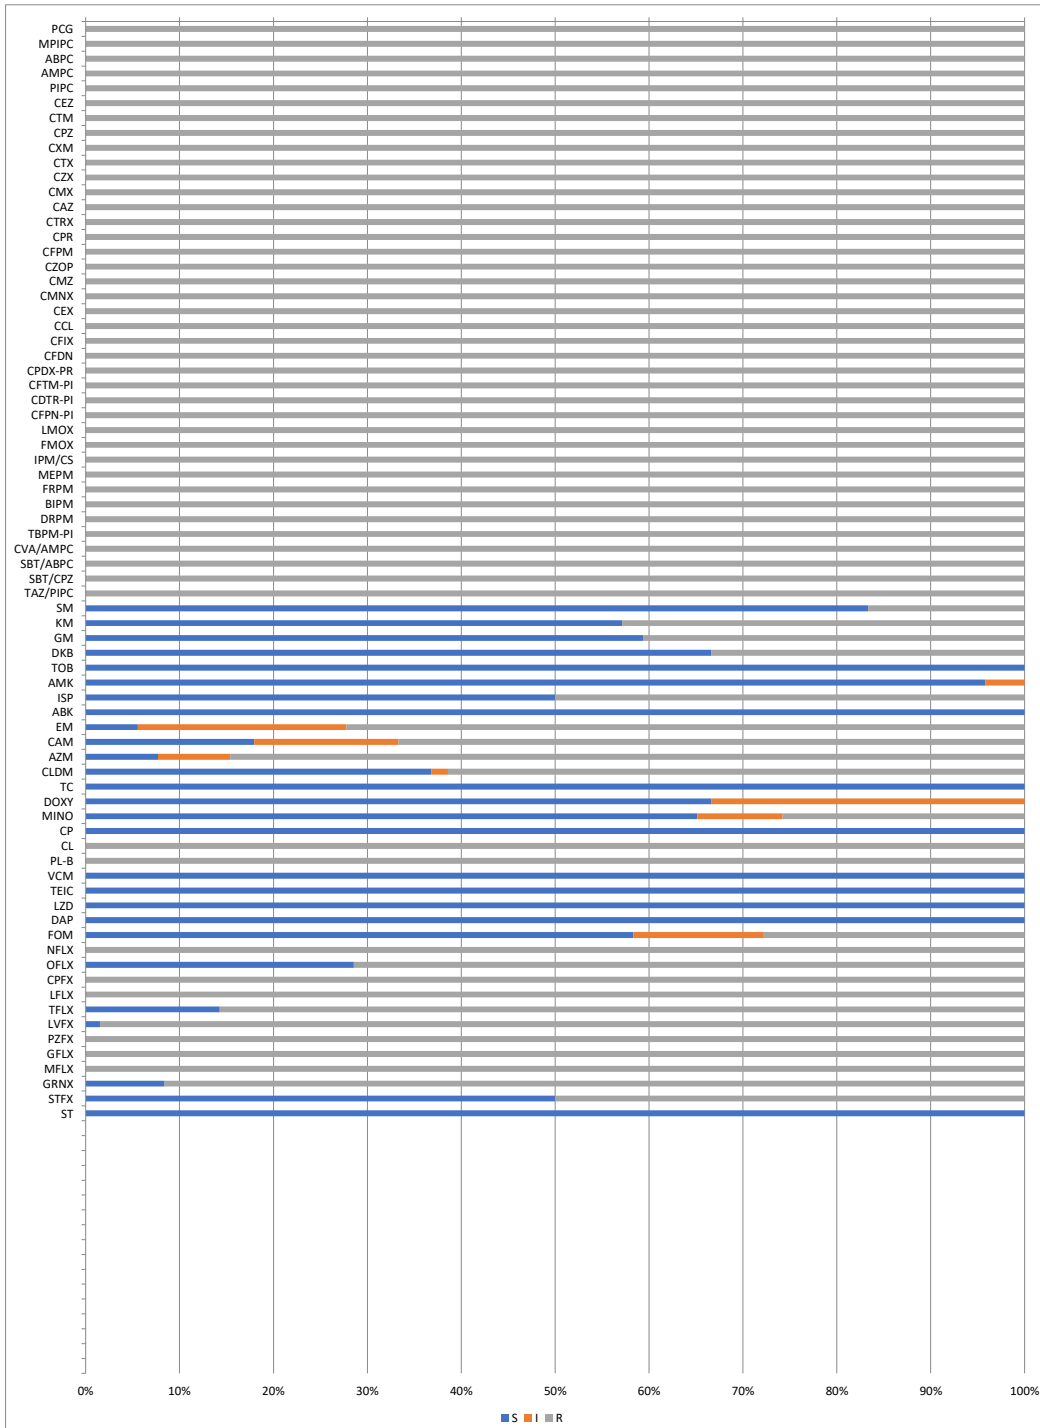

印刷日: 2024/01/25 13:34:46

指定感染菌 薬剤感受性状況

受付日

受付日	菌
2023/12/01~2023/12/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	27(100%)	27(100%)
MPIPC	0(0%)	0(0%)	27(100%)	27(100%)
ABPC	0(0%)	0(0%)	17(100%)	17(100%)
AMPC	0(0%)	0(0%)	29(100%)	29(100%)
PIPC	0(0%)	0(0%)	41(100%)	41(100%)
CEZ	0(0%)	0(0%)	51(100%)	51(100%)
CTM	0(0%)	0(0%)	43(100%)	43(100%)
CPZ	0(0%)	0(0%)	1(100%)	1(100%)
CXM	0(0%)	0(0%)	2(100%)	2(100%)
CTX	0(0%)	0(0%)	32(100%)	32(100%)
CZX	0(0%)	0(0%)	1(100%)	1(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
CAZ	0(0%)	0(0%)	28(100%)	28(100%)
CTRX	0(0%)	0(0%)	41(100%)	41(100%)
CPR	0(0%)	0(0%)	2(100%)	2(100%)
CFPM	0(0%)	0(0%)	48(100%)	48(100%)
CZOP	0(0%)	0(0%)	15(100%)	15(100%)
CMZ	0(0%)	0(0%)	50(100%)	50(100%)
CMNX	0(0%)	0(0%)	1(100%)	1(100%)
CEX	0(0%)	0(0%)	5(100%)	5(100%)
CCL	0(0%)	0(0%)	24(100%)	24(100%)
CFIX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	18(100%)	18(100%)
CPDX-PR	0(0%)	0(0%)	15(100%)	15(100%)
CFTM-PI	0(0%)	0(0%)	4(100%)	4(100%)
CDTR-PI	0(0%)	0(0%)	11(100%)	11(100%)
CFPN-PI	0(0%)	0(0%)	23(100%)	23(100%)
LMOX	0(0%)	0(0%)	1(100%)	1(100%)
FMOX	0(0%)	0(0%)	28(100%)	28(100%)
IPM_CS	0(0%)	0(0%)	44(100%)	44(100%)
MEPM	0(0%)	0(0%)	34(100%)	34(100%)
FRPM	0(0%)	0(0%)	20(100%)	20(100%)
BIPM	0(0%)	0(0%)	4(100%)	4(100%)
DRPM	0(0%)	0(0%)	10(100%)	10(100%)
TBPM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CVA-AMPC	0(0%)	0(0%)	18(100%)	18(100%)
SBT/ABPC	0(0%)	0(0%)	60(100%)	60(100%)
SBT/CPZ	0(0%)	0(0%)	58(100%)	58(100%)
TAZ/PMC	0(0%)	0(0%)	34(100%)	34(100%)
SIM	10(83.3%)		2(16.7%)	12(100%)
KM	4(57.1%)	0(0%)	3(42.9%)	7(100%)
KM	19(59.4%)	0(0%)	13(40.6%)	32(100%)
DKB	2(66.7%)	0(0%)	1(33.3%)	3(100%)
TOB	1(100%)	0(0%)	0(0%)	1(100%)
AMK	23(95.8%)	1(4.2%)	0(0%)	24(100%)
ISP	1(50.0%)	0(0%)	1(50.0%)	2(100%)
EMK	34(100%)	0(0%)	0(0%)	34(100%)
AB	1(5.6%)	4(22.2%)	13(72.2%)	18(100%)
CAM	7(17.9%)	6(15.4%)	26(66.7%)	39(100%)
AZM	2(7.7%)	2(7.7%)	22(84.6%)	26(100%)
CLDM	21(36.8%)	1(1.8%)	35(61.4%)	57(100%)
TC	1(100%)	0(0%)	0(0%)	1(100%)
DOXY	2(66.7%)	1(33.3%)	0(0%)	3(100%)
MINO	43(65.2%)	6(9.1%)	17(25.8%)	66(100%)
CP	1(100%)	0(0%)	0(0%)	1(100%)
CL	0(0%)	0(0%)	1(100%)	1(100%)
PL-B	0(0%)	0(0%)	7(100%)	7(100%)
VCM	65(100%)	0(0%)	0(0%)	65(100%)
TEIC	48(100%)	0(0%)	0(0%)	48(100%)
LZD	41(100%)	0(0%)	0(0%)	41(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	21(58.3%)	5(13.9%)	10(27.8%)	36(100%)
NFLX	0(0%)	0(0%)	4(100%)	4(100%)
OFLX	2(28.6%)	0(0%)	5(71.4%)	7(100%)
CPFX	0(0%)	0(0%)	19(100%)	19(100%)
LFLX	0(0%)	0(0%)	2(100%)	2(100%)
TLFX	2(14.3%)	0(0%)	12(85.7%)	14(100%)
LVFX	1(1.5%)	0(0%)	65(98.5%)	66(100%)
PZFX	0(0%)	0(0%)	9(100%)	9(100%)
GFLX	0(0%)	0(0%)	1(100%)	1(100%)
MFLX	0(0%)	0(0%)	5(100%)	5(100%)
GRNX	2(8.3%)	0(0%)	22(91.7%)	24(100%)
STFX	3(50.0%)	0(0%)	3(50.0%)	6(100%)
ST	30(100%)	0(0%)	0(0%)	30(100%)

[illegible]