


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2024/02/01~2024/02/29	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

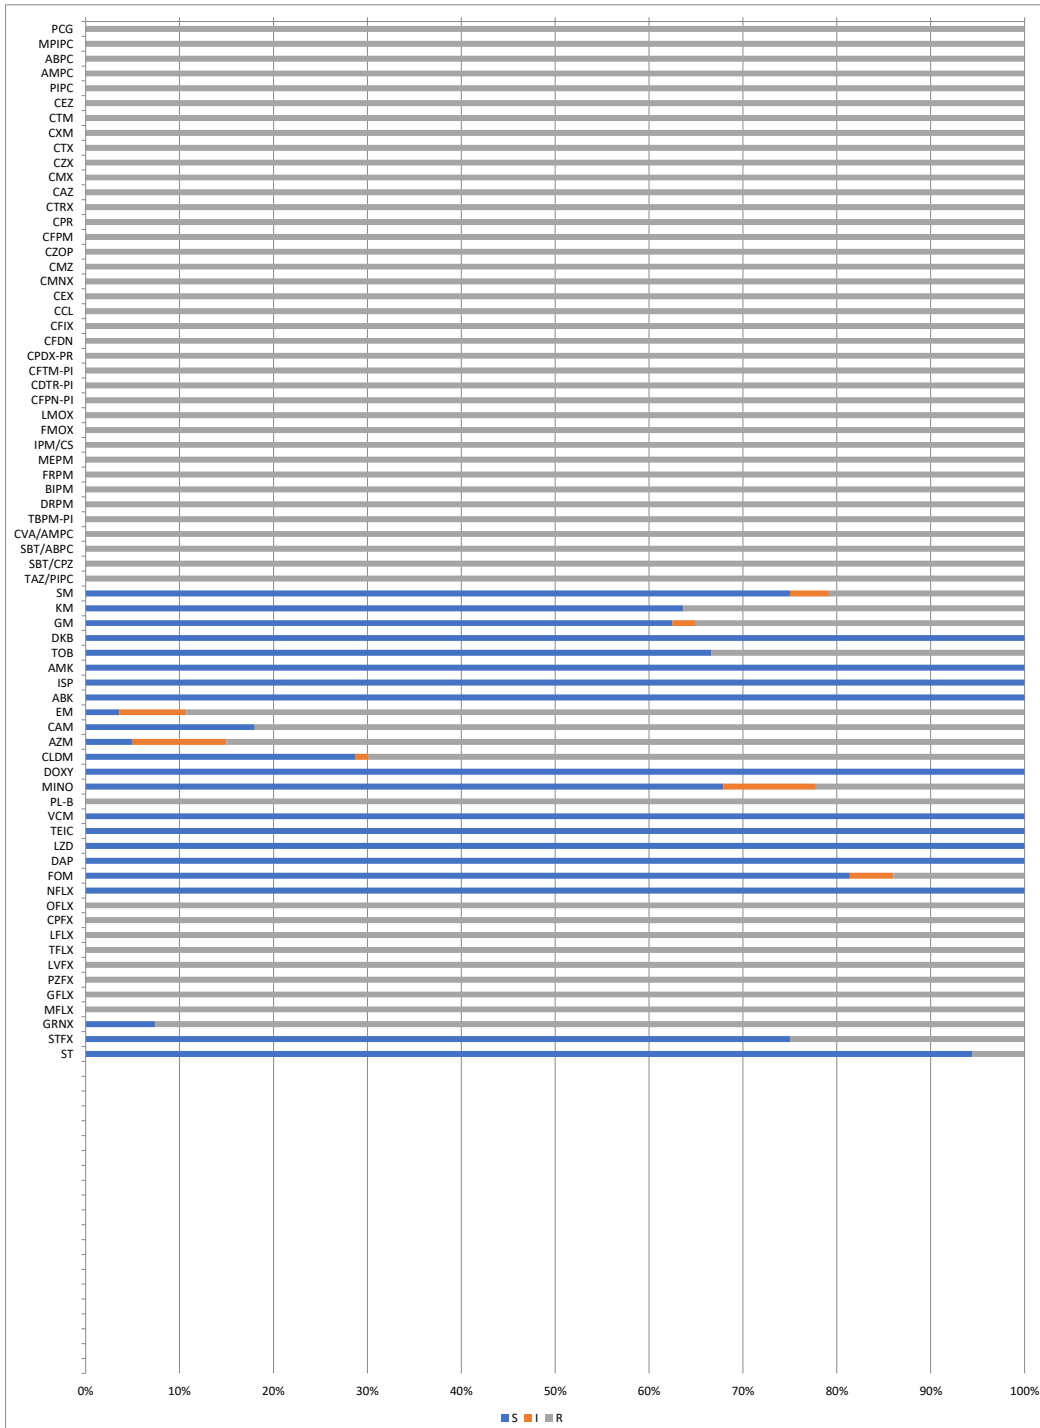

印刷日:2024/03/21 16:01:59

指定感染菌 薬剤感受性状況

受付日

受付日	菌
2024/02/01~2024/02/29	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	33(100%)	33(100%)
MPIPC	0(0%)	0(0%)	32(100%)	32(100%)
ABPC	0(0%)	0(0%)	16(100%)	16(100%)
AMP	0(0%)	0(0%)	31(100%)	31(100%)
PIPC	0(0%)	0(0%)	48(100%)	48(100%)
CEZ	0(0%)	0(0%)	66(100%)	66(100%)
CTM	0(0%)	0(0%)	56(100%)	56(100%)
CTX	0(0%)	0(0%)	1(100%)	1(100%)
CXM	0(0%)	0(0%)	38(100%)	38(100%)
CZX	0(0%)	0(0%)	2(100%)	2(100%)
CMX	0(0%)	0(0%)	1(100%)	1(100%)
CAZ	0(0%)	0(0%)	34(100%)	34(100%)
CTRX	0(0%)	0(0%)	47(100%)	47(100%)
CPR	0(0%)	0(0%)	3(100%)	3(100%)
CFPM	0(0%)	0(0%)	67(100%)	67(100%)
CZOP	0(0%)	0(0%)	9(100%)	9(100%)
CMZ	0(0%)	0(0%)	65(100%)	65(100%)
CMNX	0(0%)	0(0%)	1(100%)	1(100%)
CEX	0(0%)	0(0%)	7(100%)	7(100%)
CCL	0(0%)	0(0%)	37(100%)	37(100%)
CFX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	13(100%)	13(100%)
CPDX-PR	0(0%)	0(0%)	13(100%)	13(100%)
CFDM-PI	0(0%)	0(0%)	3(100%)	3(100%)
CDTR-PI	0(0%)	0(0%)	9(100%)	9(100%)
CFPN-PI	0(0%)	0(0%)	27(100%)	27(100%)
LMOX	0(0%)	0(0%)	1(100%)	1(100%)
FMOX	0(0%)	0(0%)	33(100%)	33(100%)
IPM/CS	0(0%)	0(0%)	54(100%)	54(100%)
MEPM	0(0%)	0(0%)	42(100%)	42(100%)
FRPM	0(0%)	0(0%)	26(100%)	26(100%)
BIPM	0(0%)	0(0%)	4(100%)	4(100%)
DRPM	0(0%)	0(0%)	9(100%)	9(100%)
TBPM-PI	0(0%)	0(0%)	1(100%)	1(100%)
CVA/AMPC	0(0%)	0(0%)	24(100%)	24(100%)
SBT/ABPC	0(0%)	0(0%)	70(100%)	70(100%)
SBT/CPZ	0(0%)	0(0%)	71(100%)	71(100%)
TAZ/PIPC	0(0%)	0(0%)	43(100%)	43(100%)
SM	18(75.0%)	1(4.2%)	5(20.8%)	24(100%)
KM	7(63.6%)	0(0%)	4(36.4%)	11(100%)
GM	25(62.5%)	1(2.5%)	14(35.0%)	40(100%)
DKB	2(100%)	0(0%)	0(0%)	2(100%)
TOB	2(66.7%)	0(0%)	1(33.3%)	3(100%)
AMK	20(100%)	0(0%)	0(0%)	20(100%)
ISP	3(100%)	0(0%)	0(0%)	3(100%)
ABK	42(100%)	0(0%)	0(0%)	42(100%)
EM	1(3.6%)	2(7.1%)	25(89.3%)	28(100%)
GAM	9(18.0%)	0(0%)	41(82.0%)	50(100%)
AZM	1(5.0%)	2(10.0%)	17(85.0%)	20(100%)
CLDM	21(28.8%)	1(1.4%)	51(69.9%)	73(100%)
DOXY	1(100%)	0(0%)	0(0%)	1(100%)
MINO	55(67.9%)	8(9.9%)	18(22.2%)	81(100%)
PL-B	0(0%)	0(0%)	11(100%)	11(100%)
VCM	79(100%)	0(0%)	0(0%)	79(100%)
TEIC	65(100%)	0(0%)	0(0%)	65(100%)
LZD	55(100%)	0(0%)	0(0%)	55(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	35(81.4%)	2(4.7%)	6(14.0%)	43(100%)
NFLX	1(100%)	0(0%)	0(0%)	1(100%)
OFXL	0(0%)	0(0%)	2(100%)	2(100%)
CPFX	0(0%)	0(0%)	31(100%)	31(100%)
LFLX	0(0%)	0(0%)	1(100%)	1(100%)
TLFX	0(0%)	0(0%)	21(100%)	21(100%)
LVFX	0(0%)	0(0%)	81(100%)	81(100%)
PZFX	0(0%)	0(0%)	7(100%)	7(100%)
GFLX	0(0%)	0(0%)	1(100%)	1(100%)
MLFX	0(0%)	0(0%)	10(100%)	10(100%)
GRNX	2(7.4%)	0(0%)	25(92.6%)	27(100%)
STFX	6(75.0%)	0(0%)	2(25.0%)	8(100%)
STF	34(94.4%)	0(0%)	2(5.6%)	36(100%)

[illegible]