


指定感染菌 薬剤感受性状況

印刷日: 2025/07/29 13:34:25

抽出条件

受付日	菌	医療機関
2025/06/01～2025/06/30	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

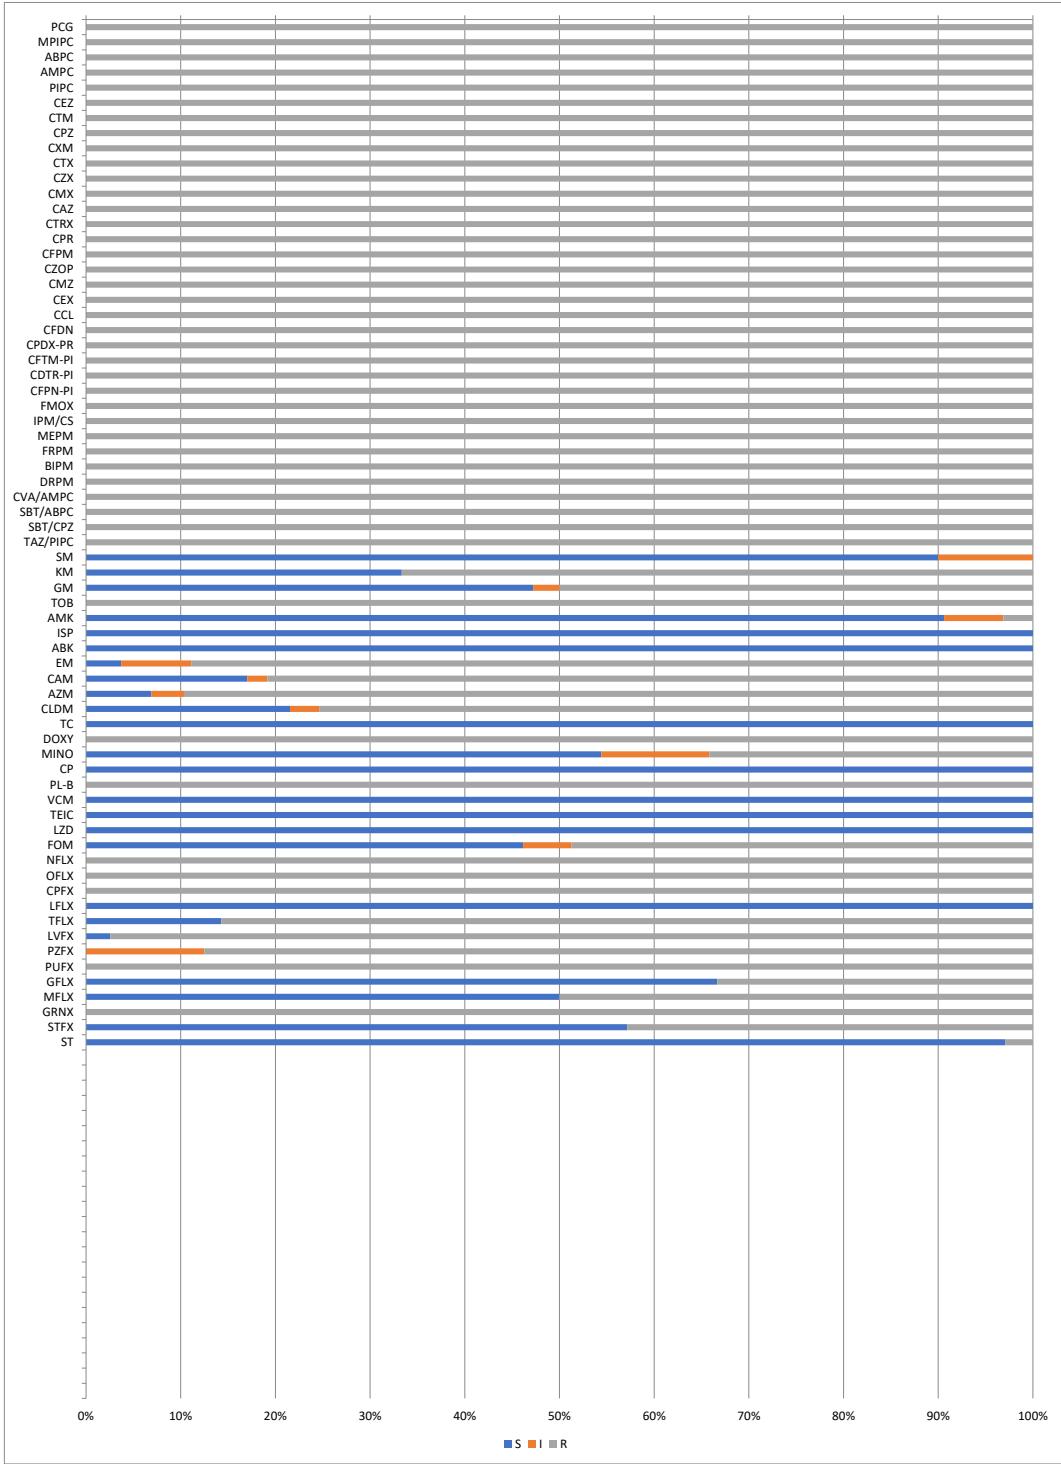

指定感染菌 薬剤感受性状況

受付日	菌
2025/06/01～2025/06/30	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	33(100%)	33(100%)
MPIC	0(0%)	0(0%)	32(100%)	32(100%)
ABPC	0(0%)	0(0%)	14(100%)	14(100%)
AMPC	0(0%)	0(0%)	26(100%)	26(100%)
PIPC	0(0%)	0(0%)	45(100%)	45(100%)
CEZ	0(0%)	0(0%)	60(100%)	60(100%)
CTM	0(0%)	0(0%)	55(100%)	55(100%)
CPZ	0(0%)	0(0%)	1(100%)	1(100%)
CXM	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	40(100%)	40(100%)
CZX	0(0%)	0(0%)	3(100%)	3(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
CAZ	0(0%)	0(0%)	33(100%)	33(100%)
CTRX	0(0%)	0(0%)	44(100%)	44(100%)
CPR	0(0%)	0(0%)	4(100%)	4(100%)
CFPM	0(0%)	0(0%)	57(100%)	57(100%)
CZOP	0(0%)	0(0%)	8(100%)	8(100%)
CMZ	0(0%)	0(0%)	57(100%)	57(100%)
CEX	0(0%)	0(0%)	5(100%)	5(100%)
CCL	0(0%)	0(0%)	23(100%)	23(100%)
CFDN	0(0%)	0(0%)	12(100%)	12(100%)
CPDX-PR	0(0%)	0(0%)	11(100%)	11(100%)
CFTM-PI	0(0%)	0(0%)	1(100%)	1(100%)
CDTR-PI	0(0%)	0(0%)	12(100%)	12(100%)
CFPN-PI	0(0%)	0(0%)	22(100%)	22(100%)
FMOX	0(0%)	0(0%)	33(100%)	33(100%)
IPM/CS	0(0%)	0(0%)	51(100%)	51(100%)
MEPM	0(0%)	0(0%)	38(100%)	38(100%)
FRPM	0(0%)	0(0%)	16(100%)	16(100%)
BIPM	0(0%)	0(0%)	10(100%)	10(100%)
DRPM	0(0%)	0(0%)	7(100%)	7(100%)
CVA/AMPC	0(0%)	0(0%)	18(100%)	18(100%)
SBT/ABPC	0(0%)	0(0%)	73(100%)	73(100%)
SBT/CPZ	0(0%)	0(0%)	58(100%)	58(100%)
TAZ/PIPC	0(0%)	0(0%)	40(100%)	40(100%)
SM	9(90.0%)	1(10.0%)	0(0%)	10(100%)
KM	2(33.3%)	0(0%)	4(66.7%)	6(100%)
GM	17(47.2%)	1(2.8%)	18(50.0%)	36(100%)
TOB	0(0%)	0(0%)	3(100%)	3(100%)
AMK	29(90.6%)	2(6.3%)	1(3.1%)	32(100%)
ISP	5(100%)	0(0%)	0(0%)	5(100%)
ABK	39(100%)	0(0%)	0(0%)	39(100%)
EM	1(3.7%)	2(7.4%)	24(88.9%)	27(100%)
CAM	8(17.0%)	1(2.1%)	38(80.9%)	47(100%)
AZM	2(6.9%)	1(3.4%)	26(89.7%)	29(100%)
CLDM	14(21.5%)	2(3.1%)	49(75.4%)	65(100%)
TC	1(100%)	0(0%)	0(0%)	1(100%)
DOXY	0(0%)	0(0%)	1(100%)	1(100%)
MINO	43(54.4%)	9(11.4%)	27(34.2%)	79(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
PL-B	0(0%)	0(0%)	10(100%)	10(100%)
VCM	77(100%)	0(0%)	0(0%)	77(100%)
TEIC	59(100%)	0(0%)	0(0%)	59(100%)
LZD	49(100%)	0(0%)	0(0%)	49(100%)
FOM	18(46.2%)	2(5.1%)	19(48.7%)	39(100%)
NFLX	0(0%)	0(0%)	2(100%)	2(100%)
OFLX	0(0%)	0(0%)	2(100%)	2(100%)
CFPX	0(0%)	0(0%)	25(100%)	25(100%)
LFLX	1(100%)	0(0%)	0(0%)	1(100%)
TFLX	2(14.3%)	0(0%)	12(85.7%)	14(100%)
LVFX	2(2.6%)	0(0%)	76(97.4%)	78(100%)
PZFX	0(0%)	1(12.5%)	7(87.5%)	8(100%)
PUFX	0(0%)	0(0%)	1(100%)	1(100%)
GFLX	2(66.7%)	0(0%)	1(33.3%)	3(100%)
MFLX	2(50.0%)	0(0%)	2(50.0%)	4(100%)
GRNX	0(0%)	0(0%)	19(100%)	19(100%)
STFX	4(57.1%)	0(0%)	3(42.9%)	7(100%)
ST	33(97.1%)	0(0%)	1(2.9%)	34(100%)