


## 指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2025/10/01~2025/10/31	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

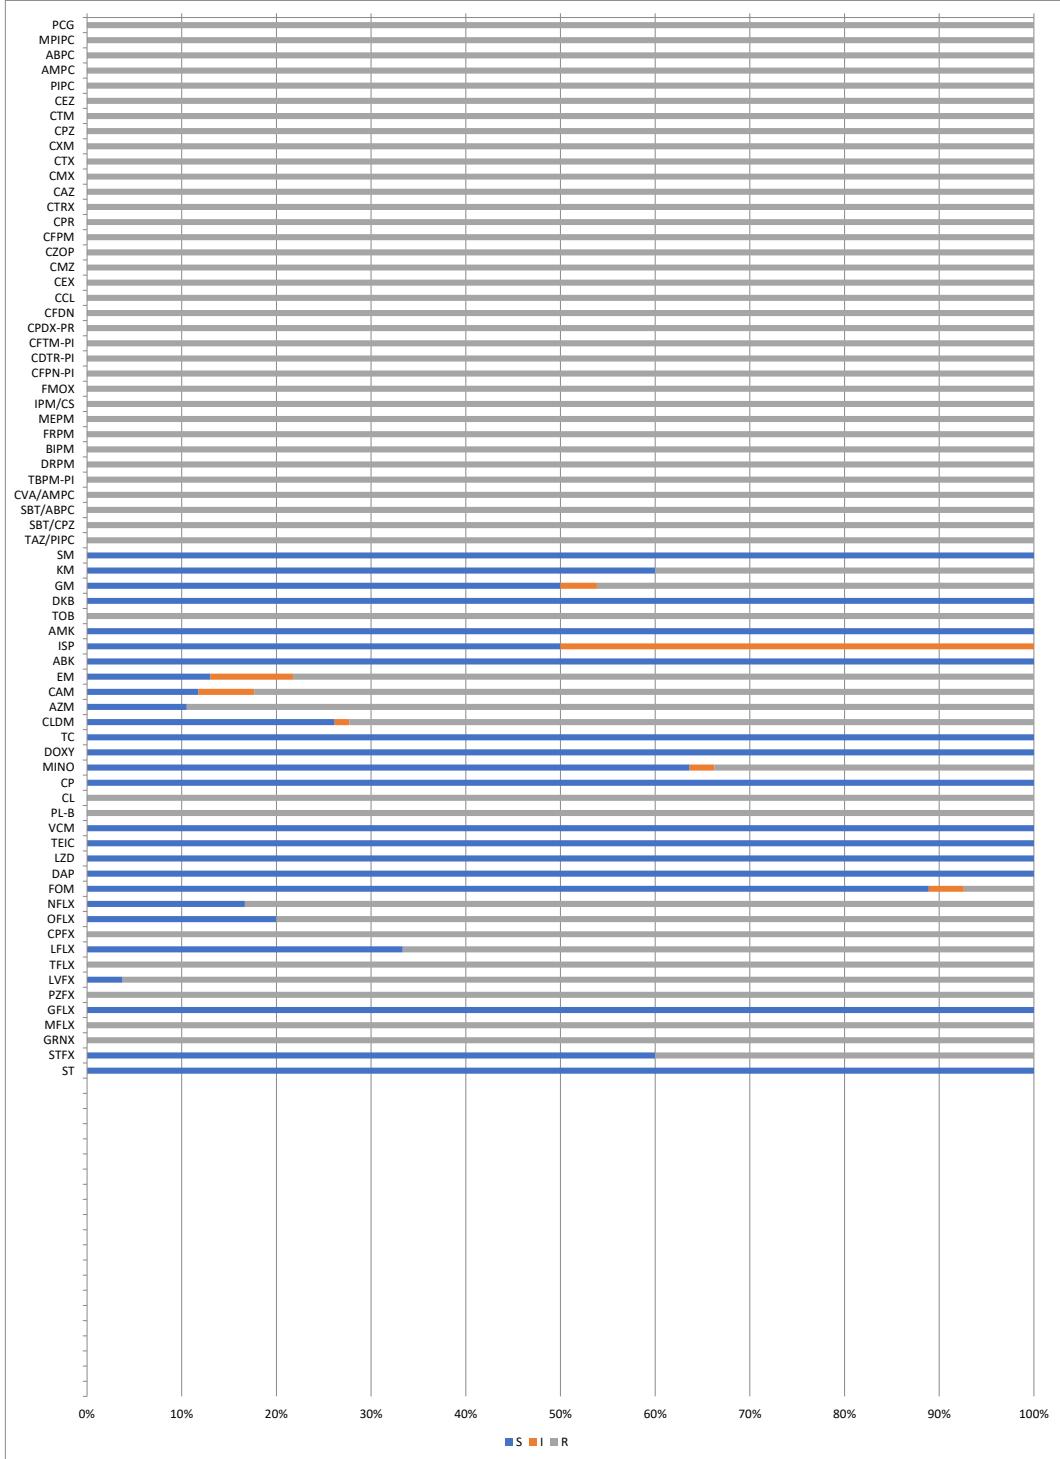

## 指定感染菌 薬剤感受性状況

受付日	菌
2025/10/01~2025/10/31	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	45(100%)	45(100%)
MPIC	0(0%)	0(0%)	45(100%)	45(100%)
ABPC	0(0%)	0(0%)	12(100%)	12(100%)
AMPC	0(0%)	0(0%)	22(100%)	22(100%)
PIPC	0(0%)	0(0%)	35(100%)	35(100%)
CEZ	0(0%)	0(0%)	57(100%)	57(100%)
CTM	0(0%)	0(0%)	55(100%)	55(100%)
CPZ	0(0%)	0(0%)	1(100%)	1(100%)
CXM	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	50(100%)	50(100%)
CMX	0(0%)	0(0%)	4(100%)	4(100%)
CAZ	0(0%)	0(0%)	23(100%)	23(100%)
CTRX	0(0%)	0(0%)	36(100%)	36(100%)
CPR	0(0%)	0(0%)	4(100%)	4(100%)
CFPM	0(0%)	0(0%)	60(100%)	60(100%)
CZOP	0(0%)	0(0%)	8(100%)	8(100%)
CMZ	0(0%)	0(0%)	63(100%)	63(100%)
CEX	0(0%)	0(0%)	5(100%)	5(100%)
CCL	0(0%)	0(0%)	8(100%)	8(100%)
CFDN	0(0%)	0(0%)	12(100%)	12(100%)
CPDX-PR	0(0%)	0(0%)	7(100%)	7(100%)
CFTM-PI	0(0%)	0(0%)	7(100%)	7(100%)
CDT-PI	0(0%)	0(0%)	17(100%)	17(100%)
CFPN-PI	0(0%)	0(0%)	23(100%)	23(100%)
FMOX	0(0%)	0(0%)	44(100%)	44(100%)
IPM/CS	0(0%)	0(0%)	62(100%)	62(100%)
MEPM	0(0%)	0(0%)	27(100%)	27(100%)
FRPM	0(0%)	0(0%)	10(100%)	10(100%)
BIPM	0(0%)	0(0%)	6(100%)	6(100%)
DRPM	0(0%)	0(0%)	8(100%)	8(100%)
TBPM-PI	0(0%)	0(0%)	1(100%)	1(100%)
CVA/AMPC	0(0%)	0(0%)	14(100%)	14(100%)
SBT/ABPC	0(0%)	0(0%)	71(100%)	71(100%)
SBT/CPZ	0(0%)	0(0%)	63(100%)	63(100%)
TAZ/PIPC	0(0%)	0(0%)	23(100%)	23(100%)
SM	6(100%)	0(0%)	0(0%)	6(100%)
KM	3(60.0%)	0(0%)	2(40.0%)	5(100%)
GM	13(50.0%)	1(3.8%)	12(46.2%)	26(100%)
DKB	2(100%)	0(0%)	0(0%)	2(100%)
TOB	0(0%)	0(0%)	1(100%)	1(100%)
AMK	28(100%)	0(0%)	0(0%)	28(100%)
ISP	1(50.0%)	1(50.0%)	0(0%)	2(100%)
ABK	47(100%)	0(0%)	0(0%)	47(100%)
EM	3(13.0%)	2(8.7%)	18(78.3%)	23(100%)
CAM	4(11.8%)	2(5.9%)	28(82.4%)	34(100%)
AZM	2(10.5%)	0(0%)	17(89.5%)	19(100%)
CLDM	17(26.2%)	1(1.5%)	47(72.3%)	65(100%)
TC	1(100%)	0(0%)	0(0%)	1(100%)
DOXY	2(100%)	0(0%)	0(0%)	2(100%)
MINO	49(63.6%)	2(2.6%)	26(33.8%)	77(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
CL	0(0%)	0(0%)	1(100%)	1(100%)
PL-B	0(0%)	0(0%)	6(100%)	6(100%)
VCM	74(100%)	0(0%)	0(0%)	74(100%)
TEIC	58(100%)	0(0%)	0(0%)	58(100%)
LZD	54(100%)	0(0%)	0(0%)	54(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	24(88.9%)	1(3.7%)	2(7.4%)	27(100%)
NFLX	1(16.7%)	0(0%)	5(83.3%)	6(100%)
OFLX	1(20.0%)	0(0%)	4(80.0%)	5(100%)
CPFX	0(0%)	0(0%)	20(100%)	20(100%)
LFLX	1(33.3%)	0(0%)	2(66.7%)	3(100%)
TFLX	0(0%)	0(0%)	4(100%)	4(100%)
LVFX	3(3.8%)	0(0%)	77(96.3%)	80(100%)
PZFX	0(0%)	0(0%)	2(100%)	2(100%)
GFLX	1(100%)	0(0%)	0(0%)	1(100%)
MFLX	0(0%)	0(0%)	2(100%)	2(100%)
GRNX	0(0%)	0(0%)	20(100%)	20(100%)
STFX	6(60.0%)	0(0%)	4(40.0%)	10(100%)
ST	30(100%)	0(0%)	0(0%)	30(100%)