


指定感染菌 薬剤感受性状況

抽出条件

受付日	菌	医療機関
2025/11/01~2025/11/30	S.aureus (MRSA)	

指定感染菌 検出推移グラフ

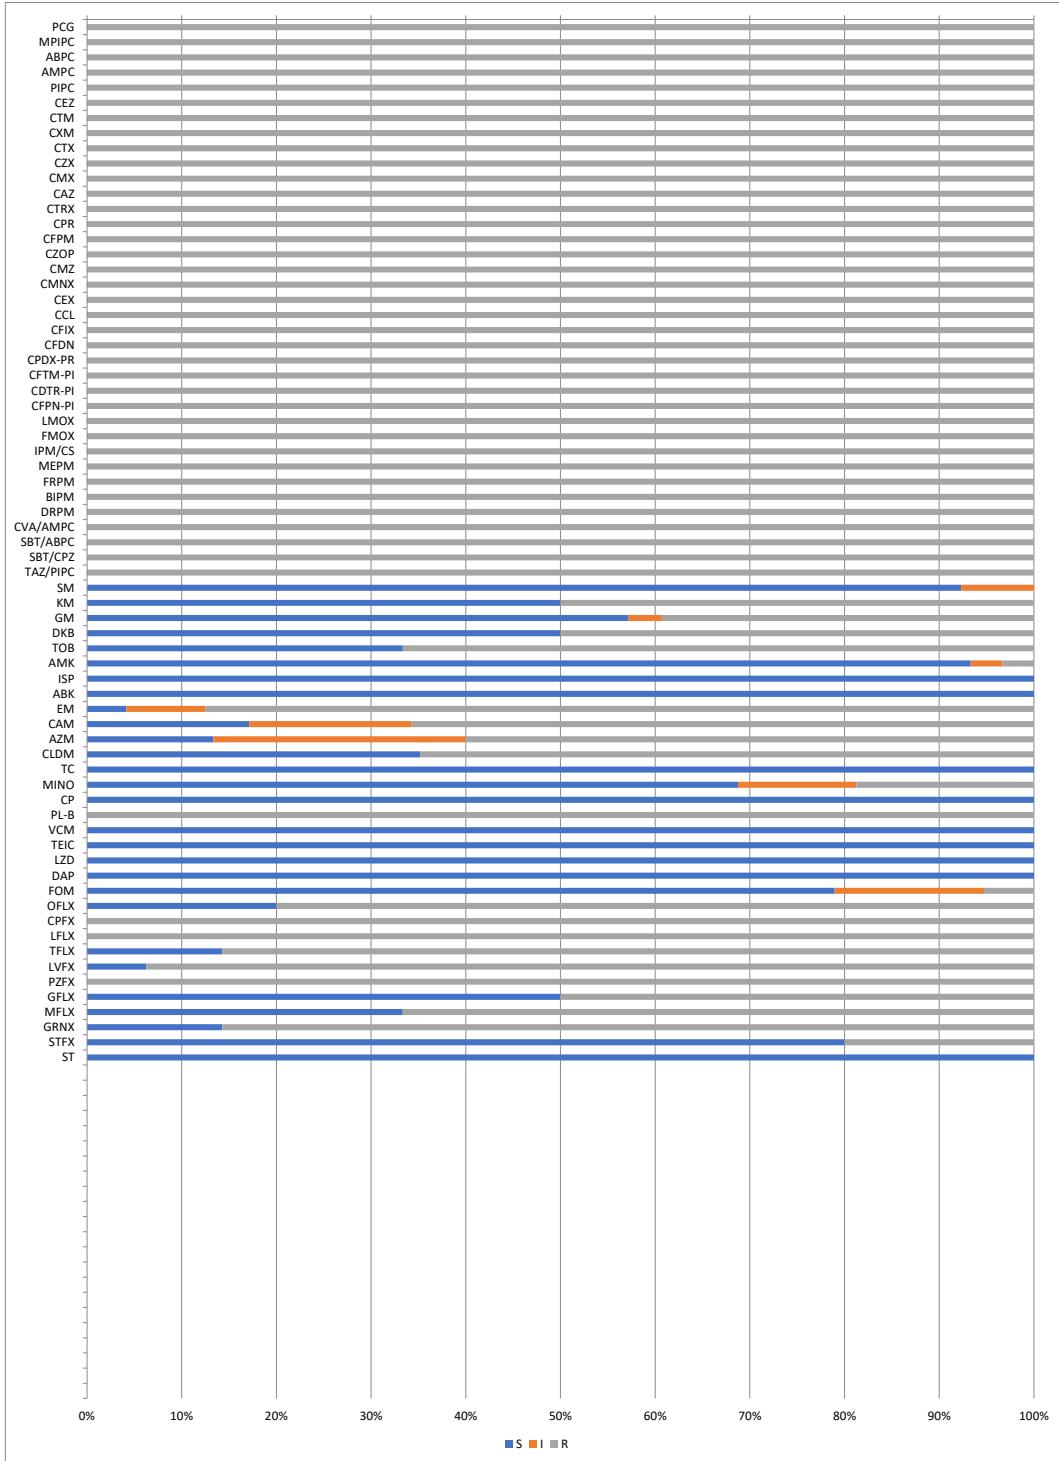

指定感染菌 薬剤感受性状況

受付日	菌
2025/11/01~2025/11/30	S.aureus (MRSA)

指定感染菌 薬剤感受性状況表

	S	I	R	合計
PCG	0(0%)	0(0%)	26(100%)	26(100%)
MPIC	0(0%)	0(0%)	28(100%)	28(100%)
ABPC	0(0%)	0(0%)	9(100%)	9(100%)
AMPC	0(0%)	0(0%)	25(100%)	25(100%)
PIPC	0(0%)	0(0%)	33(100%)	33(100%)
CEZ	0(0%)	0(0%)	49(100%)	49(100%)
CTM	0(0%)	0(0%)	36(100%)	36(100%)
CXM	0(0%)	0(0%)	1(100%)	1(100%)
CTX	0(0%)	0(0%)	28(100%)	28(100%)
CZX	0(0%)	0(0%)	2(100%)	2(100%)
CMX	0(0%)	0(0%)	3(100%)	3(100%)
CAZ	0(0%)	0(0%)	25(100%)	25(100%)
CTRX	0(0%)	0(0%)	36(100%)	36(100%)
CPR	0(0%)	0(0%)	2(100%)	2(100%)
CFPM	0(0%)	0(0%)	49(100%)	49(100%)
CZOP	0(0%)	0(0%)	5(100%)	5(100%)
CMZ	0(0%)	0(0%)	46(100%)	46(100%)
CMNX	0(0%)	0(0%)	1(100%)	1(100%)
CEX	0(0%)	0(0%)	3(100%)	3(100%)
CCL	0(0%)	0(0%)	12(100%)	12(100%)
CFIX	0(0%)	0(0%)	1(100%)	1(100%)
CFDN	0(0%)	0(0%)	10(100%)	10(100%)
CPDX-PR	0(0%)	0(0%)	10(100%)	10(100%)
CFTM-PI	0(0%)	0(0%)	2(100%)	2(100%)
CDTR-PI	0(0%)	0(0%)	20(100%)	20(100%)
CFPN-PI	0(0%)	0(0%)	20(100%)	20(100%)
LMOX	0(0%)	0(0%)	1(100%)	1(100%)
FMOX	0(0%)	0(0%)	28(100%)	28(100%)
IPM/CS	0(0%)	0(0%)	49(100%)	49(100%)
MEPM	0(0%)	0(0%)	27(100%)	27(100%)
FRPM	0(0%)	0(0%)	20(100%)	20(100%)
BIPM	0(0%)	0(0%)	2(100%)	2(100%)
DRPM	0(0%)	0(0%)	4(100%)	4(100%)
CVA/AMPC	0(0%)	0(0%)	23(100%)	23(100%)
SBT/ABPC	0(0%)	0(0%)	51(100%)	51(100%)
SBT/CPZ	0(0%)	0(0%)	39(100%)	39(100%)
TAZ/PIPC	0(0%)	0(0%)	28(100%)	28(100%)
SM	12(92.3%)	1(7.7%)	0(0%)	13(100%)
KM	15(50.0%)	0(0%)	15(50.0%)	2(100%)
GM	16(57.1%)	1(3.6%)	11(39.3%)	28(100%)
DKB	1(50.0%)	0(0%)	1(50.0%)	2(100%)
TOB	1(33.3%)	0(0%)	2(66.7%)	3(100%)
AMK	28(93.3%)	1(3.3%)	1(3.3%)	30(100%)
ISP	1(100%)	0(0%)	0(0%)	1(100%)
ABK	28(100%)	0(0%)	0(0%)	28(100%)
EM	1(4.2%)	2(8.3%)	21(87.5%)	24(100%)
CAM	6(17.1%)	6(17.1%)	23(65.7%)	35(100%)
AZM	2(13.3%)	4(26.7%)	9(60.0%)	15(100%)
CLDM	19(35.2%)	0(0%)	35(64.8%)	54(100%)
TC	1(100%)	0(0%)	0(0%)	1(100%)
MINO	44(68.8%)	8(12.5%)	12(18.8%)	64(100%)
CP	2(100%)	0(0%)	0(0%)	2(100%)
PL-B	0(0%)	0(0%)	2(100%)	2(100%)
VCM	57(100%)	0(0%)	0(0%)	57(100%)
TEIC	49(100%)	0(0%)	0(0%)	49(100%)
LZD	42(100%)	0(0%)	0(0%)	42(100%)
DAP	1(100%)	0(0%)	0(0%)	1(100%)
FOM	15(78.9%)	3(15.8%)	1(5.3%)	19(100%)
OFLX	1(20.0%)	0(0%)	4(80.0%)	5(100%)
CPFX	0(0%)	0(0%)	20(100%)	20(100%)
LFLX	0(0%)	0(0%)	1(100%)	1(100%)
TFLX	2(14.3%)	0(0%)	12(85.7%)	14(100%)
LVFX	4(6.3%)	0(0%)	60(93.8%)	64(100%)
PZFX	0(0%)	0(0%)	4(100%)	4(100%)
GFLX	1(50.0%)	0(0%)	1(50.0%)	2(100%)
MFLX	1(33.3%)	0(0%)	2(66.7%)	3(100%)
GRNX	3(14.3%)	0(0%)	18(85.7%)	21(100%)
STFX	4(80.0%)	0(0%)	1(20.0%)	5(100%)
ST	26(100%)	0(0%)	0(0%)	26(100%)